


CONCRETE MASONRY MANUAL

Seventh Edition 2005



***Incorporating masonry requirements
of the NHBRC Home Building Manual***

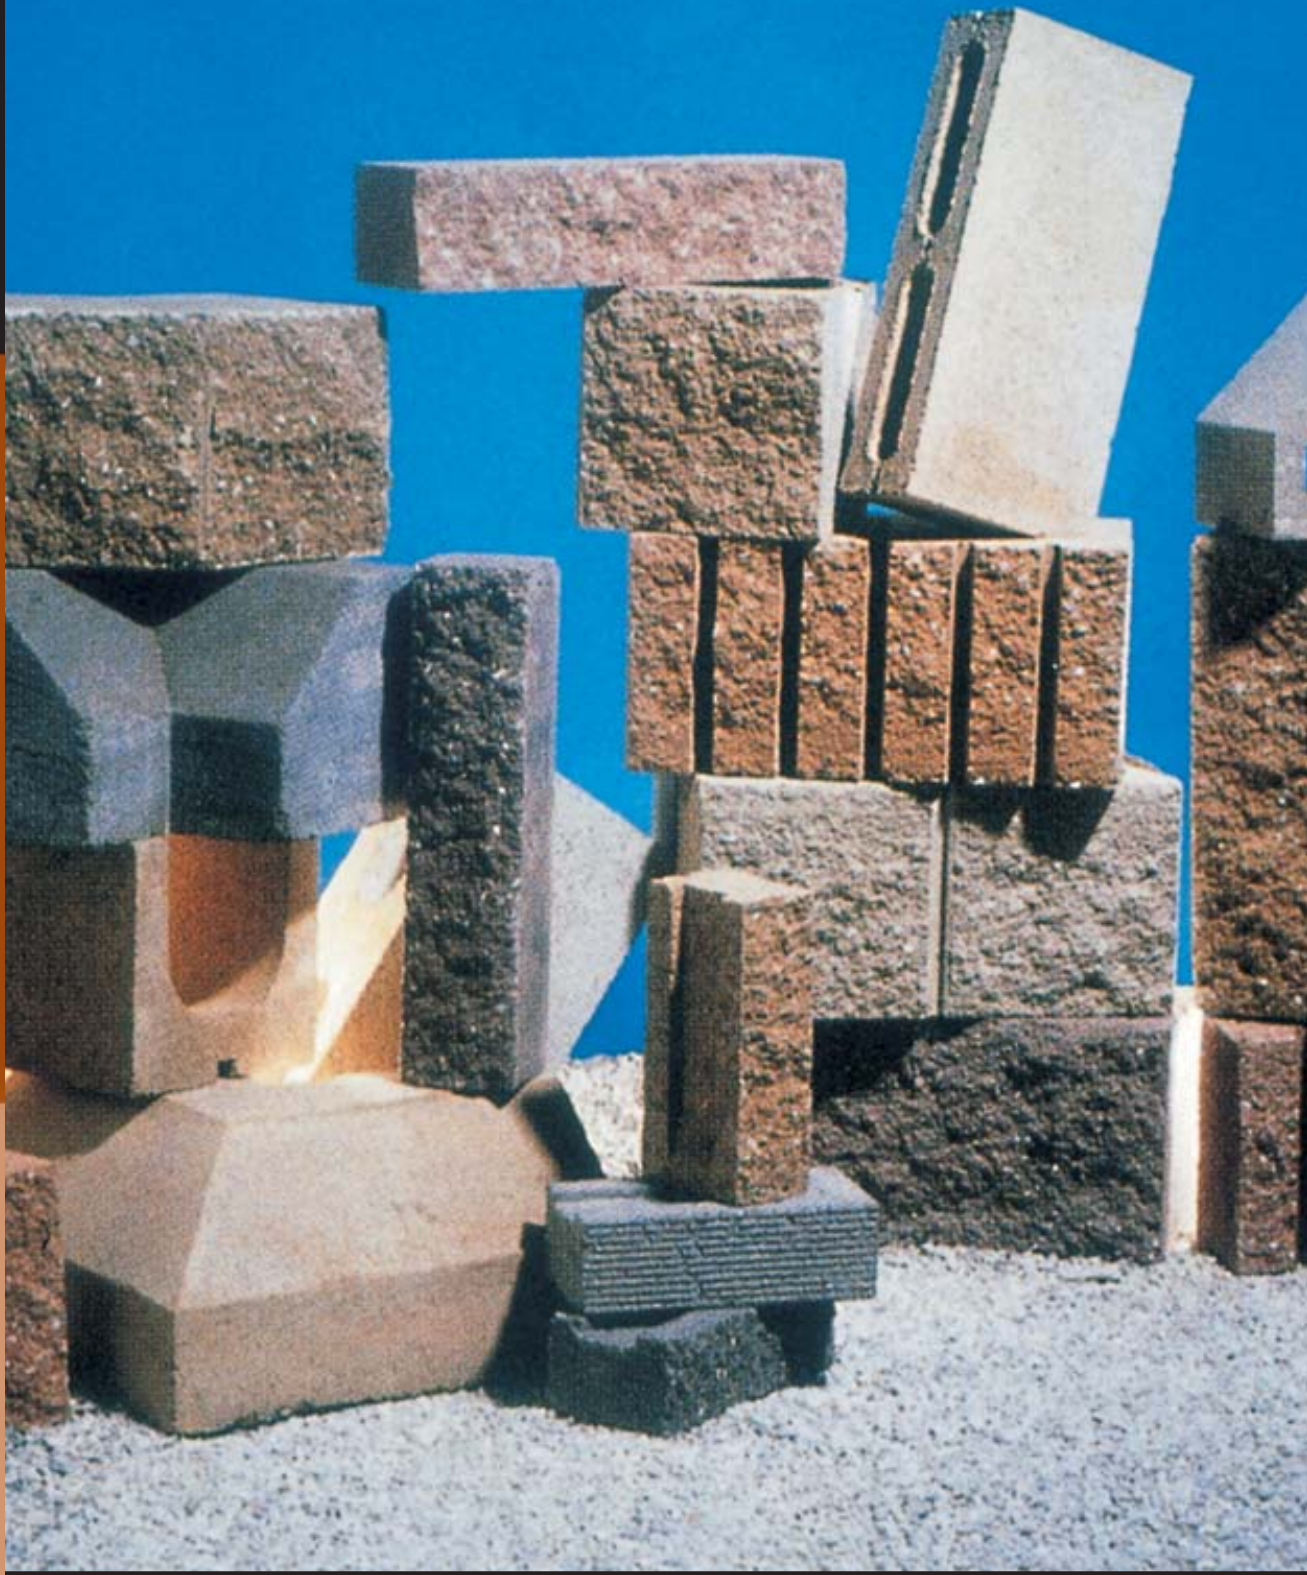



PREFACE

Though SANS 10400 Application of the National Building Regulations is at present being revised the demand for a partly updated manual is such that the seventh edition of the manual has been published.

Chapter 4 Building Regulations is based on the National Home Builders Registration Council Home Building Manual, and remains unchanged. The HBM recommendations used the Joint Structural Division (South African Institution of Civil Engineering and the Institution of Structural Engineers, UK) code of practice for foundations and superstructures for single storey residential buildings of masonry construction as the basis for their manuals.

Thus it is not anticipated that there will be any major changes in the structural aspects of building in masonry.

It is proposed that the eighth edition of the Masonry Manual will be printed incorporating the revised SANS10400 once promulgated.

Published by
Concrete Manufacturers Association
P O Box 168
Halfway House 1685
Telephone: +27 11 805-6742
Facsimile: + 27 11 315-4683
e-mail: cma@mweb.co.za
Web site: www.cma.org.za
Seventh Edition – revised 2005.
Illustrations: John L Betts MIA
Editor: J W Lane
ISBN: 0-9584142-7-0

MASONRY PRODUCER MEMBERS (MAY 2005)

A Fick Cement Works	(022) 913-1921
Brick and Concrete Industries (Pty) Ltd	(09264) 61 321 3000
Cape Brick cc	(021) 511 2006
Coastal Bricks	(041) 372 2230
Columbia DBL	(021) 905 1665
Concor Technicrete (Pty) Ltd	(011) 495 2200
Deranco Blocks (Pty) Ltd	(041) 463 3338
False Bay Bricks (Cape)	(021) 904 1620
Inca Masonry Products (Pty) Ltd	(043) 745 1215
Infraset	(012) 652 0000
Lategan's Cement Works	(021) 873 1154
Morula Brick & Sand (Pty) Ltd	(012) 549 1727
Neat Contech cc	(046) 624 3377
Panda	(09267) 241 4089
Pro Brick & Block cc	(021) 905 3362
Stanger Brick & Tile (Pty) Ltd	(032) 457 0237
Van Dyk Steengroewe	(022) 7131244
Watson Concrete (Pty) Ltd	(011) 740 0910
White River Cement Bricks	(013) 750 1271



Portland Park, Old Pretoria Road, Halfway House 1685, South Africa.
PO Box 168 Halfway House 1685
Tel +27 11 805 6742, Fax +27 11 315 4683
e-mail: cma@cis.co.za website: www.cma.org.za

**DETAILING OF
CONCRETE MASONRY**

Volume 1 – Solid Units 140



*Concrete masonry: Strong, durable
and attractive*



**DETAILING OF
CONCRETE MASONRY**

Volume 2 – Hollow Units 140/190




*Concrete masonry: Strong,
durable and attractive*



**DETAILING OF
CONCRETE MASONRY**

Volume 3 – Cavity Walls 240/290

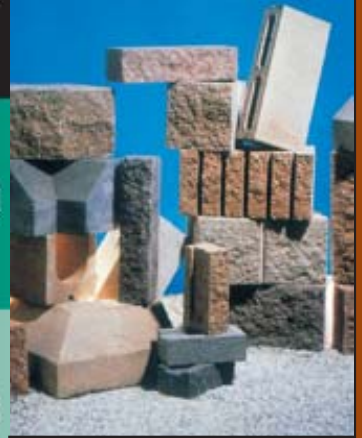

*Concrete masonry: Strong, durable
and attractive*



Portland Park, Old Pretoria Road, Halfway House 1685, South Africa.
PO Box 168 Halfway House 1685
Tel +27 11 805 6742, Fax +27 11 315 4683
e-mail: cma@cis.co.za website: www.cma.org.za

CONCRETE MASONRY MANUAL

SEVENTH EDITION 2005

EDITOR: J W LANE



CONTENTS

CHAPTER 1

Properties of concrete masonry units

Standard specification	4
Physical conditions	4
Other properties	5
Typical masonry units	7
Specific masonry units for reinforced masonry	8

CHAPTER 2

Performance criteria for walling

Structural strength and stability	10
Durability	10
Accommodation of movement	10
Weatherproofness	11
Acoustic properties	11
Thermal properties	12
Fire resistance	13

CHAPTER 3

Modular co-ordination and design

Co-ordinating sizes	15
Blocks	15
Modular detailing and building	16

CHAPTER 4

Building regulations

National Building Regulations. Part K: Walls	18
SANS 10400: Application of the National Building Regulations.	18
Part K: Walls. Part KK Rules	18
NHBRC Home Building Manual	21
Walling in single and double storey units	23
Foundation walls	34
Retaining walls	35
Free-standing walls	36
Control joints	39
Securing timber roof trusses, rafters and the like	40
Lintels	41

CHAPTER 5

Specification and construction details

Materials	46
Storage of materials	52
Notes on the properties of mortar for masonry	52
Mortar quality	54
Laying practice	55
The use of concrete and clay masonry units in the same wall	67
Rain penetration through masonry walls	70
Efflorescence on concrete masonry	71
Good laying practice illustrated	74
Good detailing practice illustrated	76

CHAPTER 6

Schedule of site checks

Schedule of site checks for concrete masonry construction	77
Accuracy in building	83

CHAPTER 7

Quantities

Quantities of masonry units and mortar	84
Mortar mix quantities of materials	85
Examples of calculations for masonry units and mortar in a wall	86

APPENDIX

Standards, codes of practice and references on the manufacture and use of concrete masonry	89
--	----

INDEX

91



1 PROPERTIES OF CONCRETE MASONRY UNITS

A concrete masonry unit is a preformed building unit of rectangular shape that is intended for use in the construction of bonded masonry walling. It is either solid or hollow and formed from a mixture of cement, aggregate and water.

The units are made in a range of sizes, shapes, colours, textures and profiles and are designed to meet various requirements such as strength, thermal and acoustic insulation and fire resistance.

When selecting units for any project, the appropriate unit should be used with a view to cost and desired properties.

STANDARD SPECIFICATION

The standard for concrete masonry units is SANS 1215. This standard covers the physical requirements and the sampling of units for testing.

Assurance of compliance with the quality requirements of this standard is by obtaining the SABS Certification Mark that the concrete masonry units manufactured comply with the requirements of SANS 1215. This certificate will indicate to purchasers that the concrete masonry units are produced under acceptable controlled conditions with appropriate materials. SABS accredited laboratories are permitted to perform the appropriate testing requirements on behalf of SABS in the awarding of the mark.

PHYSICAL CONDITIONS

1. Overall dimensions

Dimensions of concrete masonry units do not appear in SANS 1215, amendment No. 2 but in Appendix F Recommended nominal dimensions of concrete masonry units (see Table 1. 1).

The use of modular size masonry units is essential if buildings are designed to the 100mm standard module – as stated in SANS 993 Modular co-ordination in building. Figure 1. 1 shows the dimensions of the main types of masonry units of modular dimensions.

Modular planning is based on a nominal joint thickness of 10mm.

Modular wall thicknesses, as stated in SANS 10400, are 90, 140 and 190mm.

“A block is any masonry unit which has a length between 300 and 650mm or a width between 130 and

300mm or a height between 120 and 300mm. A brick is any masonry unit which is not a block”.

Although the nominal dimensions of closure units (eg. half units, quarter units, etc.) used in a walling system are not given, such units may be used, provided that they comply with all the requirements of SANS 1215.

The permissible thickness of masonry walls in building is 90, 110, 140, 190 and 230mm and the modular dimensions are 90, 140 and 190mm.

In the marketplace there is a proliferation of different sizes of masonry units. Mainly these are based on the “imperial” brick size of 222 x 106 x 73 mm, or multiples of this size up to block size units of 448 x 224 x 224 mm. The width of these units exceeds the requirements of SANS 10400, namely 106 and 224 mm wall thickness as compared to the “deemed to satisfy” thicknesses of 90 and 190 mm. Thus for commercial reasons, units of reduced width are being made which are non-modular and non-imperial, such as 222 x 90 x 73 mm that satisfy the minimum requirements of SANS 10400.

Non-modular sizes of units are found in practice not to bond well without considerable cutting of the units. English or Flemish bond and construction of square brick piers is not possible as such units deviate from the basic principle of masonry bonding where the length of a unit should be twice its width plus the thickness of the bedding or perpend joint.

Generally, for easier, cost-effective and sound building practice, the unit size should be based on the principles of modular co-ordination. (See Figure 1. 1 Dimensions of main types of masonry units of modular dimension)

Table 1. 1 **Nominal dimensions of masonry units** (SANS 1215 - Table F-1)

WORK SIZES, mm		
Length	Width	Height
190	90	90
290	90	90
390	90	190
390	190	190

2. Strength

Units are available in a wide range of strengths as illustrated in Table 1.2.

The compressive strength of a unit is based on its gross or overall area. The class of masonry unit required is described by reference to its nominal compressive strength in MPa. The minimum strength of blocks is 3,5 MPa and of bricks 7 MPa. Normally all units with a compressive strength exceeding 10,5 MPa are solid, i.e. not hollow. A solid unit contains cavities (also referred to as cores) not exceeding 25% of the gross volume of the unit while a hollow unit contains cavities constituting in excess of 25% but not exceeding 60%.

The National Home Builders Registration Council Home Building Manual (referred to in the text as NHBRC – HBM) permits units of minimum compressive strength, in MPa, of 3,0 for hollow units and 4,0 and 5,0 for solid units depending on on-site or off-site manufacture respectively. With low strength units, breakages on handling, transporting and building in must be considered in their use.

Table 1.2 **Compressive strength of masonry units** (SANS 1215 -Table 2)

Nominal compressive strength, MPa	Compressive strength MPa, min	
	Average for 5* units	Individual units
3,5	4,0	3,0
7,0	8,0	5,5
10,5	11,5	8,5
14,0	15,5	11,0
21,0	23,5	17,0

* In the case of units having an overall length of 290mm or less, an average of 12 units is taken.

OTHER PROPERTIES

Tolerances (see Table 1.3), squareness, surface texture and appearance are specified in the relevant SANS standard.

The use of customised masonry is increasing and units of various colours, textures and profiles ranging from plain, close-textured faces to split-faced, exposed-aggregate and ribbed surfaces are being specified. These units do not usually require any surface finish or treatment (i.e. paint or plaster).

Samples of the units should be requested by the client for quality and colour approval before orders are placed. (See section on typical masonry units).

Drying shrinkage should not exceed 0,06%.

Table 1.3 **Tolerances on work sizes** (SANS 1215 - Table 1)

Work size	Tolerances, mm
Length	+ 2
	- 4
Width	* ± 3
Height	± 3

***Note:** In the case of FUA (face unit aesthetic) the tolerance on the overall width shall be ± 10mm .

Expansion on re-wetting should not exceed the value of drying shrinkage by more than 0,02%. When units are made from slag or clinker or burnt clay brick aggregates, the soundness of the unit should be checked to ensure that pop-outs do not exceed the specified amount.

Where units will be exposed to the weather, the design and detailing of the building are important factors in limiting efflorescence.

Water absorption of units is not specified in SANS 1215. This is not regarded as a significant characteristic of a concrete masonry unit where weather conditions in South Africa are mild, where freezing and thawing seldom occur. Water absorption is a measure of water absorbed in a unit for a particular laboratory test and does not measure or describe the porosity or permeability of a masonry unit.

Porosity is a measure of the total volume of voids in a unit and reflects the overall density of the unit. If pores are discontinuous then the unit is considered impermeable.

Permeability is a measure of the flow of a liquid or a gas through a unit under pressure. This is a significant factor determining resistance to rain penetration through a wall. However, weather proofing a building is primarily related to the wall design and workmanship. Permeability of masonry units subjected to a corrosive environment may be significant where reinforcement is incorporated in the core of a unit or in a cavity of a wall and where the infill concrete cover to the reinforcement is inadequate on the exposed face.

Initial rate of absorption (IRA) specified in SANS 10164 Part 1 is a measure of the amount of water absorbed into the bed face of a unit in one minute, i.e. initial suction. This is generally not a significant property of concrete masonry units for use in walls. Masonry units made of materials other than concrete may be more sensitive to the IRA where it affects bonding of mortar to the masonry unit.




























Figure 1.1: **Dimensions of main types of masonry units of modular dimension.**

(Note: Check with local supplier availability of different units)

TYPICAL MASONRY UNITS

Concrete masonry offers the designer a rich variety of dimensions, aspect ratios, textures, colours and profiles as the basis of wall design. Innovations in the manufacturing process have added greatly to the palette of possible colours with the introduction of multiblend as distinct from monochromatic units.

The range of masonry units available will vary considerably from one manufacturer to another, depending on local needs and building practice. Details which follow cover typical face units displaying variations in textures and profile.

No attempt has been made to list colours from the almost limitless range of blended colours made possible with the most recent architectural facing units. Colour availability is a function of local aggregates and cements and will vary considerably from one locality to another. Colour requirements should always be checked with the supplier.

The density or mass of the unit manufactured will depend on the density of the aggregates used, whether natural aggregate or low density (light-weight) aggregates are used.

Textures

Plain face units are available in solids and hollows in "block sized" units, and in both "modular" and "standard" brick sizes. (See Figure 1.2).

Split face units are amongst the most popular facing units supplied.

They are produced as "double-sized" elements. After curing, the elements are split by shearing to defined profiles.

The standard splitter induces a vertical split, giving a block or brick with a tailored finish. The size and

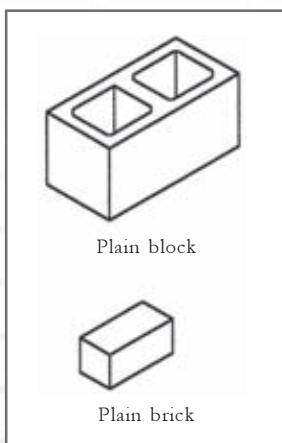


Figure 1.2:
Plain face units

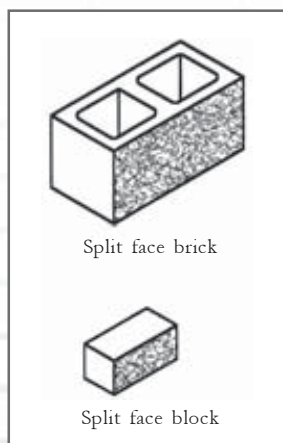


Figure 1.3:
Split face units

colour of the coarse aggregate particles in the concrete mix have a marked effect on the appearance of the finished face. Where the colour of the coarse aggregate contrasts with that of the matrix, the aggregate particles will "read" quite clearly in the finished face. Split face units come in the full range of sizes and in various colours. (See Figure 1.3).

Profiles

Concrete masonry is one of the few manufactured structural components in which a strongly profiled surface effect can be achieved.

Split-fluted block: This type of block is deservedly popular. It provides the most vigorous profile obtainable in concrete masonry. The forms of fluting which can be incorporated are almost limitless, from the provision of minor grooves in the face to the use of substantial protruding ribs.

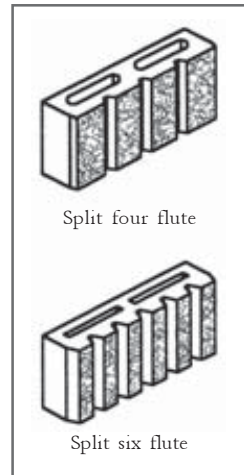


Figure 1.4:
Split-fluted blocks

A wide variety of profiles has been used, the main variations being the width of the split rib relative to the smooth-faced channel. (See Figure 1.4).

Colour

All masonry units can be produced in a rich variety of colours. The prime determinants of colour are:

- the colour of the cement
- the colour of the fine aggregates
- the curing system

These can be varied to produce a limited range of subdued colours.

A much bigger range, including strong colours, can be obtained by the introduction of metallic oxide pigments.

Colour control is more precise than with any other masonry walling material, but, because all colours are a function of variable raw materials, curing techniques and atmospheric conditions prior to curing, some minor colour variation is inevitable in concrete masonry manufacture.

Variations in colour will tend to occur between pallets. It is, therefore, good practice to select units at random from several pallets rather than to draw from a single batch. In this way any variation in colour tends

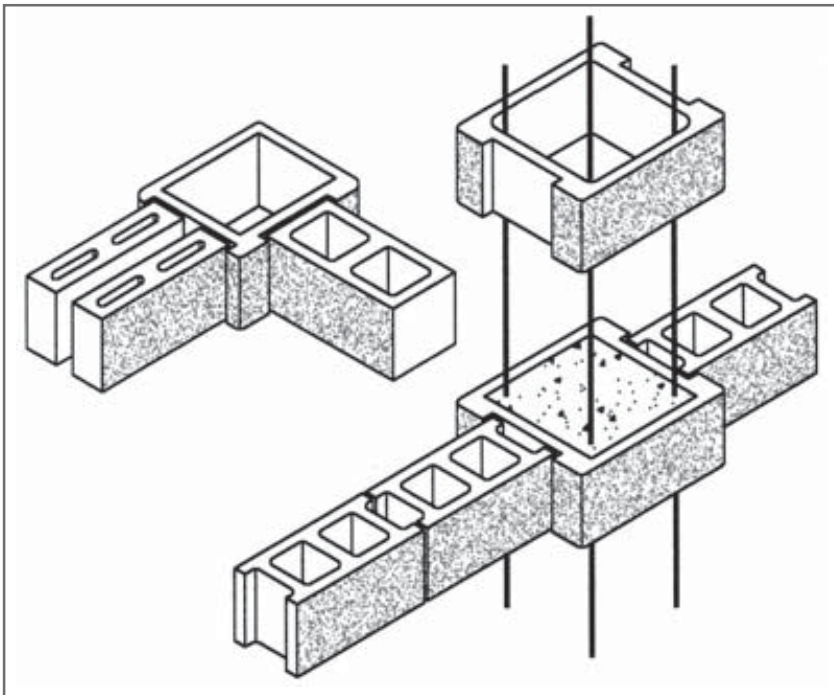


Figure 1.5: **Pilaster blocks**

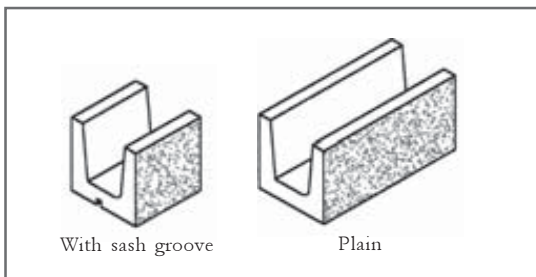


Figure 1.6: **U-beam and lintel units**

to be scattered randomly within the wall, and areas of localised contrast are avoided. The resulting wall tends to look a little less contrived than if a completely uniform colour prevails throughout and is more attractive.

SPECIFIC MASONRY UNITS FOR REINFORCED MASONRY

For ease of placing and fixing of reinforcement and housing the infill concrete or grout in hollow masonry units used in reinforced masonry specific units are manufactured such as U-beam, lintel units, bond blocks, single and double open end units and pilaster blocks.

Pilaster blocks

Pilaster blocks are used to strengthen and stabilise walls, to create corners and piers, to locate control joints and to create certain architectural effects. The pilaster block may be used with or without reinforced concrete in the core (see Figure 1.5).

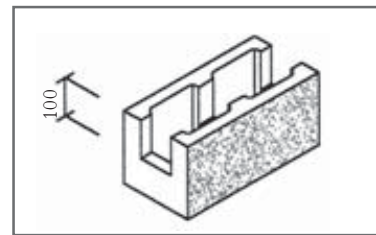


Figure 1.7 **Bond block**

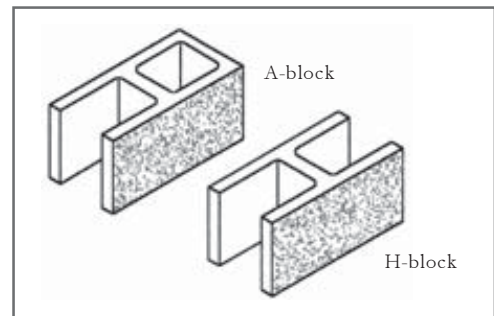


Figure 1.8 **Single and double open end units**

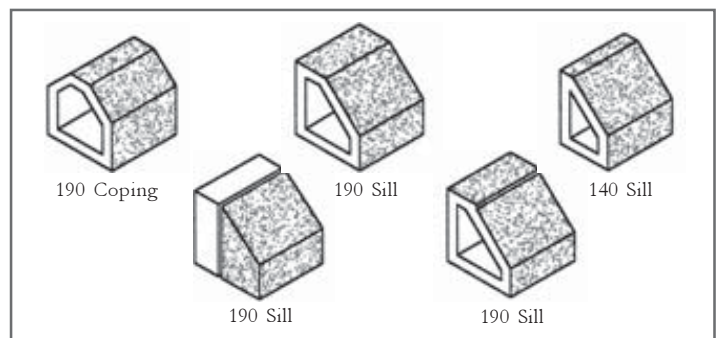


Figure 1.9 **Concrete masonry sills and coping blocks**

U-beam and lintel units

U-beam or lintel units are used over window or door openings to house the horizontal reinforcement required. Because of the way they are manufactured (extruded out of their mould such that the vertical face of the unit must be smooth or textured by being subsequently split), U-beam or lintel units cannot be made with a profile, such as fluted or ribbed. However, these units can be made with a sash groove to house the vertical leg of the transom of the steel window (see Figure 1.6). U-beam and lintel units can be laid on their side to form a vertical cavity to house vertical reinforcement.

Bond blocks

Bond blocks can be cut or manufactured. They can be made with the same colour, profile and texture as the standard units. Typical outer shell thicknesses are 32 mm for fair face units and 42 mm for rockface units. As the vertical cores are continuous through the hollow blocks, the bottom of these cores must be in

lintels and the cores filled with infill concrete or grout. This can be achieved by laying a fine mesh metal fabric in the bedding course below the cores. The soffit of the bond block lintels may be rendered where exposed (see Figure 1.7).

Single and double open end units

The use of open end units eliminates having to thread units over existing vertical reinforcement in vertically reinforced masonry. The single open end units are termed A-blocks and the double end units H blocks. These blocks may be manufactured or cut to the right shape (see Figure 1.8).

Window sills and coping blocks

Concrete masonry sills and coping blocks can be manufactured of concrete similar to that of concrete masonry units, and on similar equipment to specified profiles and dimensions (see Figure 1.9).

Decorative Block

Many decorative blocks are available. These units can be used in partition walls, fences, screen walls, etc., illustrated below are but a few of the popular patterns (see Figure 1.10).

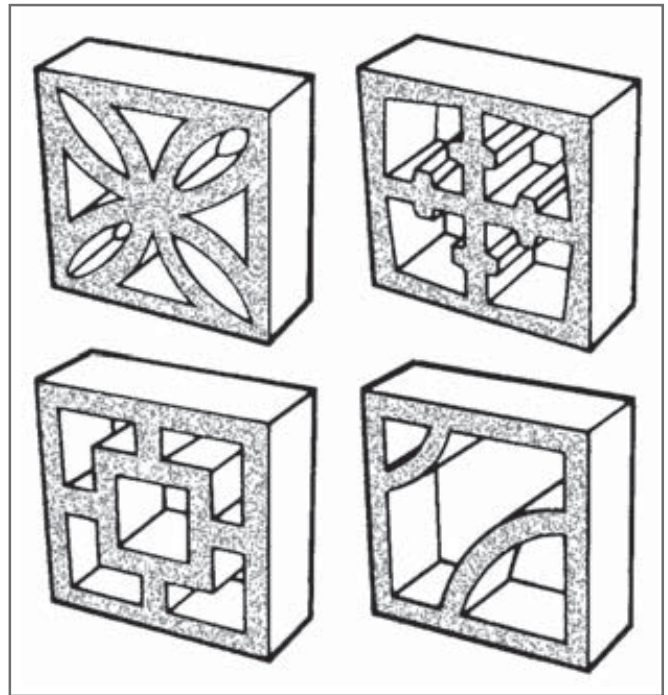


Figure 1.10: Typical decorative blocks

Range of masonry products

The following photograph illustrates the range of products available from some of the larger manufacturers of concrete masonry units. Colours of units available should be checked.

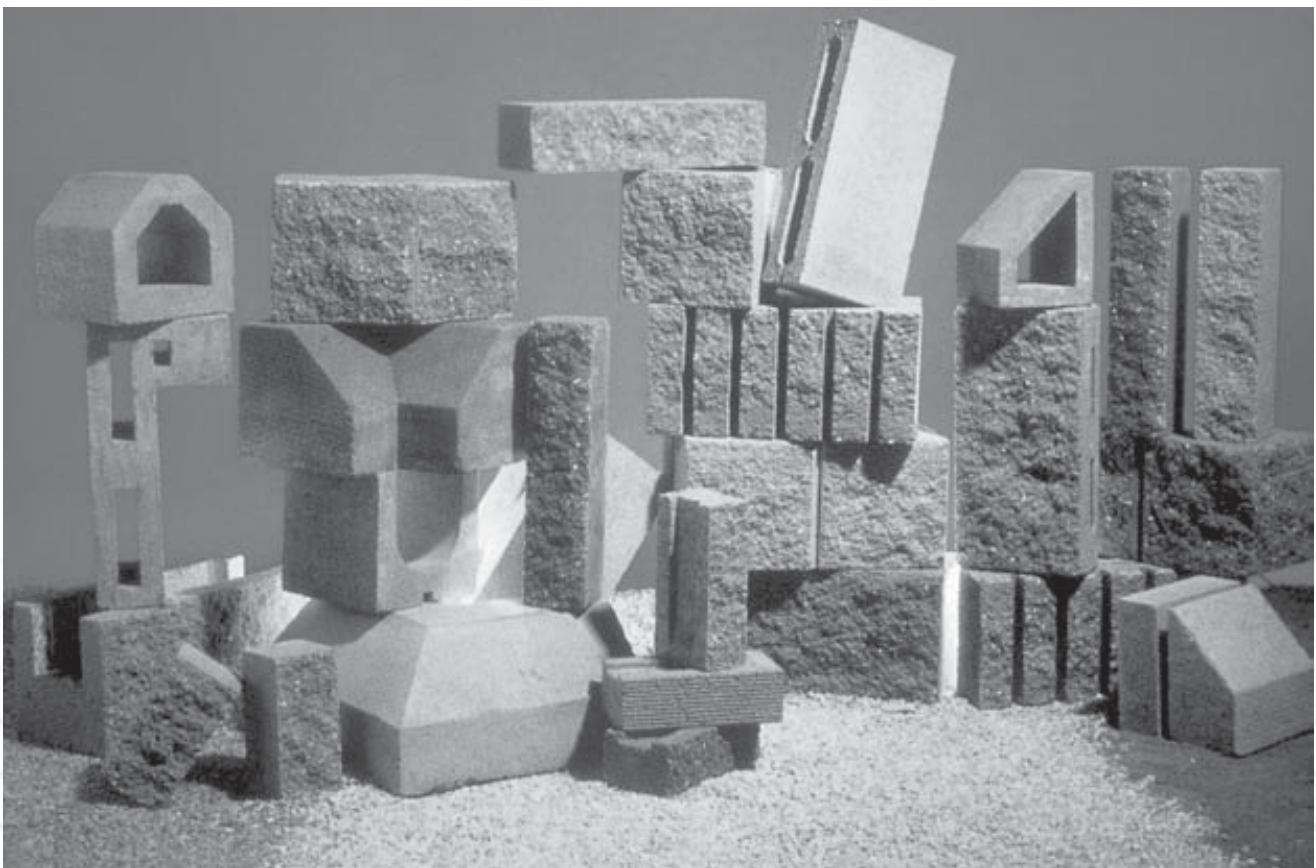


Figure 1.11: Range of masonry products



2 PERFORMANCE CRITERIA FOR WALLING

Any satisfactory walling system must meet certain minimum performance criteria. Special consideration may have to be given to any one or a combination of the following criteria:

- structural strength and stability
- durability
- accommodation of movement
- weatherproofness
- acoustic insulation
- thermal properties
- fire resistance.

Not only must the quality of the masonry units be satisfactory, but the design, detailing, specification and workmanship must be of an appropriate standard.

STRUCTURAL STRENGTH AND STABILITY

Concrete masonry structures will have adequate strength and stability for their purpose when designed and built under competent supervision according to the applicable standards and regulations. For normal buildings reference to tables of permitted dimensions for empirically designed walls is adequate, i.e. NHBRC – HBM. Walls subjected to unusual loads should be designed according to SANS 10164-1.

DURABILITY

Experience has shown that with good detailing, specification, supervision and construction, masonry structures will remain durable for many years. Besides the use of masonry units of satisfactory quality, attention should be given to the type and quality of cement and sand used in the mortar mixes; the avoidance of admixtures that may cause corrosion of reinforcement; the cover to reinforcement and wall ties; and the positioning and sealing of control joints where used. Masonry units shall be sufficiently durable to resist local exposure conditions for the intended life of the building. Durability of concrete masonry units is generally related to compressive strength and Table 2.1 can be taken as a guide where there is no surface protection of the units.

Notes:

Protected zone: Inland areas more than approximately 30 km from the coastline

Moderate zone: The coastal belt extending up to approximately 30 km from the coastline, but excluding the sea spray zone.

Severe zone: This consists of the following areas:

- sea spray zone (eg. the eastern and northern seaward slopes of the Durban Bluff and other exposed headland areas)
- the coastal belt extending north-eastwards from Mtunzini to the Mozambique border and inland for a distance of approximately 15 km (this includes Richards Bay and St. Lucia)
- the coastal belt of Namibia

Very Severe zone: This consists of the following areas:

- areas where high moisture content derived from sea mists, high groundwater tables, high soluble salt content of the soil, together with large temperature fluctuations, combine to create severe exposure and weathering conditions (eg. Walvis Bay)
- industrial areas where high acid and alkaline discharges occur.

Table 2.1: **Recommended nominal compressive strength for durability** (SANS 10 249 -Table F.1)

Exposure zone	Recommended nominal compressive strength, MPa	
	Solid units	Hollow units
Protected	7,0 – 10,5	3,5 – 7,0
Moderate	10,5 – 14,0	7,0 – 14,0
Severe	21,0	14,0
Very Severe	Manufacturer's guidance required	

ACCOMMODATION OF MOVEMENT

An understanding of movement in masonry requires a knowledge of the materials being used and their response to service loads and environmental factors.

All structures are subjected to varying degrees of dimensional change after construction. Determination of movement in response to the environment is a complex problem and not merely a summation or subtraction of extreme or individual values of thermal and moisture movement, but the response of the masonry to these movements must be considered.

Movement in response to each stimulus is controlled

to some extent by the degree of restraint inherent in the masonry and the supporting structure, namely the foundations, beams, slabs, etc.

Furthermore, walls move less horizontally under high vertical stress than walls subjected to lower vertical stress.

Not all movements are reversible. When the stimulus to movement is removed, for example when severe contractions cause cracks in perpend joints when the bond strength between a masonry unit and mortar is exceeded, the crack may not be able to close again due to mechanical interlocking, friction or insufficient force in the opposite direction.

With repeated expansion and shrinkage movement, cracks can become filled with debris, resulting in a ratchet effect which results in a continuous increase in length of the masonry.

In a building, it is often found that the orientation will induce different movements in various parts of the walls due to the incidence of radiation heat or prevailing rain.

An estimation of potential movement in a masonry element must rely to a great extent on engineering judgement. Many factors, such as temperature and moisture content of masonry units and mortar at the time of construction, the exposure to weather conditions and degree of restraint imposed on elements subject to movement are unpredictable.

In general, it is more simple to adopt empirical rules rather than try to estimate movement in a structure from first principles. Stresses in masonry that are sufficient to cause cracks may be controlled or reduced by the use of control joints or reinforcement.

Recommendations for the size and spacing of control joints to accommodate movement are given in SANS 10249 and joint spacing recommendations associated with quantities of reinforcement are given in SANS 10145. In concrete masonry, the recommended spacing of control joints varies from 6m to twice the height of the wall for unreinforced masonry and up to 18,5m for reinforced masonry. Further information on the spacing and position of control joints is given in Chapters 4 and 5.

WEATHERPROOFNESS

The resistance of a building to the ingress of rain depends not only upon the materials used, but on the quality of construction, skill of the designer and the work force, and on orientation, size and environmental exposure of the building.

Water generally enters a wall through fine capillary passages at the interface between masonry unit and mortar or through cracks in the masonry caused by movement

Prevention of rain penetration through walls begins with the design of the building, follows through with the selection of materials and the supervision of workmanship, and continues with maintenance of the structure after its completion.

The procedures to follow for exclusion of moisture from buildings are covered in detail in SANS 10249 and SANS 10021. Rain penetration of a wall can be determined by means of a rain penetration test described in SANS 10400.

It has been found in practice that there is no simple correlation between permeability and porosity of a masonry unit and the performance of test panels using the same units of construction and subjected to the standard rain penetration test.

Single leaf walls are more vulnerable to moisture penetration than cavity walls, where the air space provides an excellent barrier against the passage of moisture. Cavity wall construction should be used in coastal areas. If exposure conditions are severe, all non-cavity exterior walls should be plastered or given some other effective water-proofing coating. Alternatively, non-porous units should be used. The quality of the mortar and the workmanship requires particular attention if the structure is to be weatherproof.

Specific recommendations on reducing rain penetration through walls is given in Chapter 5.

ACOUSTIC PROPERTIES

The acoustic performance of a building is related to the capacity of all the elements of the building (i.e. masonry units, windows, doors, floors and ceilings) to reflect, absorb and transmit sound.

Table 2.2 **Approximate sound insulation values for various types of wall construction (as could be expected in practice); laboratory values would be higher**

Wall thickness, mm	Approximate sound insulation values, la dB		
	90	140	190
Unplastered hollow block unit	40	43	45
Plastered hollow block unit	43	46	48
Unplastered solid block unit	42	45	47



Concrete masonry is a suitable material for attenuating noise as it is a dense material which reduces the transmission of airborne sound. Resistance to sound transmission increases with wall thickness (see Table 2.2). Surface texture, porosity of the concrete and density all affect the transmission and absorption of sound.

The sound insulation properties of a single leaf masonry wall are largely related to the mass per unit area of wall, provided there are no direct air passages through the wall.

The sound insulation properties of a cavity wall are related to its mass per unit area, the width of the cavity and the rigidity and spacing of the wall ties.

Acoustic tests relate sound loss through a wall at various frequencies. The values obtained are used to compare sound insulation values.

To isolate noise requires more than simply providing barrier and sound absorbent walls. Doors and windows of lower acoustic performance than walls will reduce

effective sound attenuation as will fine cracks or badly fitting doors or windows. Noise leakage paths must be sealed by good design and good workmanship. Sound insulation is also affected by floors and ceilings and by the finishes applied to the concrete masonry.

At present there are no acoustic performance criteria in the National Building Regulations.

Minimum values of in situ airborne sound insulation between rooms in a dwelling unit, between adjoining dwelling units and between non-residential school buildings have been set by the Agrément Board of South Africa.

THERMAL PROPERTIES

The thermal performance of a building is related to the capacity of all the elements of the building (i.e. walls, roof, ceilings and floors) to reflect, store and transmit heat. Concrete masonry units made with dense aggregates are able to store heat while the cavities in hollow block improve the insulating value of the units. For estimates of the thermal behaviour of a building

Table 2.3 **Fire resistance ratings of loadbearing walls constructed of concrete masonry units**
(SANS 10145 - Table 4)

Construction	Thickness (excluding plaster), mm, min., for fire resistance rating in minutes of				
	240	120	90	60	30
Solid concrete masonry units containing Class 1 aggregate*:					
a) Unplastered	190	150	90	90	90
b) Plastered† with VG‡	150	90	90	90	90
Solid concrete masonry units containing Class 2 aggregate§ :					
a) Unplastered	–	200	150	150	150
b) Plastered† with VG‡	150	150	150	150	90
	Equivalent thickness// (excluding plaster), mm, min., for fire resistance rating in minutes of				
	240	120	90	60	30
Hollow concrete masonry units¶					
a) Unplastered	Not recommended			90	73
b) Plastered†	Not recommended			73	73

* Class 1 aggregate = a coarse aggregate of foamed slag, pumice, blastfurnace slag, well burned clinker, crushed calcareous aggregate, and crushed brick or other burnt clay products (including expanded clay).

† Where plaster is to contribute to the fire resistance of a wall, it should be applied over a metal lath that is so fixed to the wall as to prevent the plaster from becoming detached from the wall in the event of a fire. The values in the table apply only to plaster of thickness at least 12 mm applied to that side of the wall in relation to which the wall is required to have a specified fire resistance rating.

‡ VG = a plaster of vermiculite and gypsum mixed in a V:G ratio that is in the range 1,5:1 to 2:1 (v/v).

§ Class 2 aggregate = a coarse aggregate of flint, gravel, or any crushed natural stones other than stones that would form a calcareous aggregate.

// Equivalent thickness = the solid wall thickness that would be obtained if the same amount of concrete contained in a hollow unit were recast without core holes.

¶ Applicable only to hollow units that form a wall having not more than one cell in any vertical plane through its thickness.

reference should be made to the CSIR Division of Building Technology publication BRR 396, "The prediction of the thermal performance of buildings by the CR-Method".

FIRE RESISTANCE

The fire resistance rating of concrete masonry walls depends on whether the wall is loadbearing or not, whether solid or hollow units are used and on the

geological type of the aggregates used in the manufacture of the units. Plastering the wall improves the fire resistance rating.

The National Building Regulations requirements for walls are covered in SANS 10400. The fire resistance ratings of concrete masonry walls are given in SANS 10145 (refer Tables 2.3 and 2.4).

Note Definitions: see next page

Table 2.4 **Fire resistance ratings of non-loadbearing walls constructed of concrete masonry units** (SANS 10145 - Table 5)

Construction	Thickness (excluding plaster), mm, min., for fire resistance rating in minutes of			
	240	120	90	60
Solid concrete masonry units containing Class 1 aggregate*† :				
a) Unplastered	150	90	73	73
b) Plastered‡ with CS‡	90	90	73	73
c) Plastered‡ with GS§	90	73	73	73
d) Plastered‡ with VG//	90	73	73	73
Solid concrete masonry units containing Class 2 aggregate¶ :				
a) Unplastered	215	150	90	73
b) Plastered‡ with CS‡ or GS§	150	108	90	73
c) Plastered with VG//	150	108	73	73
	Equivalent thickness (excluding plaster), mm, min., for fire resistance rating in minutes of			
	240	120	90	60
Hollow concrete masonry units** containing Class 1 aggregate*† :				
a) Unplastered	150	108	90	73
b) Plastered‡ with CS‡ or GS§	108	90	73	73
c) Plastered with VG//	108	90	73	73
Hollow concrete masonry units, // containing Class 2 aggregate¶ :				
a) Unplastered	190	150	108	73
b) Plastered‡ with CS‡ or GS§	150	108	90	73
c) Plastered with VG//	150	90	73	73
	Thickness of inner leaf (excluding plaster), mm, min., for fire resistance rating in minutes of			
	240	120	90	60
Cavity wall having both leaves of concrete masonry units, the outer leaf being at least 100 mm thick	90	73	73	73

* Class 1 aggregate = a coarse aggregate of foamed slag, pumice, blastfurnace slag, well burned clinker, crushed calcareous aggregate, and crushed brick or other burnt clay products (including expanded clay).

† See appropriate footnote to Table 2.3.

‡ CS = a cement-sand plaster.

§ GS = a gypsum-sand plaster

// VG = a plaster of vermiculite and gypsum mixed in a V:G ratio that is in the range of 1,5:1 to 2:1 (v/v).

¶ Class 2 aggregate = a coarse aggregate of flint, gravel, or any crushed natural stones other than stones that would form a calcareous aggregate.

** Applicable only to hollow units that form a wall having not more than one cell in any vertical plane through its thickness.



Note Definitions:

Hollow masonry units: A masonry unit that contains cavities that exceed 25% but do not exceed 60% of the gross volume of the unit.

Solid masonry unit: A masonry unit that either contains no cavities or contains cavities that do not exceed 25% of the gross volume of the unit.

Calculation of equivalent thickness for fire resistance ratings

For hollow masonry units fire resistance ratings are expressed in equivalent thickness of wall. Equivalent thickness is the solid thickness that would be obtained if the same amount of concrete contained in a hollow unit were recast without core holes. Percentage solid is based on the average net area or net volume of the unit.

The Table (see Table 2.5) that follows is based on the minimum shell thickness of hollow units viz 25mm or one-sixth the width of the unit whichever is the greater and an allowance of 2mm in the tapering of the mould to permit easy extrusion of the unit from the mould and a web thickness of 25mm. In practice shell and web thickness is often greater than the minimum and in these cases the net volume (gross volume – core volume) should be recalculated based on the formula.

$$\text{Equivalent thickness} = \frac{\text{Net volume of unit}}{\text{Length of unit} \times \text{height of unit}}$$

Table 2.5 **Equivalent thickness of two core hollow masonry units for calculation of fire resistance ratings**

Unit size, mm			Shell thickness minimum, mm	Solid content %	Equivalent thickness, mm
l	w	h			
390	90	190	25	68	61
390	140	190	25	52	73
390	190	190	32	53	101

Note: Solid units may contain up to 25% voids and this must be considered in determining equivalent thickness.

3 MODULAR CO-ORDINATION AND DESIGN

Modular co-ordination is a method of co-ordinating the dimensions of buildings and building components to reduce the range of sizes required and to enable components to be built in on site without modification. For modular co-ordination, the dimensions of components and the space to be filled by them must be related to a single denominator, the basic module.

The South African Bureau of Standards has accepted 100 mm as the basic module for horizontal and vertical dimensions.

Buildings should be dimensioned to incorporate controlling dimensions which provide for the necessary co-ordination of dimensions to accommodate all modular size components, assemblies and units. Setting out is simplified because most dimensions will be multiples of 100mm, though with concrete masonry a 200mm module is preferable. The use of modular graph drawing paper incorporating faint grid lines at intervals of 1 and 10mm (or multiples thereof) along

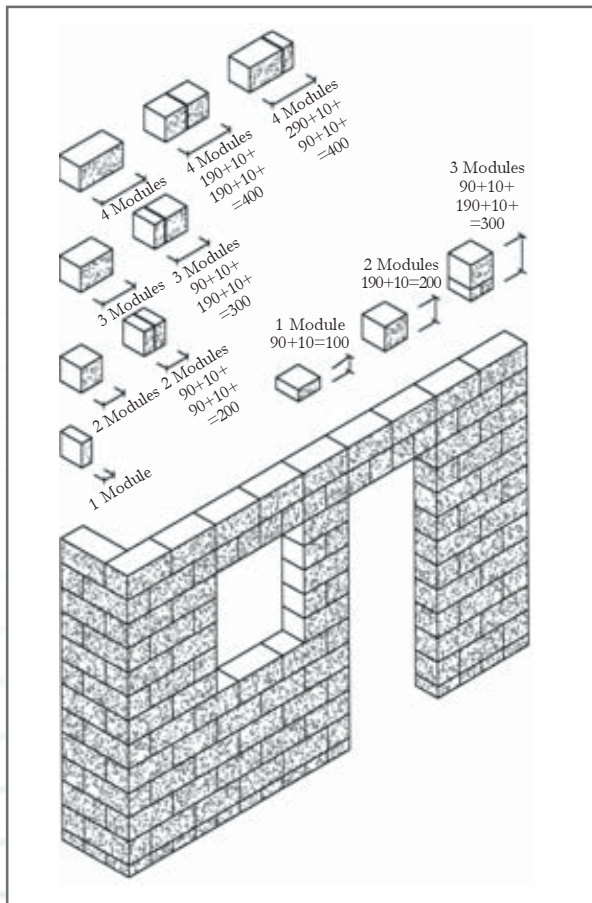


Figure 3.1 Modular co-ordination in a wall and planning modules

both axes assists in planning and drawing to modular sizes. Figure 3.1 shows a section of wall where the vertical and horizontal planning is modular; modular size window and doorsets fit the space allowed. In Figure 3.2 portion of a house drawn on 10mm grid paper is shown, the plan on a scale of 1:100 and construction details on 1:20. Working drawings may also be drawn on 1:50 while other scales for details are 1:10, 1:5 and 1:1.

CO-ORDINATING SIZES

The co-ordinating sizes of building components, such as door and window frames and units such as blocks and bricks are the dimensions which permit them to fit into the space provided in a controlling reference system in a particular direction. Some vertical controlling dimensions and planning modules are shown in Figure 3.1. The co-ordinating dimension includes the work size of the component or unit, its manufacturing tolerances and the thickness of joint required to fit it in position. In some special cases allowance must be made for a positioning tolerance.

BLOCKS

The most popular co-ordinating block dimension is 400 mm (i.e. 4 modules) horizontal and 200 mm (2 modules) vertical. To make up the design lengths and heights it may be necessary to use, other than the basic size block, blocks having co-ordinating lengths of 100, 200 and 300mm and a co-ordinating height of 100mm. These sizes may be achieved by using specific blocks of suitable modular dimensions. If a unit is of modular dimensions, and is so described, it will fit into a modular space on the design grid.

Vertically, a co-ordinating height of 100mm may be achieved by the use of bricks or blocks of 90mm nominal height.

Details of standard and certain specific blocks for use in walls of 90, 140 and 190mm thickness are shown in Figure 1.1.

The standard and specific blocks shown are only some of the block sizes and shapes that may be made in your area. Manufacturers should be consulted prior to design and detailing to check the range of blocks available.

A modular dimensioned solid block manufactured with low-density aggregates such as clinker used in 140mm thick external walls is 290 x 140 x 90 and when used on its side in 90 mm thick internal walls is 290 x 90 x 140.

Internal and external walls are bonded with metal strips at 300mm vertical intervals, maximum.

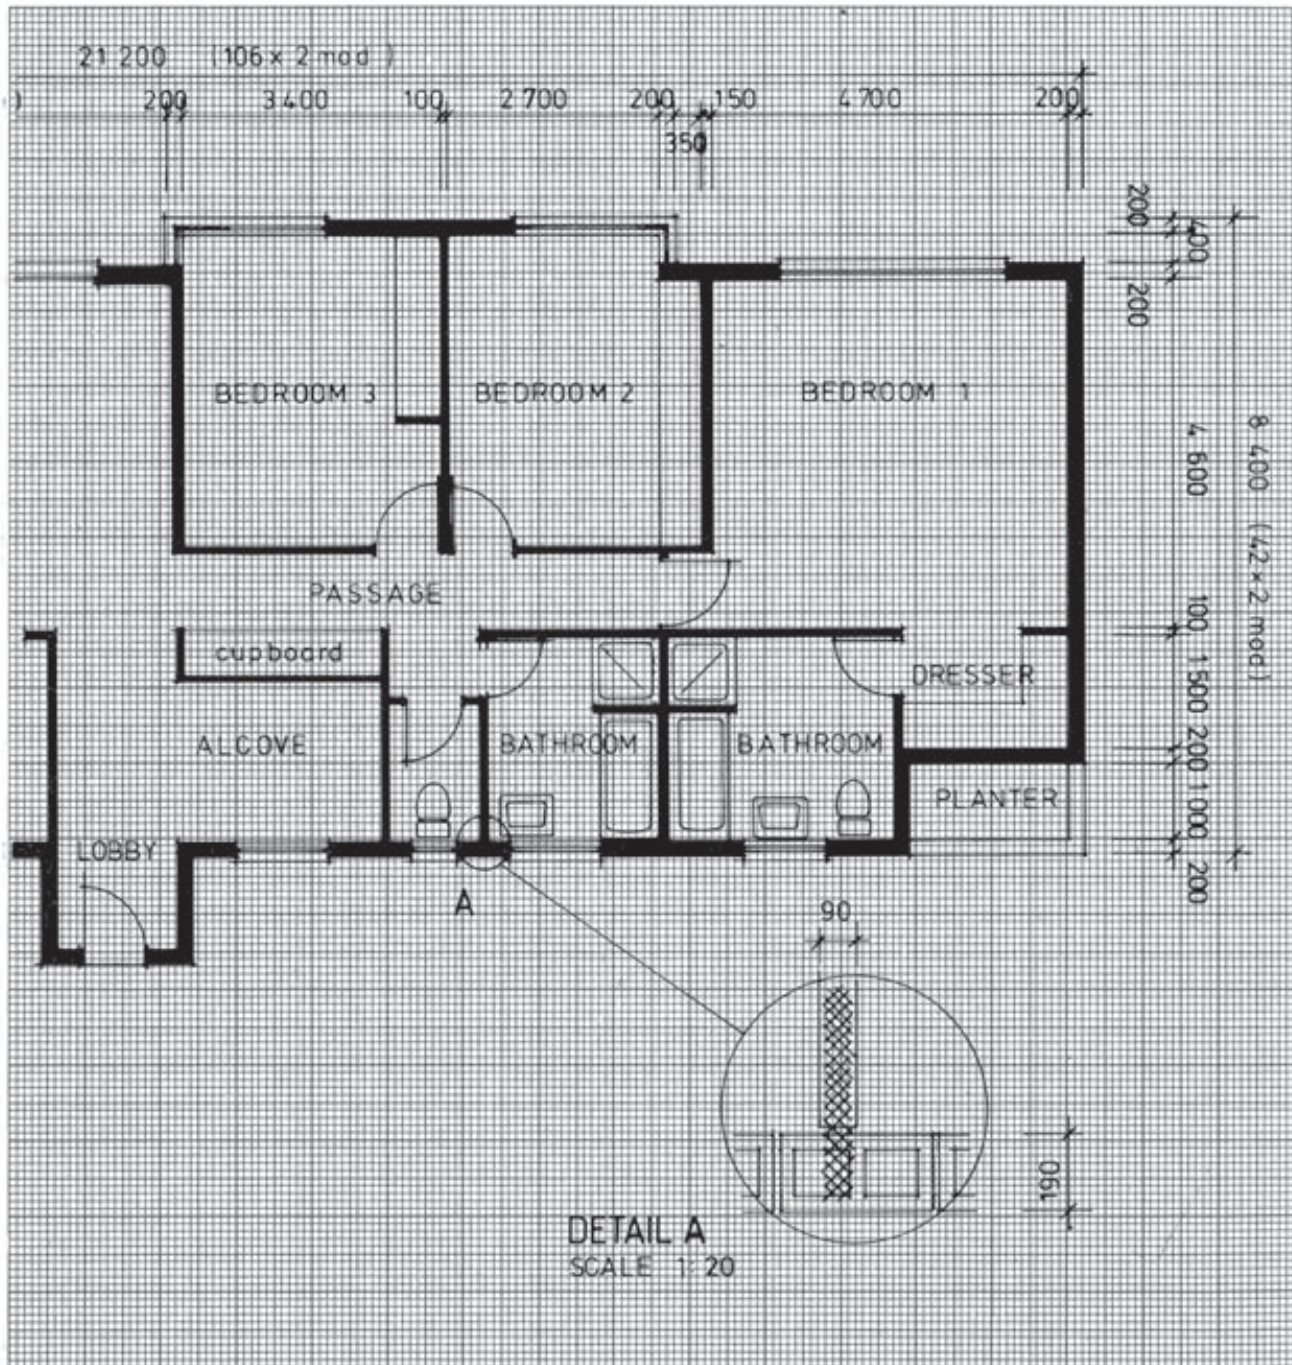


Figure 3.2 Use of modular grid

MODULAR DETAILING AND BUILDING

The purpose of good detailing is to assist in achieving sound construction and a buildable structure that will perform well in service. The three Concrete Manufacturers Association's publications on Detailing of Concrete Masonry cover the main types of masonry walls viz. single leaf walls using solid units 140mm,

single leaf walls using hollow units 140 and 190mm and cavity walls 240 and 290 mm and should be referred to for modular detailing.

The abovementioned publications cover foundation walls, sills, lintels, window and door frames, suspended floors, parapet walls, roof trusses, masonry bond patterns, joint profiles, wall intersections, control joints, reinforcing and provision for services.

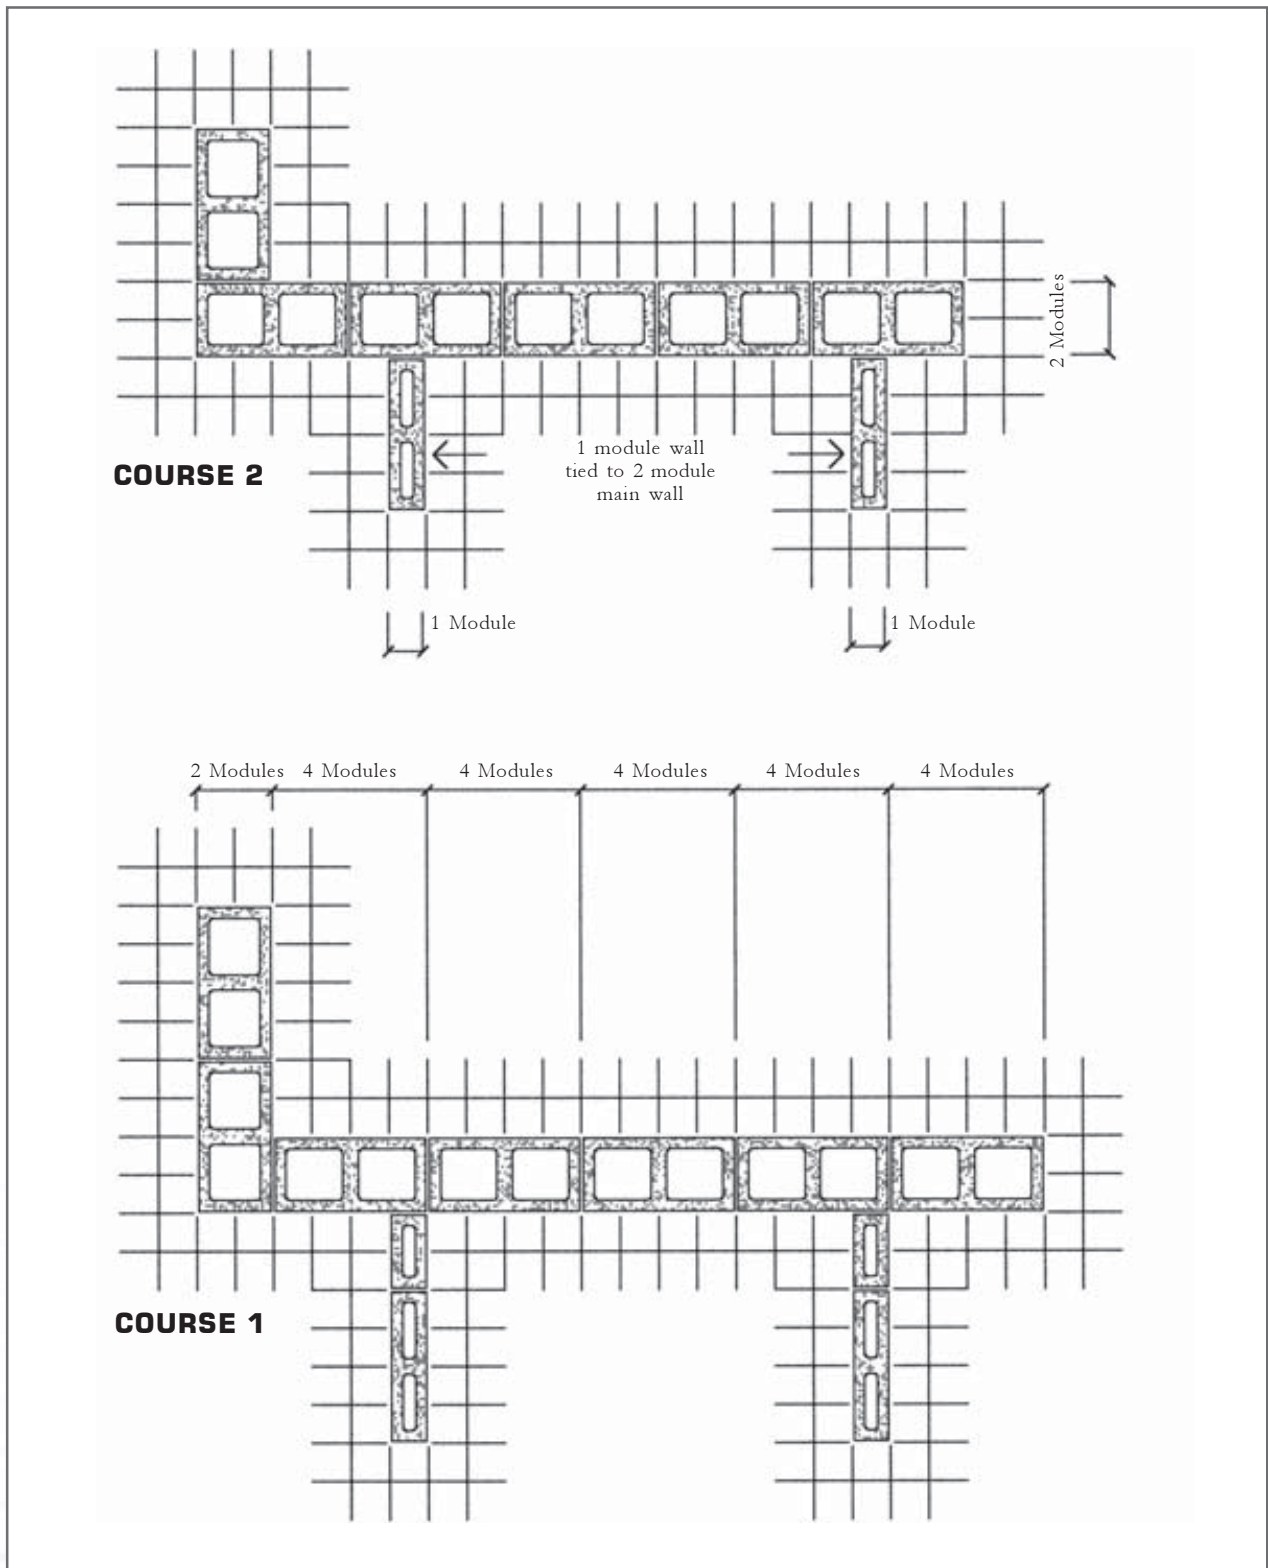


Figure 3.3 **Bonding patterns of intersecting walls**

The decision whether to build with large block size units or the smaller brick size units depends on a number of factors. Block size units are more cost-effective if the building is planned around blocks of modular size because of higher productivity of laying, sounder construction and less mortar being required.

Bricks are easier to lay as they can be used without preplanning and can easily be cut and laid.



4 BUILDING REGULATIONS

The National Building Regulations are statutory requirements that apply to the erection of all building in the country, unless otherwise exempted. SANS 10400 Application of the National Building Regulations is a non-statutory document which contains technical information needed for the practical application of the Regulations, namely satisfying the functional requirements of the NBR. The deemed-to-satisfy requirements in the standard take the form of "Rules" and are not mandatory. The Rules applying to walls are in Parts KK and have been completely revised.

Under the Housing Consumers Protection Measures Act, Act No. 95 of 1998, the Act provided for the establishment and functions of the National Home Builder's Registration Council to protect the public from poor building practices that leave new home owners with damaged buildings and no recourse except to the law.

The NHBRC has published their Home Building Manual (HBM) which sets out everything that is required for a house being built to be registered under their Standard Home Builder's Warranty Scheme.

The HBM states that "In the first instance, the design and construction shall ensure that all housing complies with the relevant requirements of the National Building Regulations and in the second instance, with those laid down by the NHBRC".

The NBR and the HBM share the same philosophy in so far as the structural performance of a housing unit is concerned. However, the NHBRC has provided deemed-to-satisfy construction rules which ensure that design intent is met during construction whereas SANS 10400 provides no such guidance.

NATIONAL BUILDING REGULATIONS. PART K: WALLS

K1 Structural strength and stability

Any wall shall be capable of safely sustaining any loads to which it is likely to be subjected and in the case of any structural wall such wall shall be capable of safely transferring such loads to the foundations supporting such wall.

K2 Water penetration

Any wall shall be so constructed that it will adequately

resist the penetration of water into any part of the building where it would be detrimental to the health of occupants or to the durability of such building.

K3 Roof fixing

Where any roof truss, rafter or beam is supported by any wall provision shall be made to fix such truss, rafter or beam to such wall in a secure manner that will ensure that any forces to which the roof may normally be subjected will be transmitted to such wall.

K4 Behaviour in fire

Any wall shall have combustibility and fire resistance characteristics appropriate to the location and use of such wall.

K5 Deemed-to-satisfy requirements

The requirements of regulations K1, K2, K3 and K4 shall be deemed to be satisfied where the structural strength and stability of any wall, the prevention of water penetration into or through such wall, the fixing of any roof to such wall and the behaviour in a fire of such wall, as the case may be, comply with Part K of section 3 of SANS 10400.

SANS 10400: APPLICATION OF THE NATIONAL BUILDING REGULATIONS. PART K: WALLS. PART KK RULES

KK1 General

The regulations contained in Part K of the National Building Regulations shall be deemed to be satisfied where:

- a) the wall is the subject of a rational design indicating that such wall complies in regard to strength and stability, with the requirements of Part B being capable of resisting imposed roof, wind and other loads, to which it may be subjected during its useful life and satisfies the provisions of K1.
- b) the wall forms part of an occupancy designated as being H3 (Domestic Residence) or H4 (Dwelling House) and is in accordance with the provisions of the Home Building Manual; or
- c) the wall forms part of an occupancy other than that designated as being an H3 (Domestic Residence) or H4 (Dwelling House), and is in accordance with the provisions of the Home Building Manual.

KK2 Water penetration

KK2.1 Any external wall of any building shall be:

- a) capable of satisfying the relevant requirements of the rain penetration test contained in rule KK5
- b) a single leaf, hollow unit, shell-bedded wall of not less than 140mm thick or an externally plastered single leaf, solid unit, solid bed joint, of thickness not less than 140 mm or a non plastered collar jointed solid unit, solidly bed jointed wall having a thickness of not less than 140mm.

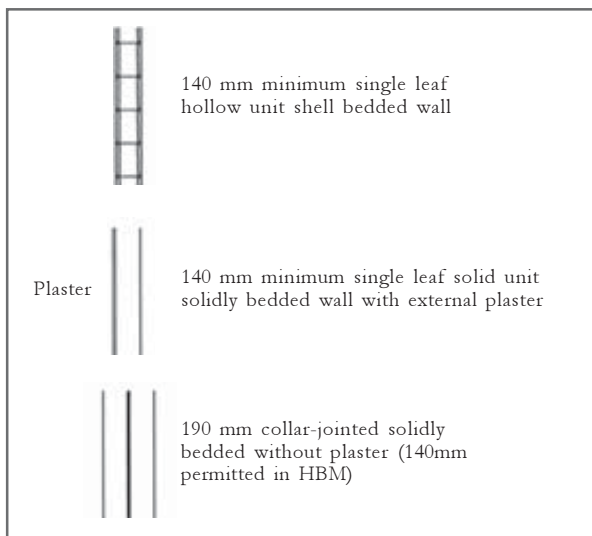


Figure 4.1 Wall cross-sections to resist rain penetration

KK3 Damp-proof course

KK3.1 Any wall or sleeper pier of a building shall be provided with a damp-proof course in such position and to an extent that will protect the wall against rising damp and the interior of the building against ingress of moisture from abutting ground (see Figure 4.2).

KK3.2

- a) any material used as a damp-proof course shall conform to the relevant requirements contained in SANS 248, SANS 952 or SANS 298
- b) in any masonry wall a damp-proof course shall be installed -
 - i) at the level of the top of a concrete floor slab resting on the ground; or
 - ii) where applicable, below any ground floor timber beam or joist.
- c) in any timber-framed wall a damp-proof course shall be installed between the bottom plate of the wall and any foundation wall or concrete floor slab.
- d) in the case of any solid masonry wall or timber-

framed wall any damp-proof course shall extend over the full thickness of such wall.

- e) in the case of any masonry cavity wall -
 - i) each leaf of such wall shall be provided with its own damp-proof course which shall extend over the full thickness of such leaf, in which case the cavity must extend 140 mm below the damp-proof course; or
 - ii) each leaf of such wall shall be covered by a membrane which extends across the cavity provided that the position of the membrane at the inner leaf is higher than its position at the outer leaf; and
 - iii) where necessary, weep holes to prevent build-up of water in the cavity shall be provided in the external leaf of every cavity wall, spaced not more than 1m apart, in the masonry unit course immediately below the damp-proof course contemplated in paragraph i) or in the masonry unit course immediately above the membrane contemplated in paragraph ii).
- f) no horizontal damp-proof course shall be installed less than 140mm above the level of the adjacent finished ground.
- g) transverse joints in the damp-proof course shall be overlapped to a minimum distance of 140mm and at junctions and corners to a distance equal to the full thickness of the wall or the leaf, as the case may be.
- h) i) Where any part of any wall of a room is so situated that the ground will be in contact therewith it shall be protected by a vertical waterproof membrane or by a drained cavity which shall extend below the level of the floor of such room;
 - ii) drainage shall be provided at the base of such wall to prevent water accumulating there.

KK4 Behaviour in fire

Any wall shall comply with the relevant requirements for fire resistance, non-combustibility and where appropriate, wall lining index set out in rules TT2, TT5, TT6, TT7, TT8, TT9, TT10, TT15, TT39, TT40, TT41, TT45, TT49, TT52 and subrules TT18.1 and TT19.1, as the case may be.

KK5 Rain penetration test for walls

KK5.1 Test Method

The wall shall be thoroughly airdry before being tested. In the case of a masonry or similar wall the inner

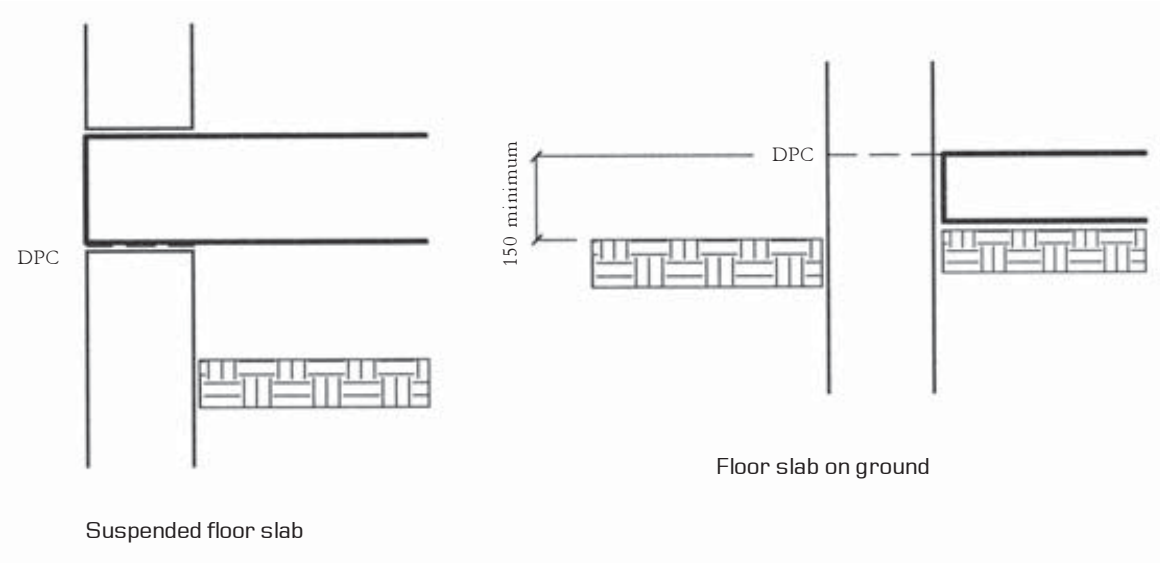
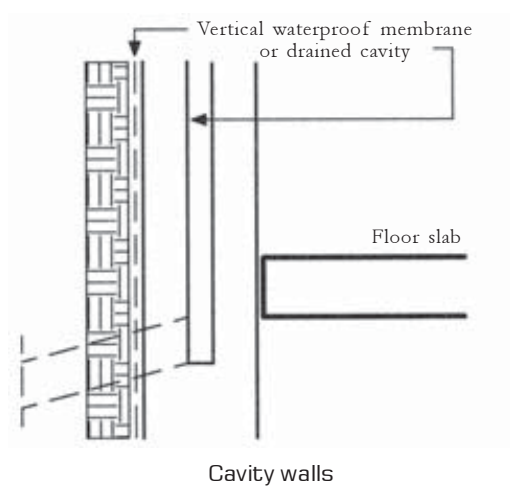
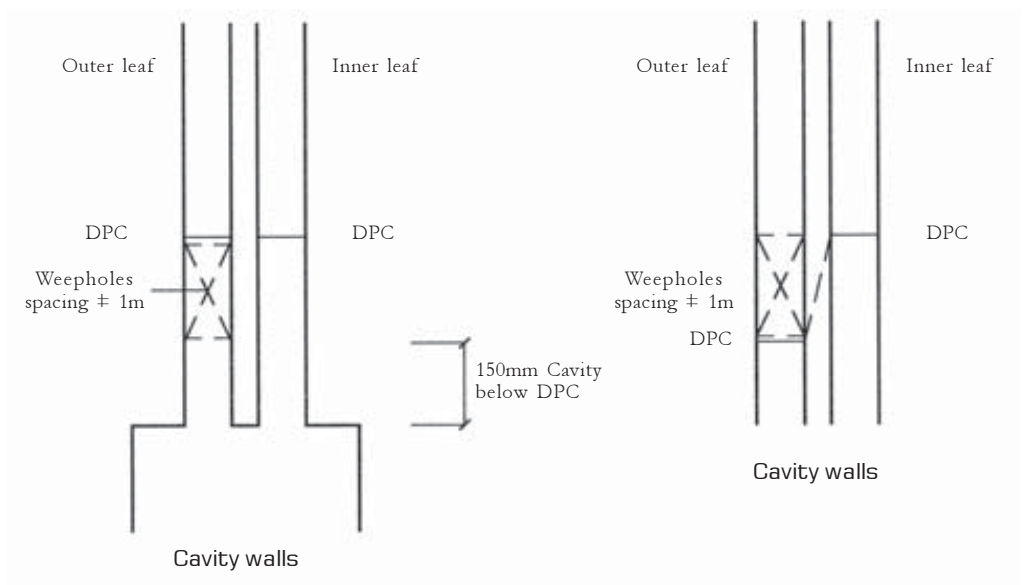


Figure 4.2 Details of damp-proof course positions

surface may be lime washed or other means may be adopted to facilitate the detection of moisture which has penetrated through the wall. The portion of the outer surface under test shall then be continuously sprayed with water in the form of a finely divided spray distributed over the whole area under test at the rate of 40 - 50mm depth of water per hour. Spraying shall be conducted in a still atmosphere and shall be continued for the minimum period in terms of column 3 of Table 4. 1 (depending upon the mean annual rainfall and the hourly mean wind speed for the locality concerned given in columns 1 and 2 of such table relative to such period in each case) or until the first signs of dampness appear on the inner surface of the wall if such signs appear before the expiry of such period. In the case of any timber-framed wall, the covering of such wall shall be removed after the required test period in order to ascertain whether any moisture has penetrated to the interior of such wall and if so, whether water has been retained within the interior.

Table 4. 1 **Test Period**

1	2	3
Mean annual rainfall*, mm	Hourly mean wind speed*, m/s	Minimum period, hours
More than †1000	20 25 30	14 19 24
600 – 1000	20 25 30	10 15 20
200 – 600	20 25 30	6 11 16
0 – 200	20 25 30	2 7 12

* See SANS 10160 General procedures and loadings to be adopted for the design of buildings (Appendices D and F)

† 1000 is based on maximum rainfall of 1400 mm. Where the actual annual rainfall is known to exceed 1400 mm the figures for duration of test may be linearly extrapolated.

KK5.2 Test Criteria

The test wall shall, in regard to rain penetration, be considered to comply with the requirements of regulation K2 where:

- a) no moisture has penetrated to the inner surface of

the wall within the relevant minimum test period given in column 3 of Table 4. 1; and

- b) in the case of a timber-framed wall, there is no evidence of water having been retained within the cavity in the wall.


KK6 Cavity walls

KK6.1 Any cavity formed in an external masonry cavity wall shall be not less than 50 mm wide and not more than 110 mm wide (refer Figure 4.3).

KK6.2 Wall ties shall be installed in any cavity wall in an evenly distributed pattern, at a rate of 2,5 ties per square metre of the face area of such wall where the cavity is not more than 75mm and at a rate of 3 ties per square metre of face area where the cavity is more than 75mm in width.

KK6.3 Such wall ties shall comply with the requirements contained in SANS 28.

Figure 4.3 **Cavity walls**

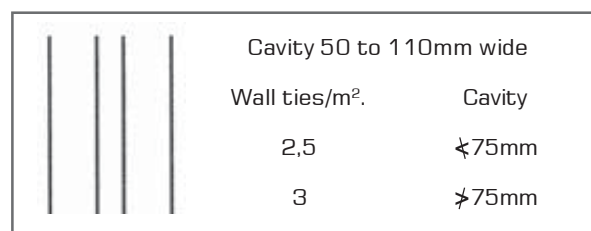

NHBRC HOME BUILDING MANUAL

The NHBRC is a statutory body and their Home Building Manual was gazetted in terms of the Housing Consumer Protection Measures Act. All contractor built housing four storeys or less shall be constructed in accordance with the NHBRC's Home Building Manual.

The HBM was developed to manage the risk associated with the warranty cover provided by the NHBRC on contractor built housing. As such, its aim is to minimise defects in housing units which may affect strength, stability, durability and serviceability in accordance with current, accepted standards of good practice.

Thus walls shall be designed and constructed to safely withstand any load to which they are likely to be subjected without undue deformation and distress. Superstructure walls shall be designed and constructed to resist rain penetration and to avoid the accumulation of rainwater thereon.

Materials used in the construction of housing units shall be sufficiently durable and of a suitable quality for the purpose for which they are to be used.



The NHBRC'S design requirements may be satisfied by either:

- i) adopting the rules contained in Part 2, Sections 2 to 9 of the HBM; or
- ii) preparing a rational design based on engineering principles in accordance with the relevant requirements set out in Part 2, Section 10 of the HBM; or
- iii) obtaining Agrément certification in accordance with the relevant requirements as set out in part 2, Section 11 of the HBM.

The NHBRC's construction requirements may be satisfied by complying either with the requirements of:

- i) the relevant portions of the construction standards as set out in Part 3 of the HBM; or
- ii) the standards and specifications referred to in the rational design prepared by a Competent Person; or
- iii) the relevant requirements set out in the Agrément certification documentation.

The building limitations for empirical design in the HBM are:

The rules that follow are only applicable to single storey units or the upper storey of double storey units where:

- the span of roof trusses/rafters between supporting walls does not exceed:
 - 6,0 m in respect of 90 and 110mm single leaf walls.
 - 8,0 m in respect of 140mm, or greater, single leaf walls and all cavity and collar jointed walls.
- the nominal height of masonry above the top of openings is not less than 0,4 m.
- the average compressive strength of hollow and solid masonry units is not less than 3,0 MPa and 4,0 MPa, respectively.
- the mass of the roof covering in roofs other than concrete slabs does not exceed 80 kg/m².
- the span of the concrete roof slabs between supporting walls does not exceed 6,0 m.
- concrete roof slabs are not thicker than 255 mm if of solid construction, or the equivalent mass if of voided construction.
- foundation walls are not thinner than the walls, which they support.
- the height of foundation walls does not exceed 1,5m.
- the walls are founded on foundations designed in accordance with the provisions of Part 2, Section

2; or the SAICE/IStructE Code of Practice for Foundations and Superstructures for Single Storey Residential Buildings of Masonry Construction, or are founded on reinforced concrete members which have the equivalent vertical, horizontal and rotational stiffness implied in the abovementioned code of practice.

The rules that follow may be applied to the lower storey in double storey buildings provided that:

- the height measured from the ground floor to the top of an external gable does not exceed 8,0m.
- the storey height measured from floor to wall plate level or to the underside of the first floor does not exceed 3,0m.
- the span of concrete floor slabs between supporting walls does not exceed 6,0m.
- the floor slabs are not thicker than 255mm if of solid construction, or the equivalent mass if of voided construction.
- the average compressive strength of the hollow and solid masonry units is not less than 7,0 MPa and 10 MPa, respectively.
- the walls supporting floor elements are of cavity construction or have a nominal thickness of not less than 140mm.
- the mass of the roof covering does not exceed 80kg/m².
- if the first floor is a concrete slab, the roof is tiled or sheeted i.e. not a concrete roof slab.

The rules pertaining to infill wall panels in concrete and steel framed buildings are only applicable to buildings of four storeys or less where:

- the average compressive strength of hollow and solid masonry units is not less than 3,0 MPa and 5,0 MPa respectively.
- the walls are either of a cavity construction or have a nominal thickness of not less than 140mm.
- the nominal height of masonry above openings is not less than 0,4 m.
- the storey height measured from floor to soffit of the floor above does not exceed 3,3 m.

Infill panel sizes and wall thicknesses are not covered in the Masonry Manual and reference should be made to the Home Building Manual.

Generally, the design rules in the Home Building Manual are more conservative than those provided for in SANS 10400 and are far more comprehensive. The

masonry rules have been based on those provided in the SAICE/IStructE Code of Practice for Foundations and Super-structures for Single Storey Residential Buildings of Masonry Construction.

The rules apply only in respect of housing units which are not exposed to severe wind loadings. The NHBC may require that walls in housing units which are located on water fronts, at the crest of steep hills, ridges and escarpments be designed by a Competent Person.

Vertical supports, where required, shall extend to the top of the wall, or in the case of gable ends, to eaves level, and shall comprise intersecting walls which shall (see Figures 4.5 and 4.6):

- i) intersect the supported wall at an angle of between 60° and 120°.
- ii) have thickness (T) of not less than 90 mm.
- iii) have a length (Ls) projecting beyond the face of the unsupported wall of not less than the greater of (refer Figure 4.6):

- **for internal walls**

1/8 of the height of the wall and 1/10 of the wall length

- **for external walls**

0,5 m and one half the sum of adjacent panel lengths in the case of an intermediate support and one half the panel length for a corner support; as appropriate, divided by: for vertical supports of thickness 110mm and less: 2,5 for vertical supports of thickness 140mm and greater: 3,0

Where such vertical supports incorporate an opening, the length (Ls) derived in accordance with iii) above shall be extended by the length of such opening. Supports should generally extend the full height of the panel. It is, however, permissible for a support on one side of a panel to extend for only 90% of the height of the panel provided that the support on the opposite end of the panel extends the full height (see Figure 4.6).

Openings and edge distances to such openings in wall panels shall not exceed the dimensions given in Table 4.8 (read in conjunction with Figure 4.7). Walls supporting concrete floors or roofs (not both) shall have a thickness of not less than 140mm or be of cavity wall construction and contain no openings wider than 2,5 m. The distance between successive openings in any wall panel shall not be less than that derived from Figure 4.7. Reinforcement shall be provided above all openings.

The height of fill retained by foundation walls shall not exceed the values given in Table 4.9.

Foundation walls shall not exceed 1,5 m height and be of a thickness not less than the wall it supports.

Cavity widths to be between 50 and 110mm.

WALLING IN SINGLE AND DOUBLE STOREY UNITS

This section covers unreinforced wall panels in single and double storey building dimensions based on the following wall configurations in Figure 4.4, viz

Table 4.2 External panel supported on both sides

Table 4.3 External panel supported on both sides incorporating a tied control/articulation joint

Table 4.4 Internal panel supported on both sides

Table 4.5 Wall panel (internal/ external) supported on one vertical side only

Table 4.6 Length of external wall panel supporting a triangular gable or portion thereof

Table 4.7 Base width of triangular gable end

Table 4.8 Dimensions of openings and edge distances in wall supporting sheeted or tiled roofs

Example:

The home builder wishes to build a single storey house using 190mm wide hollow masonry units.

The largest (and therefore critical) wall panel dimensions in his chosen layout are as follows:

- wall panel with no openings 7,0 x 2,6 m
- wall panel with openings less than 15% 6,2 x 2,6m
- wall panel with openings greater than 15% 6,5 x 2,6m
- internal wall panels 7,0 x 2,6 m
- gable end panel (11 degree double pitched roof) without openings 6,0 x 2,6m

Wall panel with no opening:

7,0 x 2,6 m panel is within the limits for panel A, left hand column of Table 4.2, viz. 7,5 x 2,7 m

Wall panel with openings less than 15%:

The left hand and right hand column limiting dimensions for panel B of Table 4.2 are 6,5 x 2,4m and 5,0 x 4,6m respectively.

Interpolating between tables, the maximum length of a 2,6 m high panel is:

$$6,5 - (2,6 - 2,4)/(4,6 - 2,4) \times (6,5 - 5,0) = 6,36\text{m}$$

Thus 6,2 x 2,6 m panel is adequate.



Wall panel with openings greater than 15%:

The left hand and right hand column limiting dimensions for panel C of Table 4.2 are 6,0 x 2,7m and 4,8 x 4,4m respectively.

A 6,5 x 2,6m panel is therefore unacceptable as its length dimension exceeds the maximum permissible length of 6,0m. It can be made acceptable by reducing the length to 6,0m or by providing truss type reinforcement in accordance with the note as an 8,0 x 4,0m panel is permitted in respect of a 190mm solid masonry unit.

Internal walls:


The maximum internal wall panel dimensions as tabulated in Table 4.4 are 8,5 and 4,6m. The 7,0 x 2,6m panel is well within these limits.

Gable end:


The maximum wall panel length as tabulated in Table 4.6 is 6,0m. 6,0 x 2,6m panel is therefore acceptable. The maximum base width of the triangular portion of wall above eaves height permitted in terms of Table 4.7 is 8,0 m for a roof having an 11° pitch. Gable end dimensions are within this limit.

Wall Configuration	Notes	Table No.
<p>External wall panel</p>	<p>Applicable to panels which do not incorporate gable ends. Wall panel sizes are sensitive to panel openings. Two categories of opening are provided for:</p> <ul style="list-style-type: none"> less than 15% of wall area; greater than 15% of wall area 	4.2
<p>External wall panel</p>	<p>Applicable to panels which do not incorporate gable ends. Wall panel sizes are sensitive to panel openings. Two categories of opening are provided for:</p> <ul style="list-style-type: none"> less than 15% of wall area; greater than 15% of wall area 	4.3
<p>Internal wall panel</p>	<p>Wall panel size is not governed by openings</p>	4.4
<p>External/internal panel supported</p>	<p>Panels which incorporate full height doors are treated as walls supported on one side only with openings. Wall panel is sensitive to openings (no size of opening is specified)</p>	4.5
<p>External</p>	<p>Applicable to panels which incorporate gable ends or portion thereof which have a panel height not exceeding 2,6m. Wall panel is sensitive to panel openings. Triangular portion of gable above eaves level must be checked for compliance with Table 4.7. Internal walls with gables (fire walls) designed in accordance with Table 4.2. Panel a (no openings).</p>	4.6
<p>G = Base width</p>	<p>The base width (G) must be reduced by the length of any openings within the gable.</p>	4.7
<p> </p>		


Figure 4.4 Selection chart for wall design (HBM Part 2 Section 3 Figure DM4)

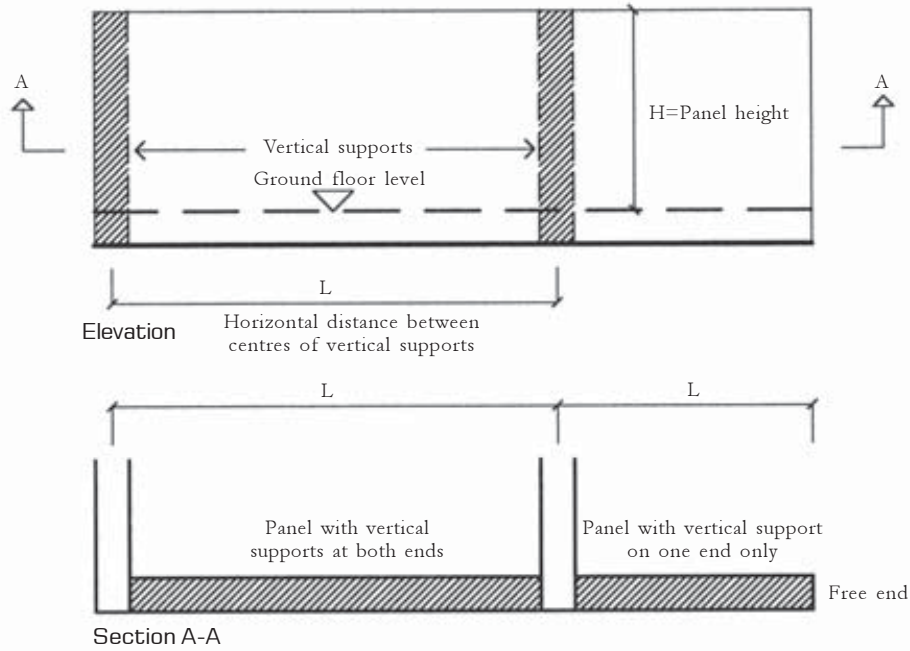

A) PANEL DIMENSIONS

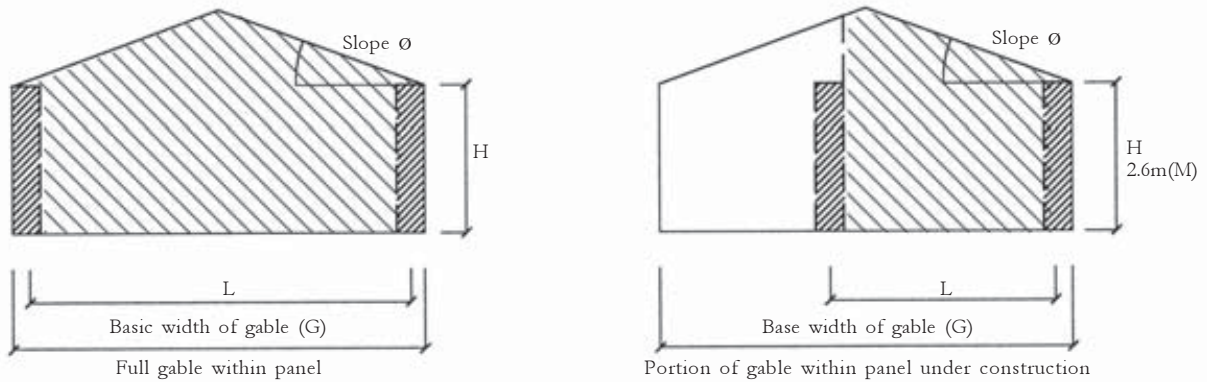


B) GABLE END INCORPORATING AN ISOSCELES TRIANGLE OR PORTION THEREOF

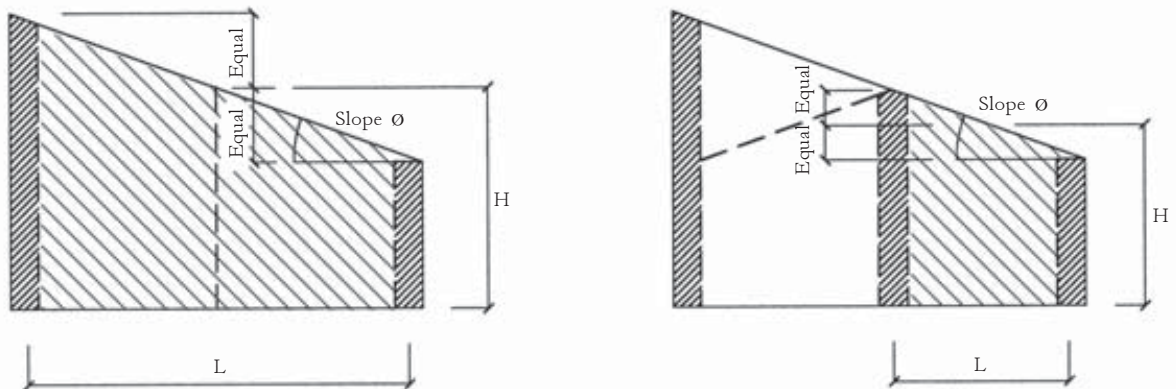

C) MONOSLOPED GABLE END

Figure 4.5 Wall panels in single and double storey housing units (HBM Part 2 Section 3 Figure DM5)

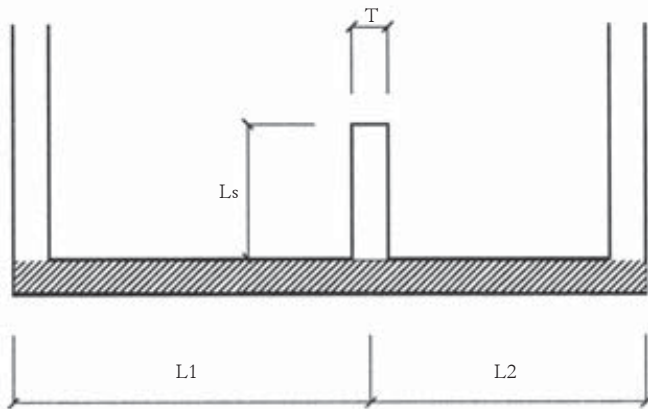

Plan


EXTERNAL WALL PANELS

$$L_s = \text{greater of } \frac{L_1 + L_2}{2x} \text{ or } 500\text{mm}$$


where

$$x = 2.5 \text{ for } T \leq 110\text{mm}$$

$$x = 3.0 \text{ for } T \geq 140\text{mm}$$

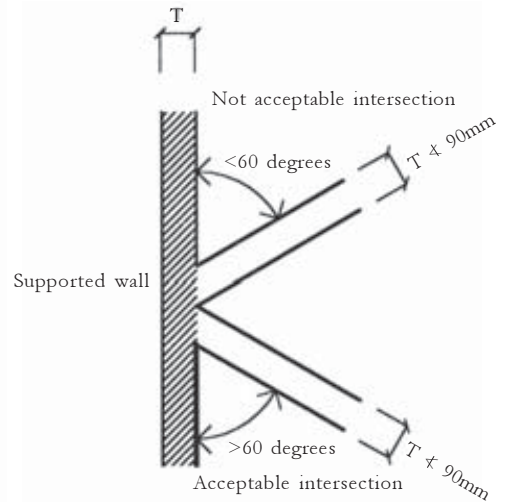

Plan

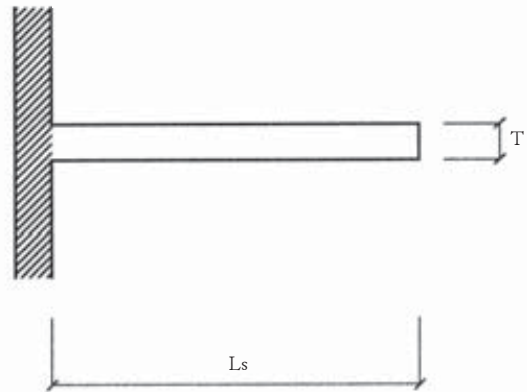

Plan

$$L_s = \text{greater of } \frac{H}{8} \text{ and } \frac{L}{10}$$

INTERNAL WALL PANELS


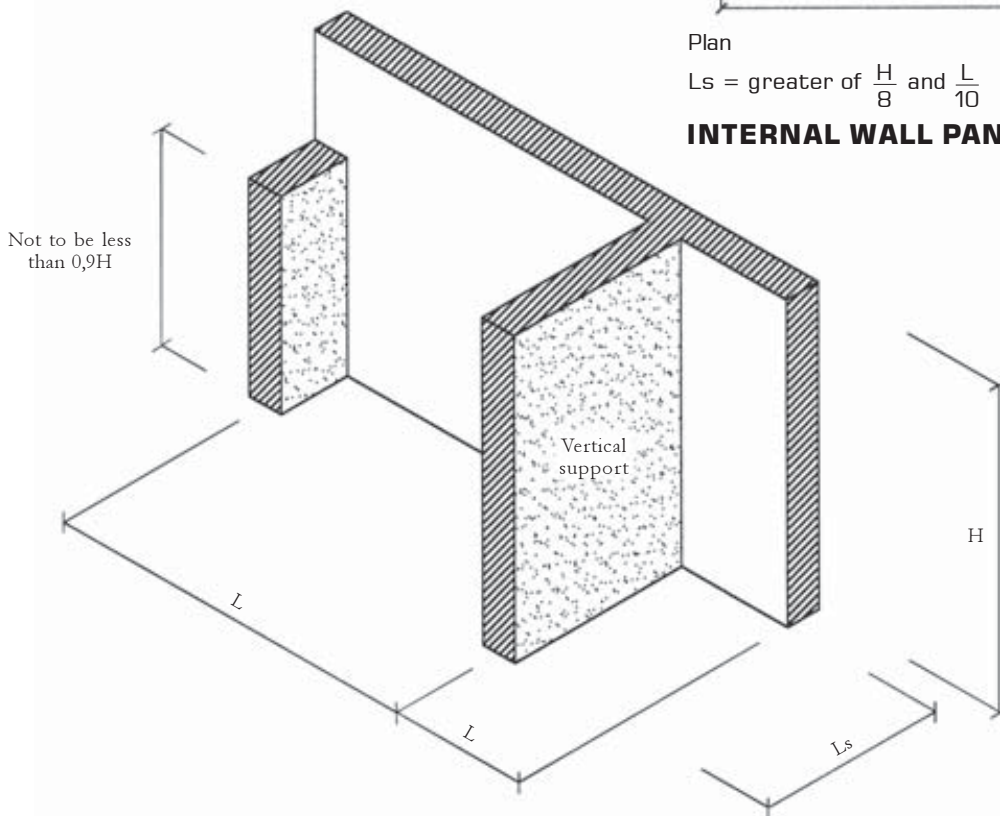


Figure 4.6 Lateral support provided by intersecting walls (HBM Part 2, Section 3, Figure DM6)

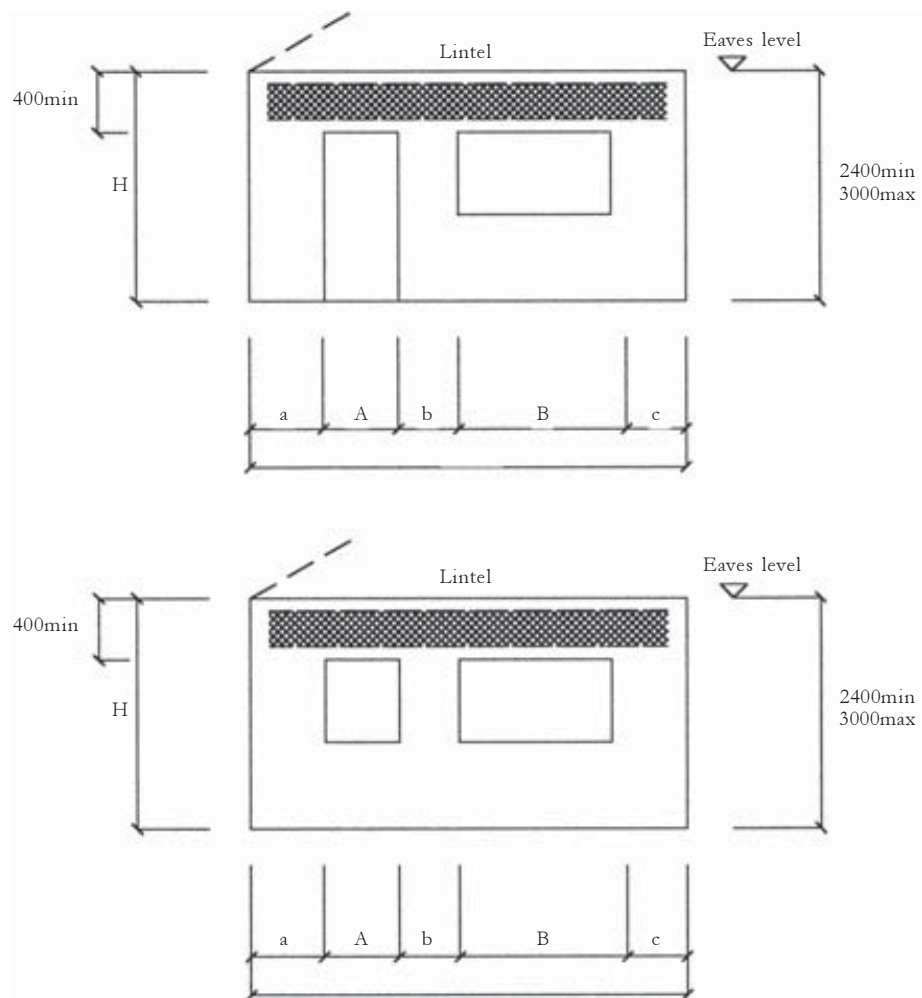

Single/upper storey with sheeted or tiled roof

a and c not less than 150 mm (solid units) or 200 mm (hollow units)
 b, A and B in accordance with Table 4.8 (HBM Part 2, Section 3, Table 7)

Lower storey of double storey or single/upper storey with concrete roof

A or B not greater than 2500 mm

a not less than $\frac{A}{x}$

c not less than $\frac{B}{x}$

b not less than $\frac{A+B}{x}$ or 300 mm

(hollow unit filled with infill concrete)

or 300 mm (solid units)

400 mm (hollow units)

Where

x = 6 - timber floor

4 - reinforced concrete floor (span not greater than 4,5 m)

3 - reinforced concrete floor (span greater than 4,5 m but not greater than 6,0 m)

Figure 4.7 Limitations on the size of openings (HBM Part 2, Section 3, Figure DM7)



Table 4.2 **Maximum dimensions for external unreinforced wall panels supported on both sides** (HBM Part 2, Section 3: Table 1)

Nominal wall thickness, mm	Wall type	Panel A No openings				Panel B Openings ≤ 15% wall area				Panel C Openings ≥ 15% wall area			
		L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m
Solid Units													
90	single leaf	3,2	2,4	2,8	3,4	2,7	2,4	2,5	3,4	2,7	2,4	2,3	3,4
90 - 90	cavity	5,5	2,7	5,5	3,9	5,5	2,7	5,0	3,9	5,5	2,4	4,5	3,9
110	single leaf	4,5	2,7	4,0	3,6	4,0	2,7	3,5	3,6	3,5	2,7	3,0	3,6
110 - 110	cavity	7,0	3,3	6,0	4,4	7,0	2,4	5,5	4,4	6,5	2,4	5,0	4,4
140	single leaf	7,0	3,3	6,0	4,3	6,5	2,4	5,2	4,3	6,0	2,7	5,0	4,3
190	collar jointed	8,0	4,6	8,0	4,6	8,0	4,6	8,0	4,6	8,0	4,0	7,5	4,6
220	collar jointed	9,0	4,6	9,0	4,6	9,0	4,6	9,0	4,6	9,0	4,6	9,0	4,6
Hollow Units													
90	single leaf	2,8	2,4	2,5	3,4	—	—	—	—	—	—	—	—
90 - 90	cavity	5,0	2,7	4,5	3,9	4,5	2,4	4,0	3,9	4,0	2,7	3,5	3,9
110	single leaf	3,5	2,4	3,3	3,6	3,0	2,4	2,8	3,6	3,0	2,4	2,8	3,6
110 - 110	cavity	6,0	2,4	5,0	4,2	5,0	2,4	4,2	4,2	4,5	2,7	4,2	4,2
140	single leaf	5,5	2,4	4,5	4,2	4,5	2,7	4,0	4,2	4,2	2,4	3,7	4,2
190	single leaf	7,5	2,7	6,0	4,4	6,5	2,4	5,0	4,6	6,0	2,7	4,8	4,4

Note:


- Two alternative panel sizes (L x H) are provided in respect of each panel type; the left hand column for each panel type provides dimensions for the maximum length (L) and the right hand column the corresponding maximum height dimension (H). Linear interpolation is permitted between these two sets of panel dimensions but not between wall types.
- The values tabulated in respect of solid units may be used for corresponding walls of hollow unit construction provided that the following reinforcement is provided:
 - truss type brickforce having main wires of not less than 3,55 mm diameter built into courses at vertical centres not exceeding 400 mm;
 - depending on the wall thickness 2 No 5,6 mm diameter rods (90 and 110 mm single leaf and cavity walls) in the bed joint immediately above the window level, or a single Y8 bar in a bond block (140 and 190 mm single leaf) at this same level, such reinforcements extending across the entire length of the panel and into the supports.
- Refer Figure 4.5 for definition of L and H.
- Where the collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.
- Refer to Figure 4.7 and Table 4.8 for maximum lengths of openings and minimum distances between face of support and openings and between successive openings.
- Panel sizes are based on a minimum height of masonry above openings of not less than 0,4 m. Panels incorporating full height doors or doors with fanlights shall be treated as panels supported on one side only and be sized in accordance with Table 4.5 (wall with opening).
- Panel dimensions are based on the assumption that lintels are installed above all openings.

Table 4.3 **Maximum dimensions for external unreinforced wall panels supported on both sides incorporating a tied control/articulation joint** (HBM Part 2, Section 3: Table 2)


Nominal wall thickness, mm	Wall type	Panel A No openings				Panel B Openings ≤ 15% wall area				Panel C Openings ≥ 15% wall area			
		L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m	L,m	H,m
Solid Units													
90	single leaf	3,0	2,4	2,7	3,4	n p	n p	n p	n p	n p	n p	n p	n p
90 - 90	cavity	5,5	2,7	5,0	3,9	5,0	2,7	4,5	3,9	4,5	2,7	4,0	3,9
110	single leaf	4,5	2,4	3,8	3,6	3,5	2,7	3,2	3,6	3,5	2,4	3,0	3,6
110 - 110	cavity	7,0	3,0	5,5	4,4	6,5	2,4	5,0	4,4	6,0	2,4	4,5	4,4
140	single leaf	7,0	2,7	5,5	4,3	6,0	2,4	4,5	4,3	5,5	2,4	4,5	4,3
190	collar jointed	8,0	4,6	8,0	4,6	8,0	3,6	7,0	4,6	8,0	3,6	7,0	4,6
220	collar jointed	9,0	4,6	9,0	4,6	9,0	4,6	9,0	4,6	8,5	4,6	8,5	4,6
Hollow Units													
90	single leaf	2,3	2,4	2,1	3,4	n p	n p	n p	n p	n p	n p	n p	n p
90 - 90	cavity	5,0	2,4	4,5	3,9	4,0	2,7	3,5	3,9	4,0	2,7	3,5	3,9
110	single leaf	3,3	2,4	3,0	3,6	2,8	2,7	2,6	3,6	2,7	2,4	2,4	3,6
110 - 110	cavity	5,5	2,4	4,5	4,2	4,5	2,4	4,0	4,2	4,3	2,4	3,7	4,2
140	single leaf	5,0	2,4	4,0	4,2	4,0	2,7	3,5	4,2	4,0	2,4	3,5	4,2
190	single leaf	7,0	2,7	6,0	4,4	6,0	2,4	4,5	4,4	5,5	2,4	4,5	4,4

Note:


- Two alternative panel sizes (L x H) are provided in respect of each panel type: the left hand column for each panel type provides dimensions for the maximum length (L) and the right hand column the corresponding maximum height dimension (H). Linear interpolation is permitted between these two sets of panel dimensions but not between wall panel types.
- The values tabulated in respect of solid units may be used for corresponding walls of hollow unit construction provided that the following reinforcement is provided:
 - truss type brickforce having main wires of not less than 3,55 mm diameter built into courses at vertical centres not exceeding 400 mm;
 - depending on the wall thickness 2 No 5,6 mm diameter rods (90 and 110 mm single leaf and cavity walls) in the bed joint immediately above the window level, or a single Y8 bar in a bond block (140 and 190 mm single leaf) at this same level; such reinforcements extending across the entire length of the panel and into the supports.
- Refer Figure 4.5 for definitions of L and H.
- Where collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.
- Refer to Figure 4.8 for location and details of tied control joint.
- np = not permitted
- Panel sizes are based on a minimum height of masonry above openings of not less than 0,4 m. Panels incorporating full height doors or doors with fanlights shall be treated as panels supported on one side only and be sized in accordance with Table 4.5 (wall with opening)
- Panel dimensions are based on the assumption that lintels are installed above all openings.
- Reinforcement to be discontinuous across a tied control joint.

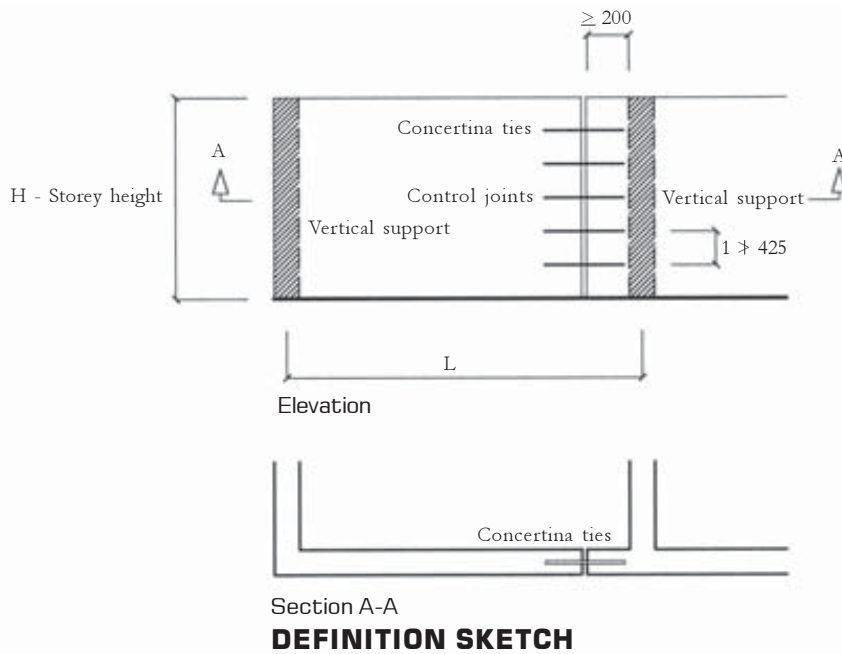


10mm mild steel dowel rod (greased on one side of joint to break bond with concrete)

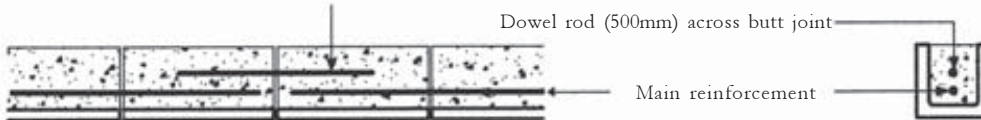


HOLLOW UNIT BOND BEAMS

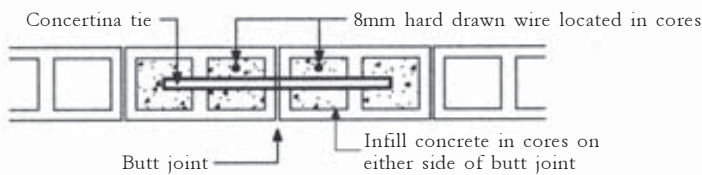

HOLLOW SINGLE LEAF WALLS

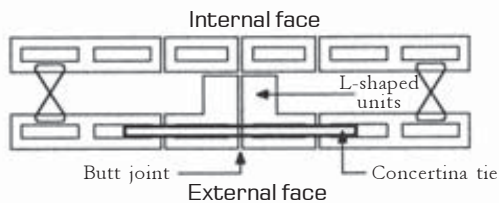

CAVITY TIES

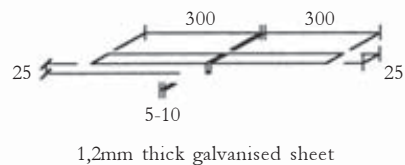

CONCERTINA TIES

Note: Concertina tie placed in mortar bed joints at vertical centres not exceeding 425mm

Figure 4.8 Tied butt control joint details (HBM Part 2, Section 3, Figure DM8)

Table 4.4 **Maximum dimensions for internal unreinforced wall panels supported on both sides with or without openings** (HBM Part 2, Section 3, Table 3)

Nominal wall thicknesses, mm	Wall type	Internal wall panel with or without openings	
		L, m	H, m
Solid Units			
90	single leaf	4,5	3,4
90 – 90	cavity	6,0	3,9
110	single leaf	5,5	3,6
110 – 110	cavity	7,0	4,4
140	single leaf	7,0	4,3
190	collar jointed	8,5	4,6
220	collar jointed	9,0	4,6
Hollow Units			
90	single leaf	4,5	3,4
90 – 90	cavity	5,5	3,9
110	single leaf	6,0	3,6
110 – 100	cavity	7,0	4,4
140	single leaf	8,0	4,6
190	single leaf	8,5	4,6

Note: Where collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.

Table 4.5 **Maximum dimensions for internal and external unreinforced wall panels supported on one vertical side only** (HBM Part 2, Section 3, Table 4)

Nominal wall thickness, mm	Wall type	Internal wall panel or without openings		External wall panels			
				No openings		Wall with openings	
		L,m	H,m	L,m	H,m	L,m	H,m
Solid Units							
90	single leaf	1,4	3,4	1,4	3,4	1,2	3,0
90 - 90	cavity	2,1	3,9	2,1	3,9	1,8	3,6
110	single leaf	2,0	3,6	2,0	3,6	1,6	3,6
110 - 110	cavity	2,6	4,4	2,6	4,4	2,1	3,6
140	single leaf	2,5	4,3	2,5	4,3	2,0	3,6
190	collar jointed	3,4	4,6	3,4	4,6	2,7	3,6
220	collar jointed	4,0	4,6	4,0	4,6	3,1	3,6
Hollow Units							
90	single leaf	1,4	3,4	1,4	3,4	1,2	3,0
90 - 90	cavity	2,1	3,9	2,1	3,9	1,8	3,6
110	single leaf	2,0	3,6	2,0	3,6	1,8	3,3
110 - 110	cavity	2,6	4,4	2,6	4,4	2,0	3,3
140	single leaf	2,5	4,3	2,5	3,6	1,8	3,0
190	single leaf	3,4	4,6	3,4	3,6	2,4	3,3

Note:

- Where collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.
- Distance between opening and free edge not to be less than dimension "b" given in Table 4.8.
- Panel dimension is based on the assumption that lintels are installed above all openings.



Table 4.6 **Maximum length of external, unreinforced wall panel 2,6 m (max.) high supporting a free standing (isosceles) gable triangle or portion thereof** (HBM Part 2, Section 3, Table 5)

Nominal wall thickness, mm	Wall type	No openings, m					With openings, m				
		SLOPE									
		≤11°	15°	17°	22°	26°	≤11°	15°	17°	22°	26°
Solid Units											
90	single leaf	2,8	2,7	2,6	2,6	2,6	2,4	2,4	2,4	2,4	2,4
90 - 90	cavity	5,5	5,5	5,5	5,0	5,0	4,5	4,5	4,0	4,0	4,0
110	single leaf	4,5	4,5	4,5	4,0	4,0	4,0	4,0	3,5	3,5	3,5
110 - 110	cavity	7,0	7,0	6,5	6,0	6,0	6,0	5,5	5,5	5,0	5,0
140	single leaf	6,5	6,0	5,5	5,5	5,5	5,0	5,0	4,5	4,5	4,5
190	collar jointed	8,0	8,0	8,0	8,0	8,0	8,0	7,5	7,5	7,0	6,5
220	collar jointed	8,0	8,0	8,0	8,0	8,0	8,0	8,0	8,0	8,0	8,0
Hollow Units											
90	single leaf	2,5	2,5	2,5	2,5	2,5	2,1	2,1	2,1	2,0	2,0
90 - 90	cavity	4,5	4,5	4,0	4,0	4,0	3,5	3,5	3,5	3,5	3,5
110	single leaf	3,5	3,5	3,3	3,3	3,0	3,0	3,0	2,8	2,7	2,7
110 - 110	cavity	5,5	5,5	5,0	5,0	5,0	4,5	4,5	4,0	4,0	4,0
140	single leaf	4,5	4,5	4,5	4,0	4,0	4,0	3,5	3,5	3,3	3,3
190	single leaf	6,0	5,5	5,5	5,0	5,0	5,0	5,0	5,0	4,5	4,5

Note:

- The values tabulated in respect of solid units may be used for corresponding walls of hollow unit construction provided that the following reinforcement is provided:
 - truss type brickforce having main wires of not less than 3,55 mm diameter built into courses at vertical centres not exceeding 400 mm;
 - 2 No 5,6 mm diameter rods (90 and 110 mm single leaf and cavity walls) in the bed joint immediately above the window level, or a single Y8 bar in a bond block (140 and 190 mm single leaf) at this level, depending on the wall thickness; such reinforcement extending across the entire length of the panel and into the supports.
- Where collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.
- Refer to Figure 4.7 and Table 4.8 for maximum lengths of openings and minimum distances between face of supports and openings and between successive openings.
- Panel dimensions are based on the assumption that lintels are installed above all openings.
- Internal panel lengths for gables (firewalls) having slopes within the range presented, may be based on the maximum length tabulated in respect of a wall without openings in accordance with Table 4.2.

Table 4.7 **Maximum base width (G) of external triangular unreinforced gable end** (HBM Part 2, Section 3, Table 6)

Nominal wall thickness, mm	Wall type	Maximum Base Width (G), m				
		SLOPE				
		≤11°	15°	17°	22°	26°
Solid Units						
90	single leaf	6,0	6,0	6,0	5,0	4,5
90 - 90	cavity	8,0	8,0	8,0	7,5	6,5
110	single leaf	6,0	6,0	6,0	5,0	5,5
110 - 110	cavity	8,0	8,0	8,0	8,0	7,5
140	single leaf	8,0	8,0	8,0	8,0	7,0
190	collar jointed	8,0	8,0	8,0	8,0	8,0
220	collar jointed	8,0	8,0	8,0	8,0	8,0
Hollow Units						
90	single leaf	6,0	6,0	6,0	5,0	4,0
90 - 90	cavity	8,0	8,0	8,0	7,0	5,5
110	single leaf	6,0	6,0	6,0	5,0	4,5
110 - 110	cavity	8,0	8,0	8,0	8,0	6,5
140	single leaf	8,0	8,0	8,0	7,0	6,0
190	single leaf	8,0	8,0	8,0	8,0	7,5

Note:

- Refer to Figure 4.5 for definition of base width (G)
- Where collar joints in collar jointed walls are not fully mortared, such walls shall be treated as cavity walls.
- Where openings are provided within the gable, reduce the permissible value of G by the width of such openings.
- The maximum base width of internal gables (firewalls), for the range of slopes presented, may be taken as that tabulated respect of a slope of 11°.

Table 4.8 **Critical dimensions of openings and edge distances in respect of single / upper storey external unreinforced wall panels supporting sheeted or tiled roofs** (HBM Part 2, Section 3, Table 7)

Nominal wall thickness, mm	Wall type	Minimum length of dimension "b"	Maximum length of dimension "A" or "B"	Maximum length of sum of dimensions "A" and "B"
		m	m	m
Solid Units				
90	single leaf	600	2,0	2,0
90 - 90	cavity	300	3,0	3,5
110	single leaf	500	2,5	3,0
110 - 110	cavity	300	3,0	4,0
140	single leaf	300	3,0	4,0
190	collar jointed	300	3,5	4,5
220	collar jointed	300	3,5	5,5
Hollow Units				
90	single leaf	600	2,0	2,0
90 - 90	cavity	600	2,5	2,5
110	single leaf	400	2,5	3,5
110 - 110	cavity	400	3,0	4,0
140	single leaf	400	3,0	4,0
190	single leaf	400	3,5	4,5

Note:

Refer to Figure 4.7 for definitions of dimensions "b", "A", and "B".



FOUNDATION WALLS

The maximum height of foundation walls retaining fill behind a wall is given in Table 4.9

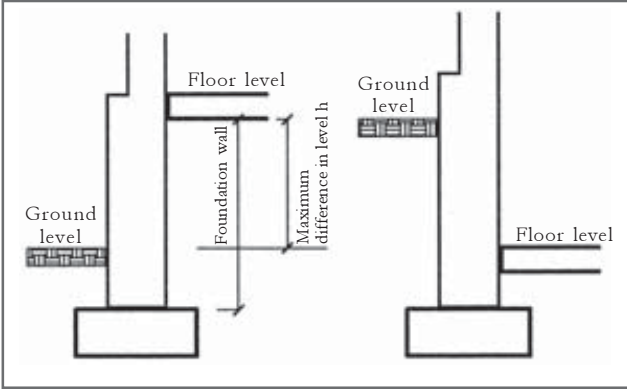


Figure 4.9 **Foundation walls** (HBM Part 2, Section 3, Figure DM9)

Table 4.9 **Maximum height of foundation walls where fill is retained behind wall** (HBM Part 2, Section 3, Table 8)

Nominal wall thickness, mm	Wall type	Maximum difference in ground levels(see Fig 4.9), mm
90 & 110	single leaf	200
140	single leaf	400
190	single leaf/collar jointed	600
220	collar jointed	700
90 - 90	cavity	700
110 - 110	cavity	1000
290	collar jointed	1000
330	collar jointed	1200

Note:

Cores in hollow units and cavities in cavity walls to be filled with grade 10 infill concrete

RETAINING WALLS

The maximum height of walls retaining earth are given in Table 4. 10.

Table 4. 10 **Retaining walls** (HBM Part 2, Section 3, Table 16)

Nominal wall thickness, (T) mm	Wall type	Maximum height retained (h) without piers, m	Nominal pier dimension (D), mm	Maximum pier spacing, m
Solid Units				
140	single leaf	1,3	600 x 300	1,8
190	collar jointed	1,3	600 x 300	2,5
190	collar jointed	1,6	800 x 400	2,6
220	collar jointed	1,7	660 x 330	3,0
220	collar jointed	1,8	880 x 440	3,1
290	collar jointed	1,0	-	-
330	collar jointed	1,2	-	-
Hollow Units				
140	single leaf	1,1	600 x 300	1,8
190	single leaf	1,1	600 x 300	2,5
190	single leaf	1,4	800 x 400	2,6

Notes:

- See Figure 4. 10 for definition of height and wall dimensions.
- Piers shall project on the opposite side of the wall to the fill that is being retained.
- Control joints shall be located at intervals not exceeding 10 m.
- No surcharge of fill shall be placed within a distance equal to the height of the amount of fill being retained.
- Sub-soil drainage shall be provided behind the wall sufficient weepholes to prevent the accumulation of water

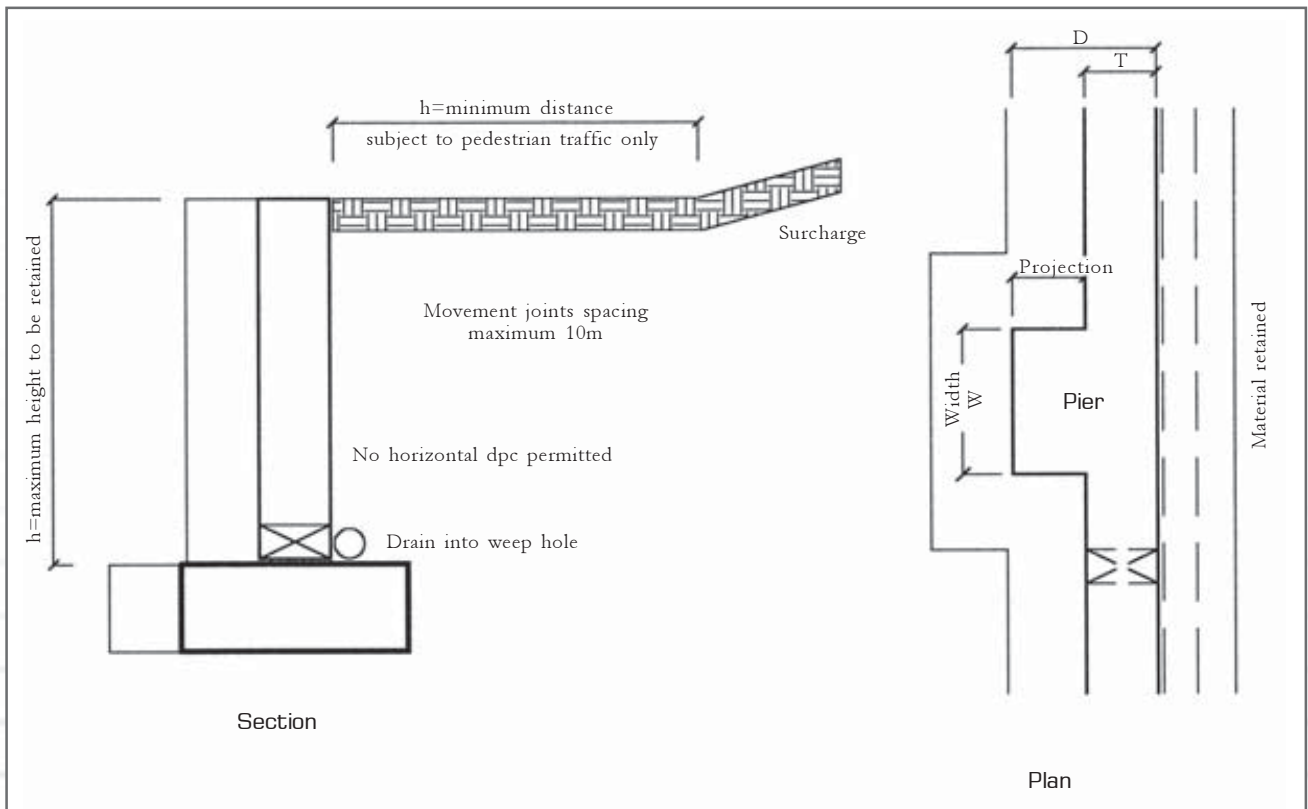


Figure 4. 10 **Retaining walls** (HBM Part 2, Section 3, Figure DM13)



FREE-STANDING WALLS


Dimensions of free-standing walls as used in boundary and garden walls using solid and hollow masonry units are given in Tables 4.11 and 4.12

Table 4.11 **Free-standing walls (solid units)** (HBM Part 2, Section 3, Table 17)

Nominal wall thickness (T), mm	Maximum height (H), m	Nominal dimensions of piers (overall depth x width D x W), mm	Maximum pier spacing (centre to centre; S),m
No Piers			
90	0,8	–	–
110	1,0	–	–
140	1,3	–	–
190	1,5	–	–
220	1,8	–	–
290	2,2	–	–
Z Shaped			
90	1,8	390 x 90	1,2
90	2,0	490 x 90	1,4
110	1,6	330 x 110	1,5
110	2,1	440 x 110	1,5
140	2,2	440 x 140	2,0
140	2,5	590 x 140	2,5
190	2,1	390 x 190	2,5
190	2,5	490 x 190	3,0
220	2,4	440 x 220	3,0
220	2,8	550 x 220	4,0
Piers projecting on one side			
90	1,4	290 x 290	1,4
90	1,5	390 x 290	1,6
90	1,7	490 x 290	1,6
110	1,5	330 x 330	1,8
110	1,5	440 x 330	1,8
110	1,9	550 x 330	2,0
140	1,7	440 x 440	2,2
140	1,8	590 x 390	2,5
190	2,0	590 x 390	2,8
220	2,3	660 x 440	3,2
Piers projecting on both sides			
90	1,5	490 x 290	1,4
110	1,6	550 x 330	1,8
140	1,6	440 x 440	2,2
190	1,8	590 x 390	2,8
220	2,1	660 x 440	3,2
Diaphragm walls			
90	2,1	290 x 190	1,4
90	2,7	390 x 190	1,4
110	2,6	330 x 220	1,6

Note:

- No earth to be retained by walls.
- Piers to extend to top of wall without any reduction in size.
- Walls to terminate in a pier or a return.
- Refer to Figure 4.11 for definitions of D, H, S, T and W.

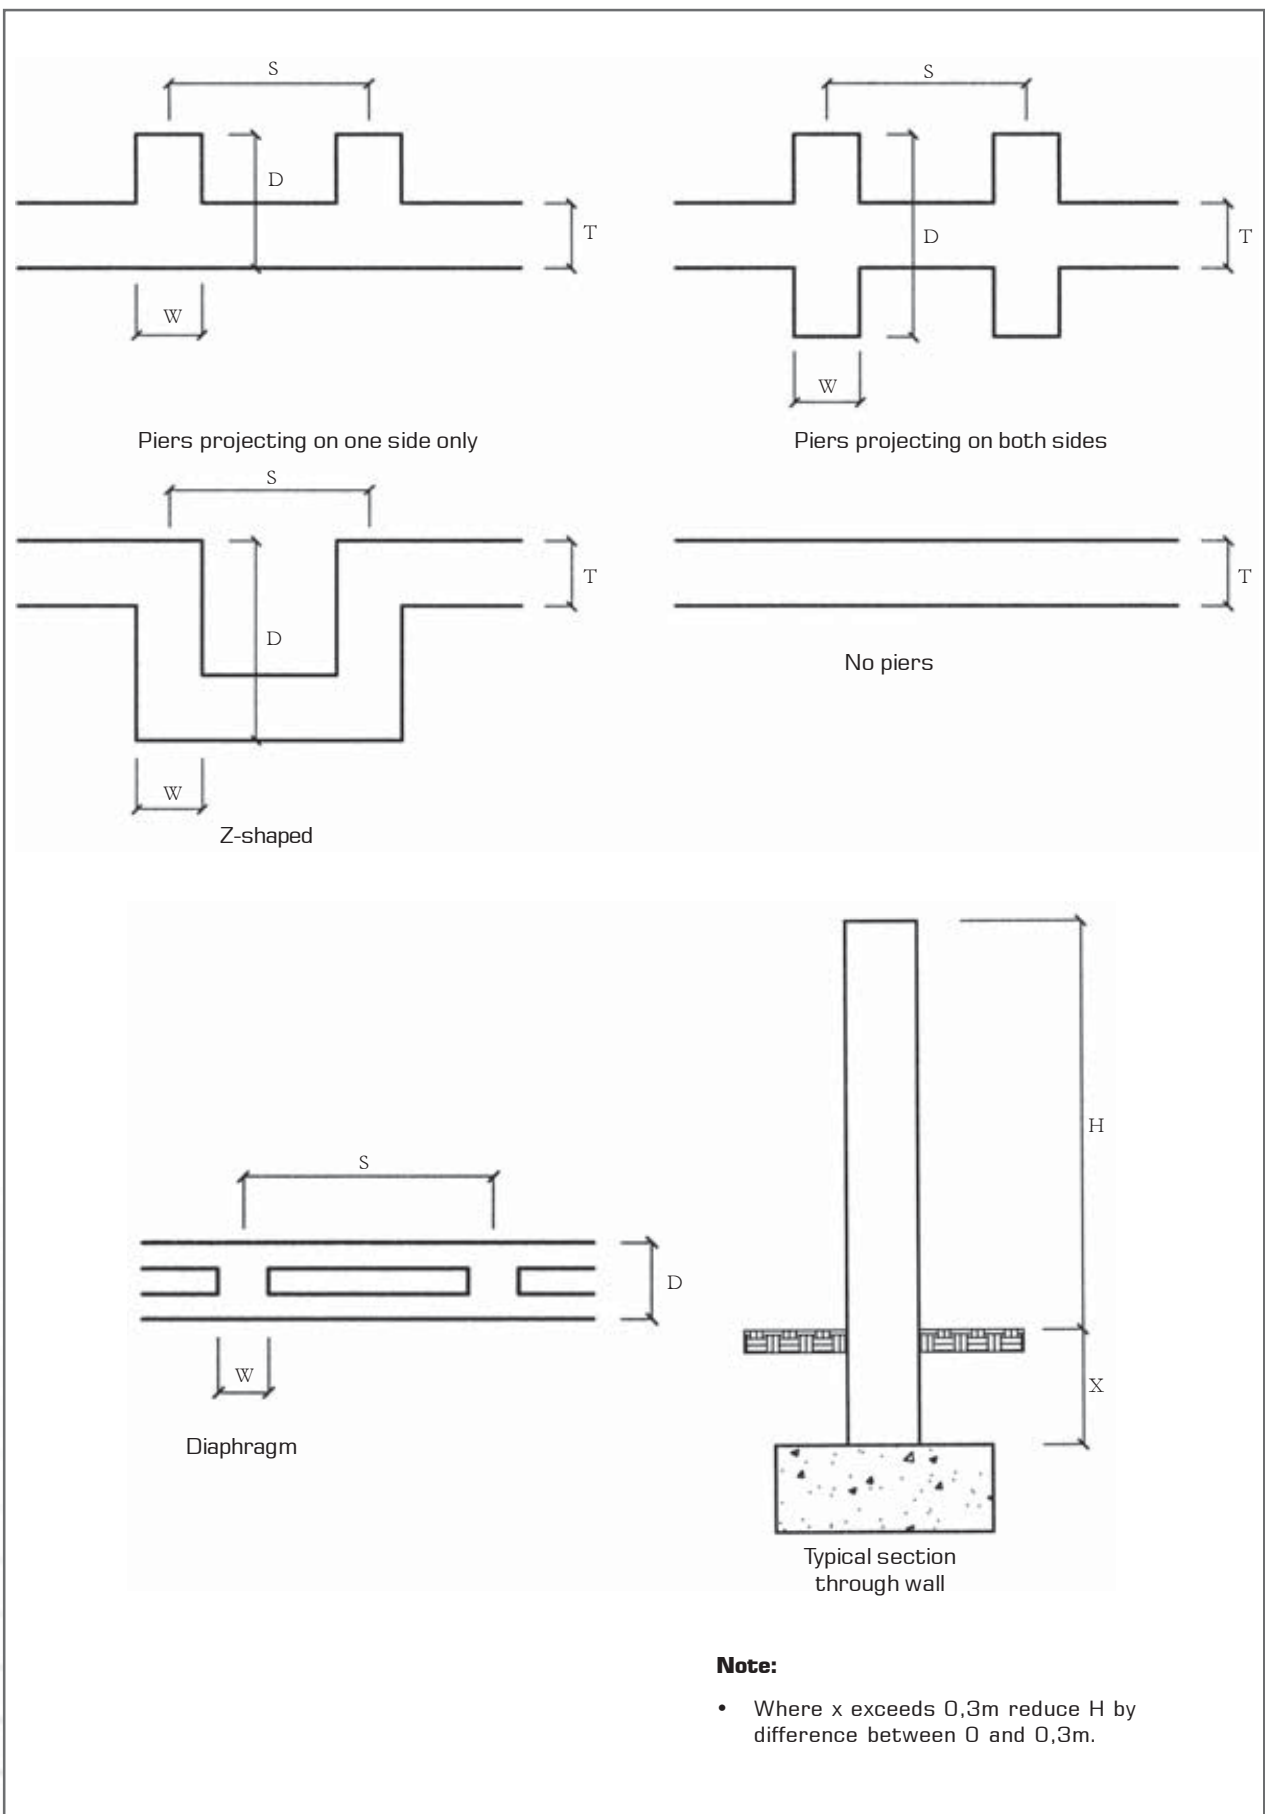

- Note:**
- Where x exceeds 0,3m reduce H by difference between 0 and 0,3m.

Figure 4.11 Free-standing walls (HBM Part 2, Section 3, Figure DM14)



Table 4.12 **Free-standing walls (hollow units)** (HBM Part 2, Section 3, Table 18)

Nominal wall thickness (T), mm	Maximum height (H), m	Nominal dimensions of piers (overall depth x width) (D x W), mm	Maximum pier spacing (centre to centre; S),m
No Piers			
90	0,8	–	–
140	1,2	–	–
190	1,4	–	–
Z Shaped			
90	1,6	390 x 90	1,2
90	1,8	490 x 90	1,4
140	1,8	440 x 140	2,0
140	2,1	540 x 140	2,2
190	2,3	590 x 190	2,8
Piers projecting on one side			
90	1,2	390 x 390	1,4
90	1,7	490 x 390	1,7
140	1,4	440 x 290	2,1
140	1,5	540 x 390	2,3
190	1,6	590 x 390	2,8
Piers projecting on both sides			
90	1,0	390 x 290	1,4
140	1,4	440 x 440	2,2
190	1,7	590 x 590	2,9
Diaphragm walls			
90	1,8	290 x 190	1,4
90	2,3	390 x 190	1,4

Note:

- Cores of hollow units to be solidly filled with infill concrete.
- No earth is to be retained by walls.
- Piers to extend to top of wall without any reduction in size.
- Walls to terminate in a pier or a return.
- Refer to Figure 4.11 for definition of D, H, S, T and W.

CONTROL JOINTS

Butt joints are specified to form vertical control joints in the HBM where no lateral stability required. Reference should be made to the CMA Detailing of Concrete Masonry publications where lateral stability

is required and for other details on the positioning of control joints.

Control joint location for free-standing walls is shown in Figure 4.12.

Table 4.13 **Maximum vertical control joint spacing in walls** (HBM Part 2, Section 3, Table 19)

Unit type	Moisture expansion %	Appropriate spacing of vertical joints 10 to 12mm wide	
		Free standing wall, m	Housing units, m
Unreinforced masonry			
Burnt clay	< 0,05	1 6	1 8
	0,05 – 0,10	1 0	1 4
	0,10 – 0,20	6	1 0
Calcium silicate	–	7,5 – 9,0	9
Concrete	–	5,0 – 7,0	8
Masonry with bed joint reinforcement			
Burnt clay	< 0,5	16	18
	0,05 – 0,10	12	16
	0,10 – 0,20	8	12
Calcium silicate	–	10	12
Concrete	–	10	12

Note:

- Bed joint reinforcement at vertical centres 450mm
- Bed joint reinforcement to be shown on drawings
- A Y8 bar in bond beams at centres 1200mm

(generally below slabs, below sills, in course above windows, above doors and in the uppermost course) accepted in place of bed joint reinforcement.

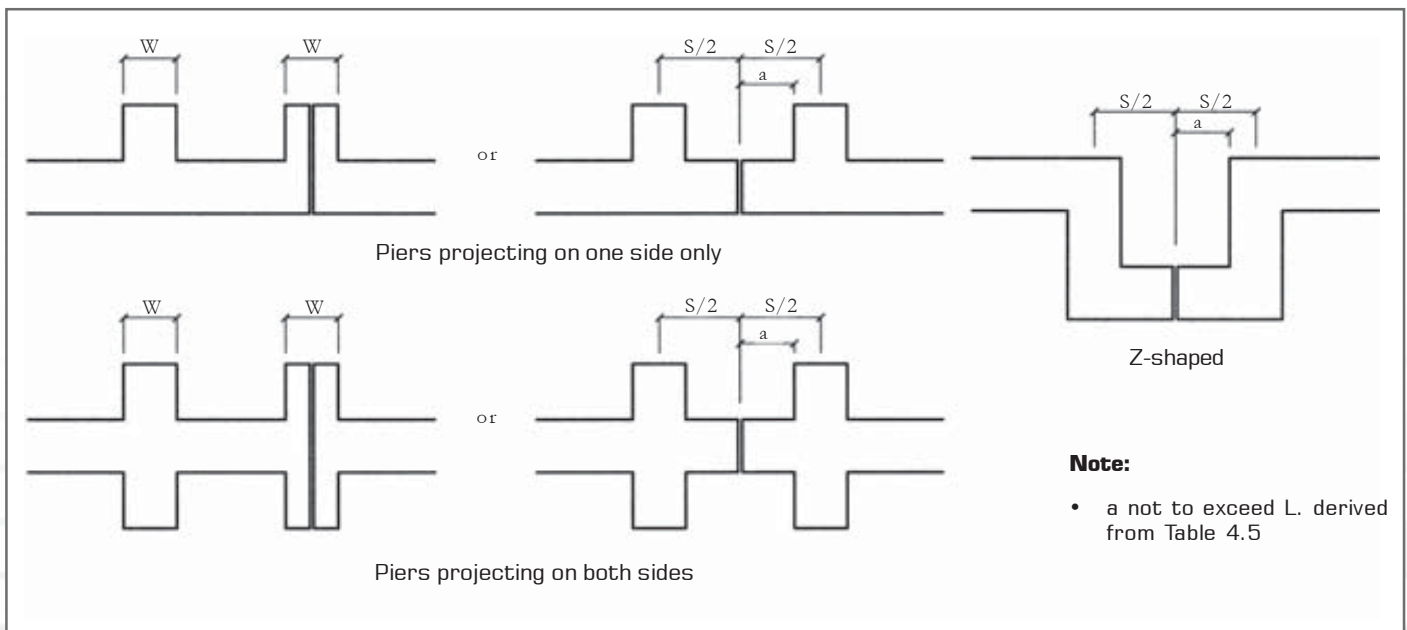


Figure 4.12 **Location of control joints in free-standing walls** (HBM Part 2, Section 3, Figure DM17)



SECURING TIMBER ROOF TRUSSES, RAFTERS AND THE LIKE

Roof trusses, rafters and the like shall be fixed to walls by means of the following anchor types, selected in accordance with Table 4. 14.

- i) **Type A:** two strands of 4 mm diameter galvanised steel wire
- ii) **Type B:** 30 x 1,2 mm galvanised steel strap
- iii) **Type C:** 30 x 1,6 mm galvanised steel strap

Table 4. 14 **Roof anchor selection** (HBM Part 2, Section 3, Table 20)

Roof slope, degrees	Maximum roof truss/ rafter spacing, mm	Type of anchor required	
		Light roof	Heavy roof
< 15	760	A, B or C	A for all applications
	1050	B or C	
	1350	C	
15 to 30	760	A, B or C	
	1050	B or C	
	1350	C	
> 30	Any	A, B or C	

Note:

- Heavy roofs include those covered with concrete tiles, clay tiles or natural slates. Light roofs refer to metal or fibre cement, profiled sheet roofs, fibre cement slates or metal roof tiles. (Length of strap in walls: Heavy roofs 300mm light roofs 600mm)
- Wire is not permitted for lightweight roof coverings unless truss/rafter spacing is 760 mm maximum (This spacing would be very unusual).

LINTELS

Lintels over openings shall have a sufficient depth for the clear span of the opening to enable them to be constructed in accordance with 3.12 HBM Part 3, Section 3. (For details of the amount of reinforcement required in a lintel refer to the HBM Part 3, Section 3, Clause 3.12 Masonry over openings).

Minimum depths of lintels over spans of up to 3,5 m are given in Table 4.15.

Maximum span of opening of nominally reinforced shallow lintels are given in Table 4.16.

Details of bond block lintels supporting heavy roofs are given in Table 4.17.

Details of prestressed concrete lintels are given in Table 4.18.

Details of lintels over double garage openings are given in Table 4.19.

The following Tables set out the minimum lintel depths

for given openings (Refer to Figure 4.14)

- Bed joint reinforced lintels
- Bond block lintels
- Prestressed concrete lintels
- Lintels over garage openings

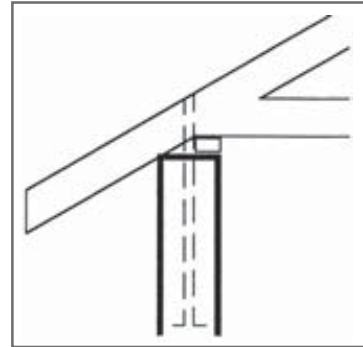


Figure 4.13 **Roof Anchoring**

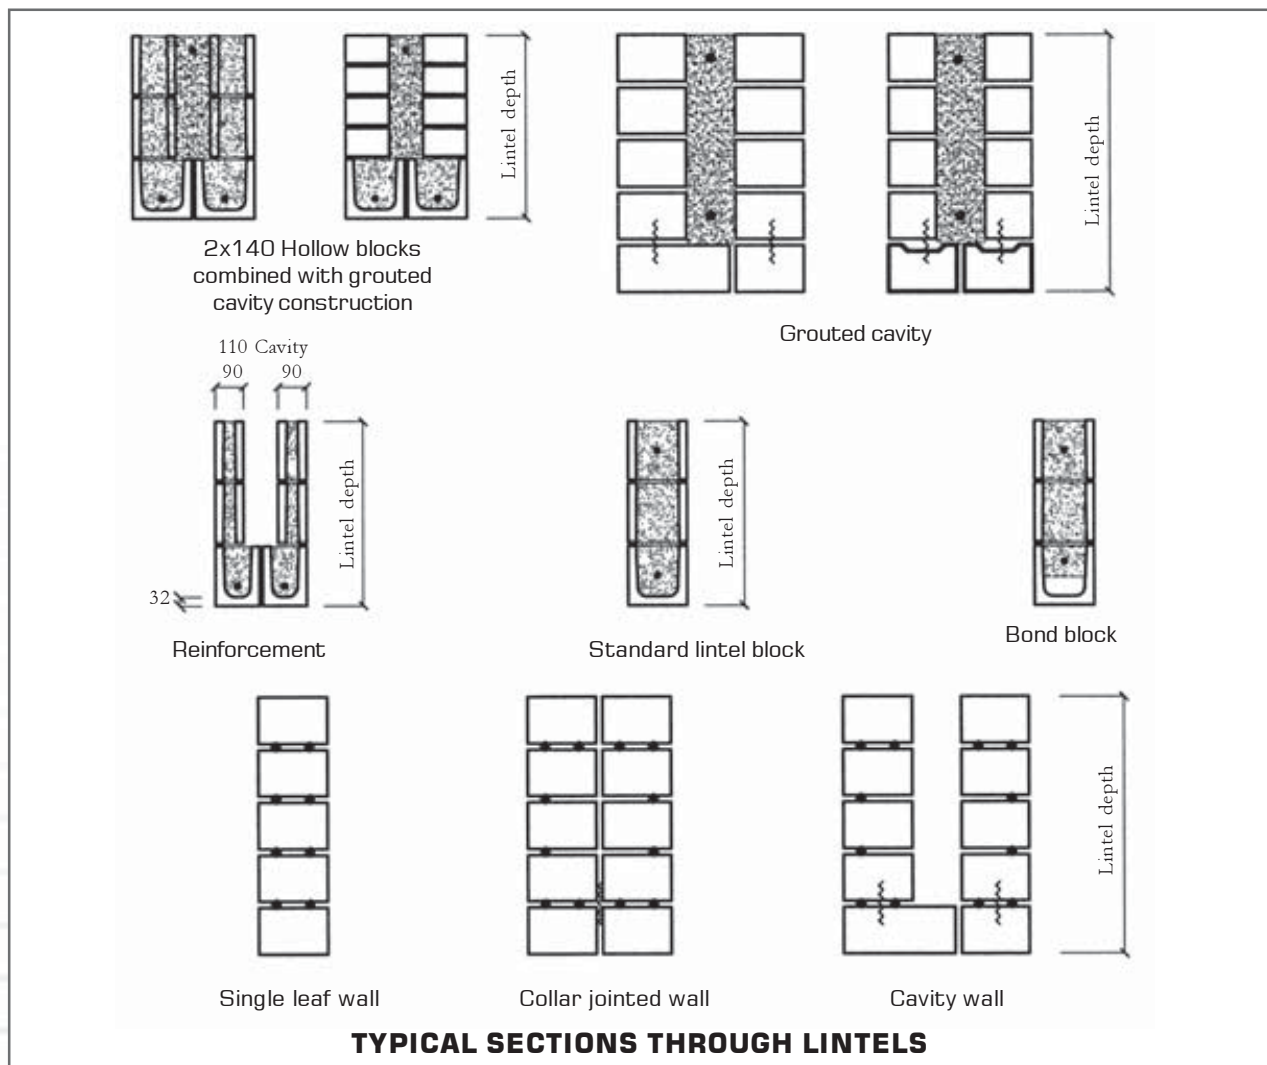


Figure 4.14 **Minimum depths of lintels** (HBM Part 2, Section 3, Figure DM 20)



Table 4.15 **Minimum depths of lintels required over openings of various spans up to 3,5m** (HBM Part 2, Section 3, Table 21)

Minimum depth of lintel			Maximum lintel span, m						
Course height, mm			No Roof	Light roof span, m			Heavy roof span, m		
85	100	200		4	6	8	4	6	8
90 mm Single leaf									
-	400	-	2,5	2,0	2,0	np	1,5	1,5	np
425	-	-	3,0	2,0	2,0	np	2,0	1,5	np
510	500	600	3,0	2,5	2,5	np	2,5	2,0	np
595	600	-	3,0	3,0	3,0	np	2,5	2,0	np
680	700	800	3,0	3,0	3,0	np	2,5	2,5	np
765	800	-	3,0	3,0	3,0	np	2,5	2,5	np
850	-	-	3,0	3,0	3,0	np	3,0	2,5	np
-	900	1000	3,0	3,0	3,0	np	2,5	2,5	np
935	-	-	3,0	3,0	3,0	np	3,0	3,0	np
110 mm Single leaf									
425	-	-	3,0	2,0	2,0	np	2,0	1,5	np
510	-	-	3,0	2,5	2,5	np	2,5	2,0	np
595	-	-	3,0	3,0	3,0	np	2,5	2,5	np
680	-	-	3,0	3,0	3,0	np	2,5	2,5	np
765	-	-	3,0	3,0	3,0	np	3,0	2,5	np
850	-	-	3,0	3,0	3,0	np	3,0	3,0	np
140 mm Single leaf									
-	400	-	2,5	2,5	2,5	np	2,0	1,5	1,5
425	-	-	3,0	2,5	2,5	np	2,0	2,0	1,5
510	500	600	3,0	3,0	3,0	np	2,5	2,5	2,0
595	600	-	3,0	3,0	3,0	np	3,0	3,0	2,5
680	700	800	3,0	3,0	3,0	np	3,0	3,0	2,5
190 mm Collar jointed									
-	400	-	2,5	2,5	2,5	2,0	2,5	2,0	2,0
475	-	-	3,0	2,5	2,5	2,5	2,5	2,5	2,0
510	500	600	3,5	3,0	3,0	3,0	3,0	2,5	2,5
595	600	-	3,5	3,5	3,5	3,0	3,0	3,0	3,0
680	700	800	3,5	3,5	3,5	3,5	3,5	3,5	3,0
765	800	-	3,5	3,5	3,5	3,5	3,5	3,5	3,0
850	-	-	3,5	3,5	3,5	3,5	3,5	3,5	3,5
-	900	1000	3,5	3,5	3,5	3,5	3,5	3,5	3,5
220 mm Collar jointed									
425	-	-	3,0	2,5	2,5	2,5	2,5	2,5	2,0
510	-	-	3,5	3,0	3,0	3,0	3,0	3,0	2,5
595	-	-	3,5	3,5	3,5	3,5	2,5	3,0	3,0
680	-	-	3,5	3,5	3,5	3,5	3,5	3,5	3,0
765	-	-	3,5	3,5	3,5	3,5	3,5	3,5	3,0
850	-	-	3,5	3,5	3,5	3,5	3,5	3,5	3,5
90 - 90 Cavity wall (solidly filled)									
-	400	-	2,5	2,5	2,5	2,5	2,5	2,0	2,0
425	-	-	3,0	3,0	3,0	3,0	2,5	2,0	2,0
510	500	600	3,0	3,0	3,0	3,0	3,0	2,5	2,5
595	600	-	3,0	3,0	3,0	3,0	2,5	3,0	2,5
680	700	800	3,0	3,0	3,0	3,0	3,5	2,5	3,0
110 - 110 Cavity wall (solidly filled)									
425	-	-	3,0	3,0	3,0	2,5	2,5	2,5	2,0
510	-	-	3,0	3,0	3,0	3,0	3,0	2,5	2,5
595	-	-	3,0	3,0	3,0	3,0	3,0	3,0	2,5
680	-	-	3,0	3,0	3,0	3,0	3,0	3,0	3,0

Table 4. 16 **Maximum width of opening in respect of nominally reinforced shallow lintels** (HBM Part 2, Section 3, Table 22)

Minimum number of courses			Primary Reinforcement, no x diam., mm	Maximum roof span, m					
				4		6		8	
Course height, mm				Maximum width of opening, m					
85	100	200	Light	Heavy	Light	Heavy	Light	Heavy	
90 mm Single leaf									
-	3	-	2 x 5,6	2,0	1,5	2,0	1,5	np	np
4	-	-	2 x 5,6	2,0	2,0	2,0	1,5	np	np
5	4	2	2 x 5,6	2,5	2,5	2,5	2,0	np	np
110 mm Single leaf									
4	-	-	2 x 5,6	2,0	2,0	2,0	1,5	np	np
5	-	-	2 x 5,6	2,5	2,5	2,5	2,0	np	np
140 mm Single leaf									
-	3	-	2 x 5,6	2,5	2,0	2,5	1,5	2,0	1,5
4	-	-	2 x 5,6	2,5	2,0	2,5	2,0	2,0	1,5
5	4	2	2 x 5,6	3,0	2,5	2,5	2,0	2,5	2,0
190 mm Collar jointed									
-	3	-	2 x 5,6	2,5	2,0	2,0	1,5	2,0	1,5
4	-	-	2 x 5,6	2,5	2,0	2,5	2,0	2,0	1,5
5	4	2	2 x 5,6	3,0	2,5	2,5	2,0	2,5	2,0
220 mm Collar jointed									
4	-	-	2 x 5,6	2,5	2,0	2,5	2,0	2,0	1,5
5	-	-	2 x 5,6	2,5	2,5	2,5	2,0	2,0	2,0
90 - 90 Cavity wall (solidly filled)									
-	3	-	2 x 5,6	2,5	2,0	2,0	1,5	2,0	1,5
4	-	-	2 x 5,6	2,5	2,0	2,5	2,0	2,0	1,5
5	4	2	2 x 5,6	2,5	2,0	2,5	2,0	2,0	1,5
110 - 110 Cavity wall (solidly filled)									
4	-	-	2 x 5,6	2,5	2,0	2,0	1,5	2,0	1,5
5	-	-	2 x 5,6	2,5	2,0	2,0	2,0	2,0	1,5

Note:

- If the cavity in cavity wall construction is not filled with infill concrete, the two leaves should be regarded as being independent leaves and be treated as single leaf walls.
- np = not permitted



Table 4.17 **Bond block lintels supporting heavy roofs** (HBM Part 2, Section 3, Table 23)

Maximum width of opening, m	Overall lintel depth, mm	Maximum roof span, m
140 mm Single leaf		
1,5	400	8
2,0	400	6
2,5	600	8
3,0	600	6
3,0	600	8
140/140 Bond beam in cavity wall construction		
1,0	400	8
1,5	400	6
2,0	600	8
2,5	600	6
3,0	800	8
190 mm Single leaf		
1,5	400	8
2,0	400	6
2,5	600	8
3,0	600	8
3,5	600	6
3,5	800	8

Table 4.18 **Prestressed concrete lintels** (HBM Part 2 Section 3 Table 24)

Minimum number of courses	Maximum Span, m		
	No Roof	Light roof	Heavy roof
85mm Course Height: Nominal Thickness \leq 140mm			
4	3,0	2,0	1,5
5	3,0	2,5	2,0
6	3,0	3,0	2,5
9	3,0	3,0	3,0
85mm Course Height: Nominal Thickness \geq 190mm			
4	3,0	2,0	2,0
5	3,5	2,5	2,5
6	3,5	3,5	3,0
9	3,5	3,5	3,5
100mm Course Height: Nominal Thickness \leq 140mm			
3	3,0	2,0	1,5
4	3,0	2,5	2,0
5	3,0	3,0	2,5
8	3,0	3,0	2,5
100mm Course Height: Nominal Thickness \geq 190mm			
3	2,5	2,0	2,0
4	3,0	2,5	2,0
5	3,5	3,5	3,0
8	3,5	3,5	3,5

Table 4. 19 **Lintels over double garage openings which have a clear opening not exceeding 5,0m** (HBM Part 2, Section 3, Table 25)

Lintel type	Minimum lintel depth, mm	Primary reinforcement	Application and maximum clear span of roof supported by lintel
190 Hollow block	600	2 x Y10	No roof loads
	800	2 x Y12	Light roof loads up to 8,0 m
	800	2 x Y12	Heavy loads up to 6,0 m
	1000	2 x Y12	Heavy roof loads up to 8,0 m
2 x 140 Hollow blocks combined with grouted cavity construction	600	2 x Y12	No roof loads
	800	2 x Y12	Light roof loads up to 8,0 m
	800	2 x Y12	Heavy roof loads up to 6,0 m
	1000	2 x Y16	Heavy roof loads up to 8,0 m
Grouted cavity construction	595/600	2 x Y12	No roof loads
	700	2 x Y12	Light roof loads up to 8,0 m
	765/800	2 x Y12	Heavy roof loads up to 6,0 m
	935/1000	2 x Y16	Heavy roof loads up to 8,0 m



5 SPECIFICATION AND CONSTRUCTION DETAILS

The quality of masonry work depends on the care taken in laying the units accurately to line and level and on the neatness and uniformity of the joints. Good concrete masonry walls depend just as much on good construction as on a good unit, and many cracked and leaky walls are due to the method of construction rather than to the units themselves. Requirements for quality of masonry units and workmanship should be stated in the specification.

Suggested clauses for inclusion in the contract specification are given first and are distinguished by being in italics, followed by notes. "Unit" applies to both block and brick unless otherwise stated.

In SANS 10145 and SANS 10249, there are sections on precautions to be observed to prevent cracking of masonry and moisture penetration. Information is also given on site procedures and construction techniques. Reference should be made to these standards.

The NHBRC Home Building Manual, Part 3, Section 3 covers masonry construction. The clauses in this section must be complied with if the contractor-built house is to be accepted under the NHBRC warranty against structural defects policy.

MATERIALS

1. Concrete masonry units

Concrete masonry units shall comply with the requirements of SANS 1215. Concrete masonry units of nominal compressive strength... MPa, shall be of the thickness shown on the drawings, and be ... (solid, hollow); or

Concrete masonry units shall comply with the requirements of the NHBRC Home Building Manual and shall be of the thickness shown on the drawing.

The specifier must decide on the class of concrete masonry unit required for the contract. In the case of houses, the strength requirements based on the HBM are given in Table 5.1.

The strength requirements based on empirical design for other masonry structures and elements are given in Table 5.2.

On important contracts, consideration should be given to building reference panel walls.

The drying shrinkage of concrete masonry units shall not exceed 0,6%.

Note:

The above clauses may include special requirements and special features such as profile, colour and surface texture of the masonry units. When face units

Table 5.1 **Minimum compressive strengths of masonry units** (HBM Part 3, Section 3, Table 1)

Description	Hollow units		Solid units	
	Average, MPa	Individual, MPa	Average, MPa	Individual, MPa
Single storey construction				
• on-site manufacture	3,0	2,4	4,0	3,2
• off-site manufacture	3,0	2,4	5,0	4,0
Double storey construction	7,0	5,6	10,0	8,0
Cladding and internal walls in concrete framed housing units	3,0	2,4	5,0	4,0

Note:

- The average compressive strength shall be determined on a minimum of five samples based on the gross surface area.
- On-site manufacture is where units do not require to be transported more than 25 m to the place where they are built into walls.
- The minimum compressive strength of masonry units is based on walls designed in accordance with the provisions of Part 2, Section 3 of the Home Building Manual.

Table 5.2 **Nominal compressive strength of masonry units for various wall types and positions**

Min. nominal unit strength, MPa	Wall type	Position
3,5 Hollow unit	<ul style="list-style-type: none"> • Foundation • Structural other than foundation and retaining walls • Non-structural other than free-standing walls • Parapet and balustrade • Infilling and cladding 	<ul style="list-style-type: none"> • Supporting single storey • Single storey building – external or internal • External or internal
7,0 Hollow unit	<ul style="list-style-type: none"> • Foundation • Structural • Free-standing • Retaining 	<ul style="list-style-type: none"> • Supporting double storey • Double storey building – external or internal
7,0 Solid unit	<ul style="list-style-type: none"> • Foundation • Structural other than retaining • Non-structural other than free-standing walls • Parapet and balustrade • Infilling and cladding 	<ul style="list-style-type: none"> • Supporting single storey • Single storey building – external or internal • External or internal
10,5 Solid unit	<ul style="list-style-type: none"> • Foundation • Structural (minimum wall thickness 140 mm) • Free-standing • Retaining 	<ul style="list-style-type: none"> • Supporting double storey • Double storey building - external or internal
14,0 Solid unit	<ul style="list-style-type: none"> • 90-50-90 to 90-110-90 cavity wall – structural • 110-110-110 cavity wall – structural 	<ul style="list-style-type: none"> • Double storey dwelling unit without concrete slab roof • Double storey building

are required to have coloured surfaces the colour shall be as agreed upon between the manufacturer and the purchaser and the manufacturer shall supply to the purchaser for his retention three units of the agreed colour to serve as an example of the possible range of such colour:

2. Sand

Sand for mortar shall comply with SANS 1090. Sand which does not comply with SANS 1090 may be used only with the written consent of the specifier:

The HBM permits acceptance of sand if not complying with SANS 1090 based on the following requirements:

- contain no organic material (material produced by animal or plant activities).

- not contain any particles, which are retained on a sieve of nominal size 5 mm.
- have a sufficiently small clay content such that a "worm" 3mm in diameter cannot be rolled in the palm of the hand, by adding a few drops of water to material obtained from the sieving of a sample of dry sand through a nylon stocking.
- when 2,5kg of common cement is mixed to 12,5kg of air dry sand, the mixture does not require more than 3,0 litres of water to be added to reach a consistency suitable for plastering and the laying of masonry.
- when mixed with the common cement in accordance with the mix proportions, has adequate workability.

The grading requirements for sand for mortar as specified in SANS 1090 are given in Table 5.3



Table 5.3 **Grading requirements of sand for mortar** (Extract from SANS 1090 Aggregates from natural sources – fine aggregates for plaster and mortar)

Sieves of square apertures, μm	Grading (percentage passing by mass)	
	Fine aggregate for plaster	Fine aggregate for mortar
4750	100	100
2360	90 – 100	90 – 100
1180	70 – 100	70 – 100
600	40 – 90	40 – 100
300	5 – 65	5 – 85
150	5 – 20	0 – 35
75	0 – 7,5	0 – 12,5

3. Coarse aggregate

Coarse aggregate for infill concrete shall comply with SANS 1083 and be of nominal size... mm.

The nominal size of coarse aggregate should be chosen in relation to the size of void to be filled; normally this is 9,5 mm maximum.

4. Water

Water shall be clean and free from injurious amounts of acids, alkalis, sugar and other organic substances. Water suitable for drinking purposes shall be acceptable. If so required by the specifier, the suitability of the water shall be proved by tests carried out by an approved laboratory.

SANS 10100: Part II – 1980, clause 3,2, Water, gives details of a test for water for making concrete in cases where water may be of doubtful quality.

5. Cement

Cement for mortar

Cement for use in mortar shall comply with SANS 50197-1 for common cements and SANS 50413-1 for masonry cements and shall be one of the following types:

Common cement: CEM I CEM II/ A – S, L, V or W and CEM II/B – S, L, V or W 42,5

Masonry cement: MC 12,5

In the HMB, the following cements are specified:

Common cements designated as CEM I 32,5 and 42,5 or CEM II/A – L, S, V, W 32,5 or CEM II B – S 42,5

Masonry cements designated as being MC 12,5

Cement for infill concrete and grout

Cement for use in infill concrete and grout shall be common cement complying with SANS 50197-1 and shall be one of the following types:

CEM I CEM II/A – S, L, V or W or CEM II/B – S, L, V or W 42,5

6. Lime

Lime for mortar shall comply with SANS 523. The lime shall be prepared according to the manufacturer's instructions.

The use of lime is optional but may be advisable with certain sands. Lime should not be used with masonry cement. Lime for mortar means hydrated lime, i.e. commercial bedding lime and not quicklime or agricultural lime. Research by the CSIR Division of Building Technology has shown that lime complying with class A2P of SANS 523 should be used in mortars. Lime gives best results when used with coarser sands lacking fines than with fine clayey sands.

7. Mortar plasticizers

Mortar plasticizers shall comply with BS 4887 and shall be used in the proportions and manner recommended by the manufacturer.

The use of mortar plasticizers is optional. Their effectiveness varies with the quality of the sand. The manufacturer's recommendations should be followed.

8. Pigments

Mineral pigments shall comply with BS 12878.



Pigments may be used to colour mortar. The dosage of pigment to achieve the specific colour required depends on the type of pigment used. The recommended limit on mineral oxide content is 7% of common cement content.

9.1 Wall ties (metal)

Metal wall ties for use in cavity walls shall be wire ties complying with SANS 28.

The type of wall tie shall be... (state type) made of...

Table 5.4 **Selection of wall ties**

	Type of tie	Cavity width, mm
Increasing strength  Increasing flexibility and sound insulation 	Vertical and flat twist	150 or less
	Double triangle	75 or less
	Butterfly	75 or less

(state material) and shall... (state with or without a plastic coating).

The materials used in the manufacture of wall ties are galvanised mild steel wire, galvanised mild steel strip, copper, copper-zinc alloy and austenitic stainless steel. The selection of the material for the ties will depend on the location of the structure and the resistance to corrosion of the ties required.

Wall ties perform the function of permitting the leaves of a wall to act as a complete unit in resisting compressive and flexural forces while permitting some differential longitudinal movement between the leaves.

Alternatively, other wall ties, for which there is no SANS standard, may be used, provided the manufacturer or his agent is able to submit evidence to show that the material is suitable for the intended purpose.

Guidelines on the selection of ties are given in Table 5.4.

9.2 Wall ties (non-metallic)

Non-metallic ties, when the central 75 mm portion of the tie is clamped between two jaws of a testing machine capable of displacing the ends relative to each other, without twist, tilt or rotation, shall be capable of resisting a tensile and compressive force of 0,6 and 0,7 kN respectively, when the tie ends have been displaced by an amount not exceeding 1,5 mm, with a 95% level of confidence. It is imperative that wall ties do not deflect significantly under load. The abovementioned performance test ensures that wall ties will have adequate stiffness. A 95% confidence level implies that there is only a 5% probability that a tie will not be able to resist the prescribed force. As a result, the minimum force which a tie must be capable of resisting must be determined from the following formula:

$$X = X_c - 1,65s$$

where

X = minimum force which tie must be capable of resisting

X_c = arithmetic mean of test sample (minimum of 6 ties)

s = standard deviation of test sample.

Polypropylene wall ties are permissible in the UK for double storey buildings with a fire requirement of less than twenty minutes. However, these ties are likely to char under hot conditions and also to exhibit creep under normal working conditions.

10. Masonry anchors

Metal masonry anchors used to secure shelf anchors shall have an anchor diameter of not less than 10 mm and be galvanised, and have a minimum safe working load of not less than 10,0 kN. In areas within 1,0 km of the coastline such anchors shall be of stainless steel.

11. Reinforcement

Reinforcing steel including bed reinforcement shall comply with SANS 920 and SANS 1024.

Brickforce

Brickforce shall comprise hard drawn wires comprising two main diameter wires of diameter not less than 2,8mm spaced a constant distance apart and 2,5mm diameter cross wires spaced at longitudinal intervals of 300mm in ladder type brickforce and at twice the distance between the longitudinal wires in truss type reinforcement. In areas within 1 km from the coastline or shoreline of large expanses of salt water and within 3 km of industries that discharge atmospheric pollutants which are corrosive (eg. Mpumalanga escarpment), brickforce shall be manufactured from pre-galvanised wire (class A galvanising in accordance with SANS 935). In tidal and splash zones, brickforce shall be made of stainless steel wire.

Rod reinforcement

Rod reinforcement shall comprise hard drawn wires having a proof stress of 485 MPa and a diameter of not less than 4,0mm or greater than 6,0mm. Rods shall be pre-straightened at the place of manufacture. In areas within 1 km from the coastline or shoreline of large expanses of salt water and within 3 km of industries that discharge atmospheric pollutants which are corrosive (eg. Mpumalanga escarpment), rod reinforcement shall be galvanised (class A galvanising in accordance with SANS 935 or SANS 763, as appropriate). In tidal and splash zones, rod reinforcement shall be made of stainless steel.



TYPES OF WALL TIES

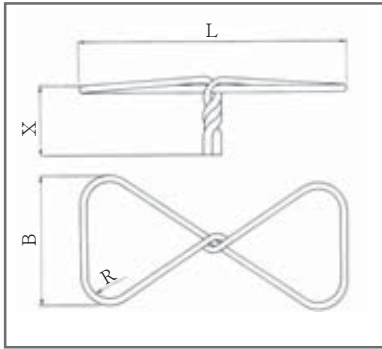


Figure 5.1 **Butterfly wall tie**

Material	Wire diameter	Dimensions, mm			
		L	B	R, min.	X
Mild steel (galvanized)	3,15 ± 0,1	150 ± 5 or 200 ± 5	75 ± 5 or 100 ± 5	13	25 ± 5
Copper					
Copper-zinc alloy	3,15 ± 0,1				
Stainless steel					

Note:

- In general butterfly ties are preferred for use in concrete block walls.

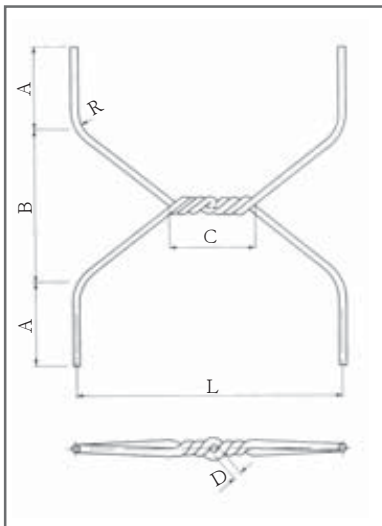


Figure 5.2 **Modified PWD wall tie**

Material	Wire diameter	Dimensions, mm					
		L	A	B	C	D	R, min
Mild steel (galvanized)	3,15 ± 0,1	150 ± 5 or 200 ± 5	50 ± 5	75 ± 5 or 100 ± 5	40 ± 5	8 ± 2	13
Copper							
Copper-zinc alloy	3,15 ± 0,1						
Stainless steel							

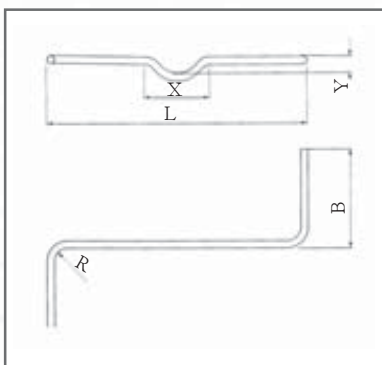


Figure 5.3 **Single wire wall tie**

Material	Wire diameter	Dimensions, mm				
		L	B	R, min	x	Y, min
Mild steel (galvanized)	4,5 ± 0,1	150 ± 5 or 200 ± 5	70 ± 5	8	22 ± 2	7 ± 2
Copper						
Copper-zinc alloy	4,5 ± 0,1					
Stainless steel						

Note:

- In the particular case of a non-cavity wall constructed in two stretcher bond leaves, with the vertical joint between the two leaves solidly filled with mortar, crimped wire ties may be used.

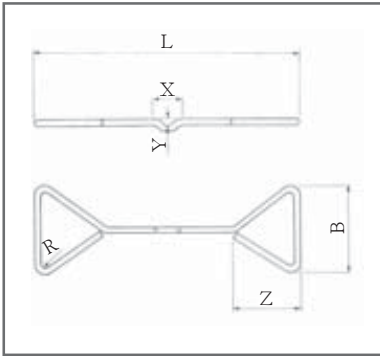


Figure 5.4 **Double triangle wall tie**

Material	Wire diameter	Dimensions, mm					
		L	B	R min	X	Y	Z
Mild steel (galvanized)	4,3 ± 0,1	150 ± 5 or 200 ± 5	65 ± 5	8	22 ± 2	7 ± 2	50 ± 5
Copper							
Copper-zinc alloy	4,3 ± 0,1						
Stainless steel							

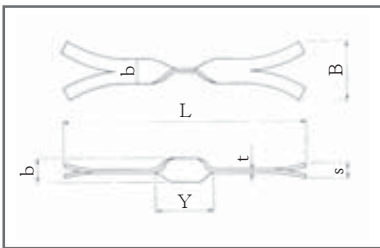


Figure 5.5 **Vertical twist wall tie**

Material	Dimensions, mm					
	L	b	B	S, min	t	Y, min
Mild steel (galvanized)	150 ± 5 or 150 ± 5 or 150 ± 5 or 150 ± 5	20 ± 1	40 ± 10	5	4 ± 1	50
Copper						
Copper-zinc alloy						
Stainless steel						

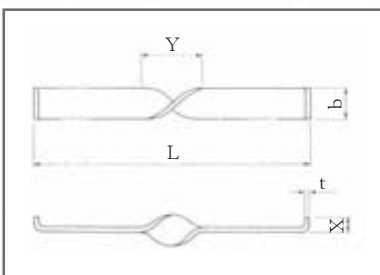


Figure 5.6 **Flat twisted wall tie**

Material	Dimensions, mm				
	L	b, min	t, min	X	Y max
Stainless steel	150 ± 5	13	1,5	7 ± 1	50



12. Metal lath strips

Metal lath strips shall have a minimum standard metal thickness of not less than 0,8mm, be of pre-galvanised mild steel and have openings having dimensions not exceeding 30 mm in the longitudinal direction and 10mm in the direction of its width. It shall exhibit no sign of cracking or fracture at the metal strands when bent through 90 degrees in either direction over a mandril of radius 6mm.

13. Expanded metal building products

Expanded metal building products shall comply with SANS 190 : Part 2.

14. Damp-proof courses

Damp-proof material shall comply with the relevant specification in SANS 248, SANS 298 or SANS 952.

The HBM recommends that horizontal and vertical damp-proof courses shall comprise embossed 0,375 mm polyolefin film complying with the requirements of SANS 952 for a type B sheeting.

15. Joint sealants

Joint sealants of polysulphide, polyurethane or silicone-rubber base are acceptable sealing compounds. They shall comply with the relevant requirements of SANS 110, SANS 1077 or SANS 1305.

STORAGE OF MATERIALS

1. Masonry units

Units shall be carefully unloaded and handled to prevent chipping and breakage. They shall be stacked on prepared level areas to ensure that the stack is stable. The top of each stack shall be kept covered during rainy weather, and the whole pack protected from staining or marking.

It is usually adequate to protect only the top of the stack from rain, as there is little penetration at the sides of stacks, except where driving rain is experienced. Where facework is being built, it is important to protect exposed faces from becoming stained as a result of other building activities. Face units must be offloaded and stacked with care to protect the faces and arrises; plaster bricks may be tipped.

Ensure that the supply of units is of a consistent, even colour range, from batch to batch and within batches. Distribute face units of varying colour evenly throughout the work so that no patches appear in the wall. Mix different packs and deliveries which may vary in colour to avoid horizontal stripes and raking back marks in the finished wall.

2. Cement

Cement stored on site shall be adequately protected against moisture and other factors that may cause it to deteriorate.

When the cement is supplied in paper bags, the bags shall be closely and neatly stacked to a height not exceeding 12 bags and arranged so that they can be used in the order in which they were delivered to the site.

Storage of cement in silos or similar containers shall be permitted provided that the cement drawn for use is measured by mass and not by volume.

Cement shall not be kept in storage for longer than 6 weeks without the specifier's permission.

3. Sands

Sands from different sources shall be stored separately. Contamination by foreign matter shall be avoided.

4. Coarse aggregate

Coarse aggregates from different sources shall be stored separately. Contamination by foreign matter shall be avoided.

5. Deteriorated material

Material that has deteriorated, or has been contaminated or does not comply with the specification shall not be used.

6. Reinforcement, metal ties and anchors

Reinforcement, metal ties and anchors shall be protected from contact with soil and before placing shall be free from loose mill scale and other coatings that will adversely affect bond.

NOTES ON THE PROPERTIES OF MORTAR FOR MASONRY

Important properties of mortar that impact on the quality of masonry work are workability, water retention, compressive strength, bond strength, ability to accommodate movement and rate of strength development. Workability is a property which describes how easily mortar can be spread over the masonry unit and affects the performance and the productivity of the artisan. Water retention is a measure of the resistance of mortar to loss of water from suction of a porous masonry unit. Good water retention properties are important to ensure that:

- water is prevented from bleeding out of the mortar;
- the mortar bed is prevented from stiffening too quickly and becoming unworkable before the unit can be placed in position; and

- sufficient water is retained in the mortar to ensure proper hydration of the cement.

Mortars with good water retention remain workable for a long time after been spread on bed joints. This assists with proper bedding of the units and later compaction of the joint by tooling.

Except for highly stressed structural masonry, the compressive strength of mortar is not a particularly important property. It has comparatively little influence on compressive strength of the wall (Compressive strength of mortar is measured by testing 100mm cubes of mortar. In practice the mortar bedding thickness is between 8 and 12mm. With mortar in this situation the triaxial shear regime results in a strength of 2 to 3 times that of an equivalent cube, i.e a class II mortar cube of 5 MPa compressive strength has a 10 to 15 MPa bedding mortar strength). Since the compressive strength of cubes is easier to measure than a thin slice of mortar which resembles the bed joint, it tends to be used as the control for mortar strength. Bond strength between mortar and masonry units is a more representative property of both the tensile and flexural strength of walls.

Bond strength is important in relation to the permeability of masonry. Rain water usually penetrates a wall through fine cracks between the masonry units and the mortar, and only rarely through either the masonry units or the mortar. The greater the strength of the bond between mortar and masonry, the greater is the resistance to leakage.

Bond depends largely on the balance between initial rate of absorption (suction) of the unit and the water retention properties of the mortar.

Mortars shrink on drying and the magnitude of drying shrinkage is directly related to the water requirement of the mortar sand.

However, in a masonry wall shrinkage movement occurring in mortar is restricted by the masonry units

and the compressive load on the units.

Concrete masonry units tend to expand with a gain in moisture and contract with loss of moisture. On the other hand some burnt clay bricks expand slowly after leaving the kiln when they come in contact with humidity in the air.

This expansion is not reversible even by drying the clay bricks and the movement, termed moisture expansion, continues for a number of years.

Cracks in masonry work is not only attributable to directly applied loads, but generally is caused by differential movement between various parts of a building as a result of thermal or moisture movement (i.e. environment) or foundation movement.

The objective in designing a mortar mix is to determine an economical and practical combination of readily available materials to produce mortar that will satisfy the performance requirements for particular conditions of use.

Performance requirements are:

- In plastic state: adequate plasticity (cohesiveness), workability, water retention (in relation to initial rate of absorption of masonry units being used) and setting time
- In hardened state: adequate bond and compressive strength, low drying shrinkage and durability.

Four types of building mortar are detailed in SANS specifications, namely mortar manufactured with:

- common cement and sand
- common cement, lime and sand
- common cement, sand and mortar plasticizer
- masonry cement and sand

The approximate limiting proportions for mortar are detailed in Table 5.5.

A mortar plasticizer should not be used with masonry cement (a plasticizer may be used with common

Table 5.5 **Proportions for mortar** (SANS 10164-1 - Table C. 1)

Mortar class	Common cement, kg	Lime, <i>l</i>	Sand (measured loose and damp), <i>l</i> max	Masonry cement, kg, or Common cement with mortar plasticizer, kg	Sand <i>l</i> , max
I	50	0 - 10	130	50	100
II	50	0 - 40	200	50	170
III	50	0 - 80	300	50	200



Table 5.6 **Compressive strength requirements for mortar** (SANS 10164-1: Table 1)

Mortar class	Compressive strength, at 28 d, MPa, min	
	Preliminary (laboratory) tests	Work tests
I	14,5	10
II	7	5
III	2	1,5

cement only with the approval of the specifier). The addition of lime to the mix is optional.

MORTAR QUALITY

1. General

The type of sand and cement, and their sources of supply, shall remain unaltered for the duration of the contract unless the prior written agreement of the specifier is given.

2. Mortar mix proportions

The contractor shall provide on the site mortar made with materials specified in the proportions given in Table 5.5, the use of mortar being detailed below.

The compressive strength requirements of the standard classes of mortar are set out in SANS 10164 – 1, Table 1 (see Table 5.6).

Mix proportions of mortars are invariably given in a traditional prescriptive form, as shown in Table 5.5, which is an extract from SANS 10164 – 1, SANS 10145 & SANS 10249.

However, under conditions where durability is important, or where mortar will be subjected to high stresses (as in loadbearing masonry) a “performance” type specification should be used.

Reference should be made to BS 4551, which was issued in response to the need for standard methods of testing mortars for composition and consistency suitable for brick and block laying. “Recent developments, including the use of masonry cements and mortar plasticizers, have created a demand for methods of testing important properties of mortar so that the quality of these newer materials can be standardised and the effectiveness of different materials can be compared.” (BS 4551).

In general terms the purposes for which the various classes of mortar may be used are as follows:

Class I: Highly stressed masonry incorporating high strength masonry units such as might be used in multistorey loadbearing buildings.

Class II: Normal loadbearing applications, as well as parapets, balustrades, retaining structures, free-standing and garden walls and other walls potentially exposed to severe damp conditions. Only mortar class II is permitted in the HBM.

Class III: Lightly stressed (eg. single storey) walls where exposure to dampness is not severe.

Durability of mortar is not normally a factor in the service performance of masonry except where there is a severe aggressive environment.

High cement content mortars are best to resist attack. Admixtures or sand containing chlorides should not be used when reinforcement is embedded in the mortar.

If sand is batched by volume a standard wheelbarrow for concrete (SANS 795: Type 2 wheelbarrow), having a capacity of between 60 and 65ℓ, may be used for batching, i.e. 200ℓ batched with, say, three wheelbarrow loads.

3. Use of mortar

The type of mortar to be used in... shall be class... and type... and as detailed on the drawings.

In the HBM, only class II mortar is specified for housing.

4. Batching, mixing, retempering and transportation

Materials for mortar shall be batched by volume or mass that will ensure the correct amount of materials are used. Mortar shall be mixed using a procedure for the minimum period of time that will ensure all ingredients are evenly distributed throughout the mixture. Mortar may be retempered prior to initial set so as to restore workability by adding water and thoroughly remixing such that no segregation of materials occurs. Mortar in which initial set has occurred shall not be used.

Ready-mixed mortar shall be mixed and delivered to site with adequate workability and without segregation.

Ready-mixed mortar shall not be used after the expiry period recommended by the manufacturer.

Where pigments and similar admixtures are permitted, they shall be added to the mortar in accordance with the manufacturer’s instructions.

The ingredients for mortar may be measured in gauge boxes or other calibrated measures and be mixed on a

boarded platform, the ingredients being turned over twice in the dry state and twice while water is added through a rose. Alternatively, mixing may be by an approved mechanical batch type mixer. In the case of cement-lime mortar, it is preferable to mix the sand and lime before adding the cement. Cement and cement-lime mortars shall be used within two hours of mixing (in cold weather and one hour in hot weather). Any mortar not used within two hours shall be discarded and not retempered.

The sand and lime for cement-lime mortars, with water added, may, with the approval of the specifier, be mixed in recommended batches and stored, provided it is not allowed to dry out.

Powdered plasticizers should, where possible, be dissolved in part of the mixing water before use. The amount of water to be used in the mortar should be decided by the layer.

Ready-mixed mortars containing retarders and pigmented mortars should only be used under the direction of a competent person.

The amount of pigment (mineral oxide) per mass of cement shall not exceed 7%. Pigmented mortar should not be retempered as it results in a colour change of the mortar.

5. Infill concrete quality

The concrete infill shall be... (prescribed or designed) mix to SANS 1200 G, of strength grade... (25, 30, 35 etc) with a slump not exceeding... mm

or

The concrete infill shall be 50kg common cement: 0 to 10ℓ lime: 100ℓ fine aggregate: 70ℓ coarse aggregate (9,5 mm maximum size) and shall have a slump not exceeding... mm

Infill concrete or grout shall comply with the requirements for a prescribed mix or a strength infill concrete or grout, whichever is specified. The minimum grade of concrete for reinforced masonry is 25, and for prestressed masonry in which the infill acts structurally, 40. The alternative specified mix of 1:0 – 10ℓ:100ℓ:70ℓ (cement: lime: sand: stone) is approximately equivalent to a grade 25 prescribed mix. Slump should be specified between 75 and 175 mm as appropriate to the size and configuration of the

space to be filled. The maximum size of aggregate shall not exceed 9,5mm.

The words "infill concrete" and "grout" are referred to in SANS standards. In USA the terminology is "coarse" and "fine" grouts. Local interpretation is that "grout" contains no coarse aggregate and "infill concrete" is a mixture of cement, fine and coarse aggregate. In unreinforced cores, cavities or pockets grade 10 or higher may be used.

LAYING PRACTICE

For detailing of concrete masonry for single leaf and cavity walls for various thicknesses of wall covering foundations, building in of window and door frames, sills, lintels, reinforcement, services, construction of corners, supporting of suspended floors and roofs, intersection of walls etc., reference should be made to the three CMA publications on "Detailing of concrete masonry".

1. Setting out

All specified dimensions and angles shall be laid down or set out to an order of accuracy appropriate to the type of building and its importance.

Reference should be made to SANS 10155 for permissible accuracy in building. Although this clause covers the accuracy of setting out it should be borne in mind that setting out should be such as to reduce the cutting of masonry units to a minimum.

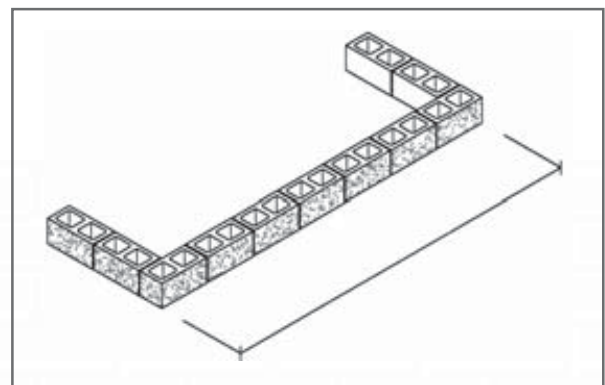


Figure 5.7 Units laid dry to check modular spacing

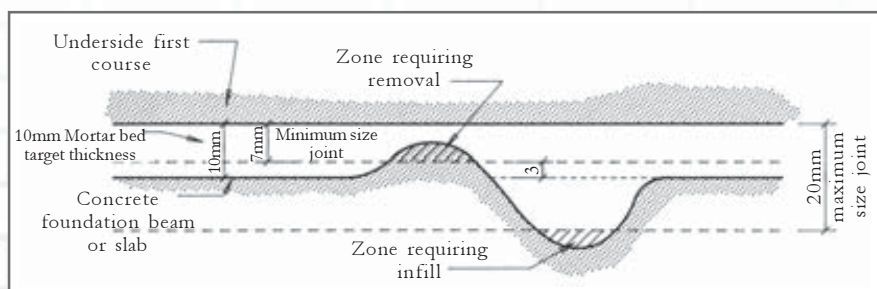


Figure 5.8 Tolerances of surfaces of foundations, beams or slabs supporting structural masonry



The first course should be laid with great care because inaccuracies in level, plumbness and alignment will be magnified in successive courses. The line of the walls and the position of corners and openings should be accurately established. The wall should be set out by first laying units without mortar as shown in Figure 5.7. Layout dimensions should be multiples of the basic module dimension of 100 mm. This will ensure units being laid in their final positions with ease.

Tolerances of surfaces of foundations, beams or slabs supporting masonry are shown in Figure 5.8.

Where reinforced structural masonry is specified then the following clause should be obligatory:

The position of vertical reinforcement starter bars and the setting out of inspection and clean out openings and service conduits/pipes/ducts shall be selected prior to laying the first course of masonry in order to fit in with the specified bond pattern.

2. Wetting of masonry units

Units **shall not** be wetted prior to laying in a wall. Whenever work stops the top of the wall shall be covered to prevent moisture entering the unfinished wall.

The consistency of the mortar should be adjusted to suit the degree of suction of the units instead of the units being wetted to suit the mortar.

When wet concrete masonry units dry out in a wall they shrink and may cause the mortar in the joints to crack.

Work should stop during heavy rain unless the work is adequately protected.

3. Laying of masonry units

(a) Bedding of masonry

Units shall be laid on a bed of mortar of proportions as specified in "Use of mortar" and as detailed on the drawings, using either shell bedding (applicable to hollow units only) or full bedding (as directed by the specifier). All joints are to be nominally 10mm thick.

In shell bedding only the inner and outer shells of hollow units shall be covered with mortar. In full bedding, the entire bedding area shall be covered.

Full bedding shall always be used with solid units.

Hollow units shall be laid with the thicker shell-face uppermost.

Solid units having frogs shall be laid with the frog or the larger frog uppermost and frogs should be filled with mortar as the work proceeds.

Vertical joints between solid units as in collarjointed

walls shall be filled with mortar as the work proceeds, and those between hollow units shall be made as for shell bedding, except where open joints are left, either for control joints or for drainage purposes. In reinforced masonry beams vertical joints shall be filled.

Masonry shall not be laid when the ambient temperature is less than 5 °C. Wet or frozen units shall not be laid. In hot (ambient temperature above 32 °C) and/or windy and dry weather conditions, the length of mortar runs ahead of units, which are to be laid, shall be adjusted to ensure that the mortar remains plastic when the units are laid.

Each unit shall be laid and adjusted to its final position while the mortar is still plastic.

Where hollow units are used in exterior walls, shell bedding reduces the penetration of rain to the inner surface. However, shell bedding results in a reduction in the strength of the wall.

Each unit should be adjusted to its final position in the wall while the mortar is still plastic and any unit which is disturbed after the mortar has stiffened should be removed and relaid with fresh mortar. Mortar should not be spread so far ahead of actual laying that it stiffens and loses its plasticity, as this results in poor bond.

Immediately after the unit is laid, excess mortar should be struck off the external face of the work and off the internal faces of leaves of cavity walls. Care should be taken to ensure that mortar is not scraped into the exposed face of the unit. Any accidental smears should be lightly brushed off the face after initial setting of the mortar has taken place.

Hollow units on a concrete foundation may be laid on a full bed of mortar; subsequent bedding may be in face shell mortar bedding.

Solid units should be laid on a full bed of mortar and all cross joints should be filled with mortar.

b) Bonding

Unless otherwise stated, units shall be laid in stretcher bond. The horizontal distance between vertical joints in adjacent courses shall be at least one quarter of the length of the units. Where the thickness of a solid wall consists of more than one unit, and in cavity wall construction, wall ties shall be placed in the horizontal joints at intervals of not more than 1m in the horizontal direction and not more than 450mm in the vertical direction, except that within 150mm of the sides of any opening, this distance shall be decreased to not more than 300mm. Ties shall be staggered in alternate

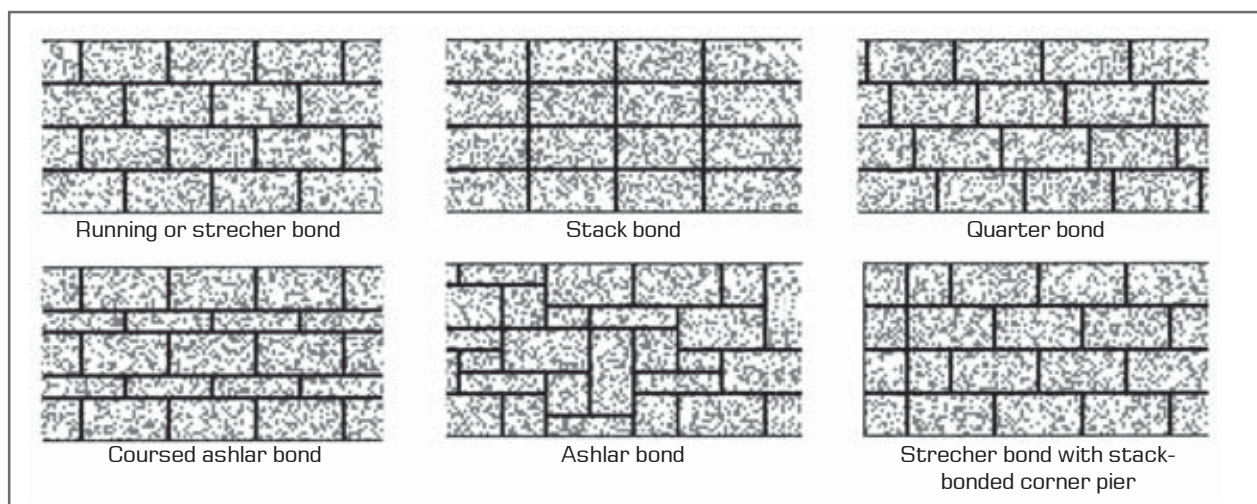


Figure 5.9 **Types of bonding patterns with block and/or brick**

courses and be laid falling to the outer leaf.

Masonry units of dissimilar materials shall not be built into the same wall unless separated by a horizontal damp-proof course or a vertical control joint.

Blocks should normally be laid to stretcher bond, i.e. with staggered vertical joints. Stretcher or running bond, with blocks in each course overlapping those in the course below by half a block length, yield the best results in terms of wall strength.

Various bonding patterns are shown in Figure 5.9. For all normal construction the stretcher bond pattern should be used. For decorative and non-loadbearing blockwork the other bonding patterns may be used but note that the horizontal joints should be reinforced.

Brick walls should generally be bonded in the traditional manner. When building a cavity wall, it is essential that the cavity should not be bridged by any material which could transmit water from the external to the internal leaf.

Accumulations of mortar droppings in the cavity should be prevented by using laths, drawholes, fine sand and/or thick rope. Any mortar which does fall on wall ties or cavity trays should be removed and the bottom of the cavity should be cleared daily through temporary openings.

Both leaves of a cavity wall should be raised at the same time. The difference between the heights of the two leaves should be:

- i approximately the same as the vertical spacing of consecutive rows of ties, for vertical twist and flat twisted ties;
- ii not greater than five block courses, for double triangle and butterfly ties.

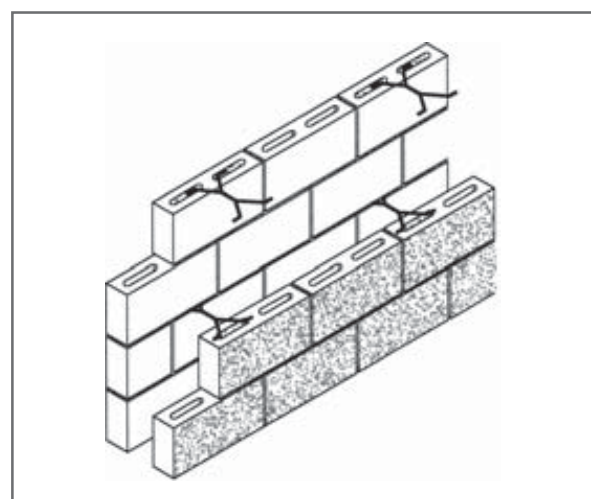


Figure 5.10 **The positioning of wire ties in a cavity**

The wall ties should be placed in the bed joint of the appropriate course in the higher leaf as it is built and not pushed in after the units are bedded. Wall ties should be bedded to a minimum depth of 50 mm in each leaf and have a slight fall to the outer leaf.

See Figure 5.10 for positioning of wire ties in a cavity wall.

c) Bonding with a cross wall

Cross walls shall be masonry bonded or be built up flush against the existing wall with a control joint where they meet. If the cross wall is a structural wall of hollow block, the two walls shall be tied together with metal anchors or wire, starting at the first course above the damp-proof course and spaced at a vertical distance not exceeding 900mm. The anchors shall be at least 3mm thick, at least 30mm wide and approximately 700mm long, with a 50mm right angle bend at each end, and these bends shall be embedded in mortar or concrete placed in the cores. If the cross

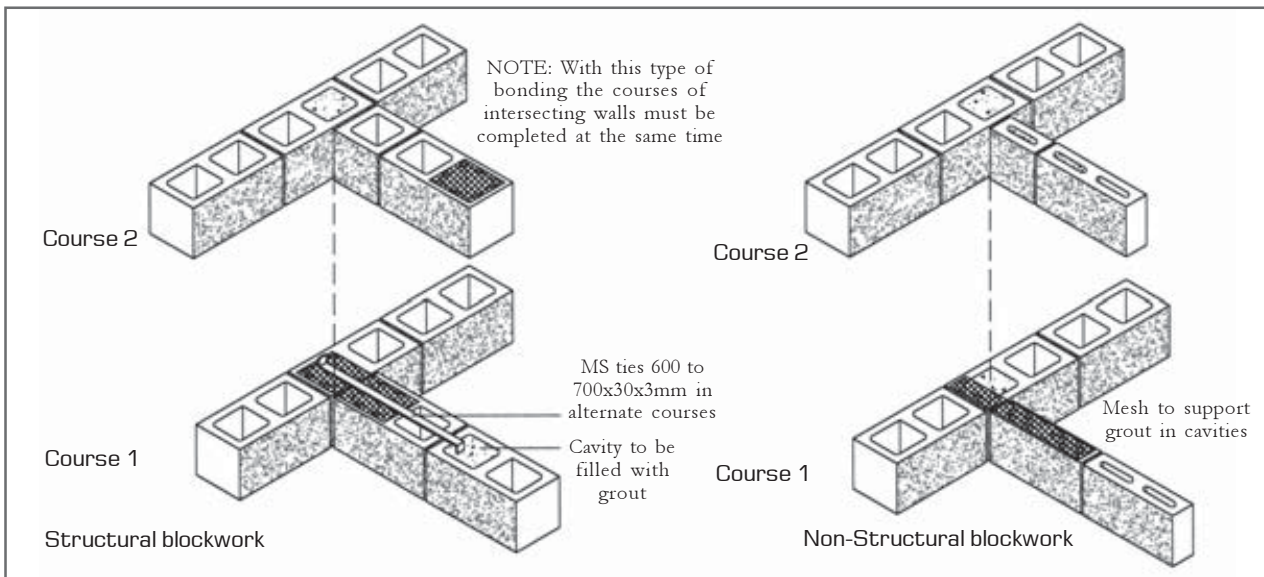


Figure 5.11 **Bonding of intersecting walls**

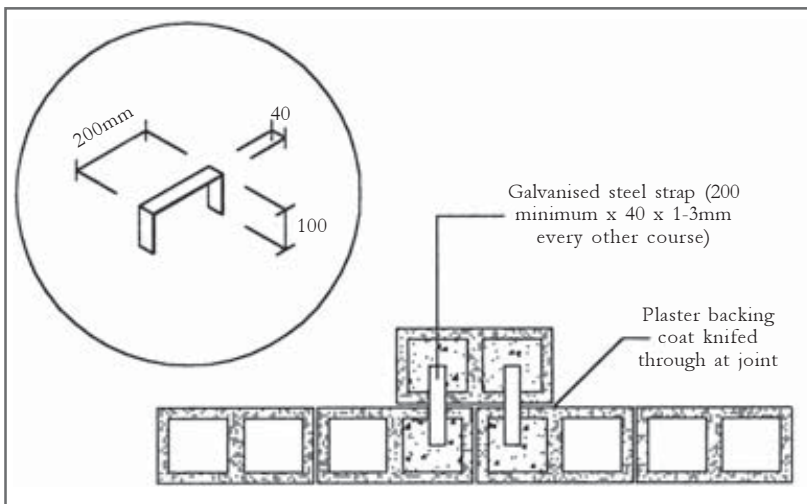


Figure 5.12 **Bonding a pier**

if the wall is not structural, the two walls shall be tied together with strips of mesh (metal lath strips) having a minimum thickness of 0,8mm placed in every second horizontal joint and stretching across the vertical joint between the walls. The strips shall be at least 450mm long and of sufficient width to permit a mortar cover of at least 20mm over the edges of the strips.

Details of bonding wall intersections and piers are shown in Figures 5.11 and 5.12.

d) Alignment and perpend

All masonry shall be built true and plumb. The courses shall be aligned and care taken to keep the perpend in line.

e) Raking back of masonry

Corners and other advanced work shall be raked back and not raised above the general level of the remaining

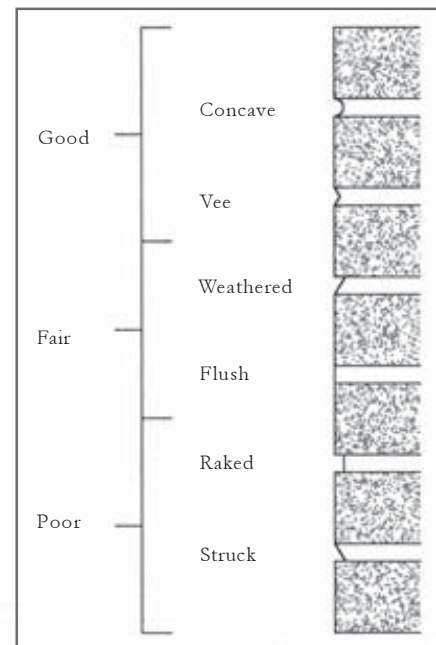


Figure 5.13 **Joint profiles**

blockwork by more than one metre at one lift.

The rate of new construction shall be limited so as to eliminate any possibility of joint deformation, slumping or instability which may reduce bond strength. Tothing of masonry shall not be permitted.

f) Corners

All corners shall be accurately constructed and the height of courses shall be checked by a gauge rod as the work rises. The bonding of corners shall preserve the symmetry in the appearance of the work.

g) Reveals

The depth of reveals and rebates shall conform as far as practicable to the unit size, in order to maintain masonry strength and to avoid cutting units.

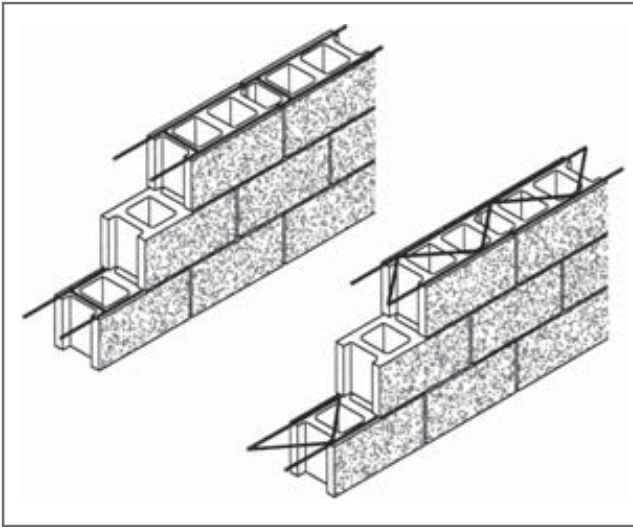


Figure 5.14 **Joint reinforcement comes in many shapes for various purposes**

h) Jointing

As the work proceeds, mortar joints on the face of the wall shall be compacted to give a... joint (specifier to specify shape of joint). Tooling shall be delayed until the mortar has stiffened slightly.

Figure 5.13 shows some of the types of joint finish commonly used in masonry. The type of finish selected depends on the use of the wall and on the appearance desired. A flush joint is made by cutting off the excess mortar with a trowel after the unit is laid. A raked joint is made by raking out the mortar to a uniform depth after the unit has been laid. Both these joints have an inherent disadvantage in that the mortar is not compacted or pressed into place; this facilitates moisture penetration. Raked joints also reduce strength and tend to form water traps which may cause water penetration and efflorescence.

For these reasons, the concave or V joint is preferred for exterior work. Such joints are formed by tooling with a convex or a V-shaped jointer or with the point of a trowel.

Joints should be tooled when the mortar has become thumbprint hard. The jointing tool should be slightly larger than the thickness of the mortar joint so that complete contact can be made along the edges of the units. Delayed tooling of the joints improves the impermeability of the mortar.

i) Reinforcement

Reinforcement for... (location) shall be... (type, size) complying with SANS 920.

Bed joint reinforcement for... (location) shall be... (type, size) complying with...

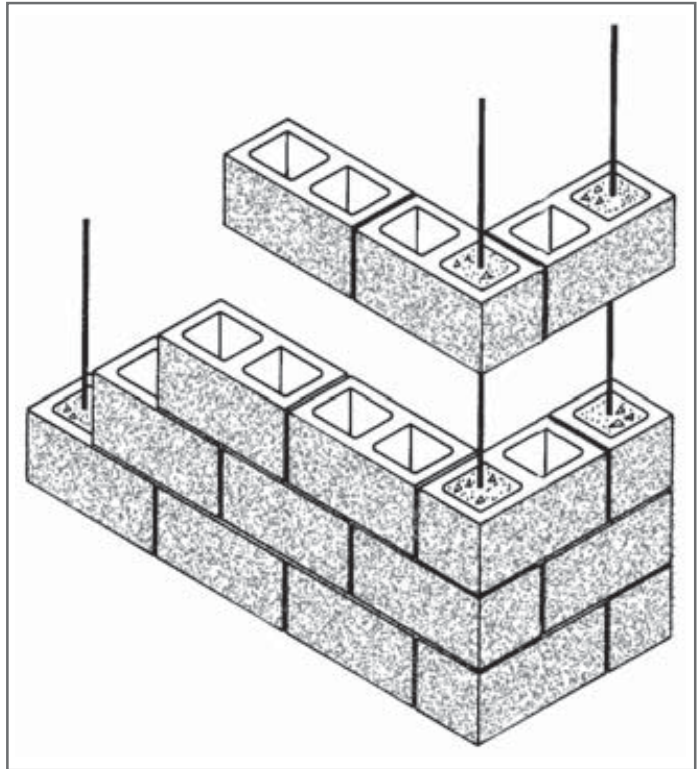


Figure 5.15 **Reinforced corner construction**

For type indicate type of steel (i.e. high yield, mild); for size indicate length and diameter (reference to drawings/schedules is often required).

In the case of proprietary reinforcement, it may be necessary to indicate width, manufacturer's reference number, manufacturer and so on. (See Figure 5.14).

Reinforcement in a bed joint should not exceed 6mm in diameter and should be hard drawn (preferably) pre-straightened deformed steel wire. Mild steel has the disadvantage of being difficult to maintain in a straight position and because of its lower yield stress (250 MPa) it is required in larger quantities.

Brickforce can provide tension reinforcement in masonry work to control cracking. Because of the small wire diameter however its usefulness in reinforced masonry work is limited.

While bed joint reinforcement has been the traditional way of reinforcing walls, recent developments include the reinforcing of hollow blocks, both horizontally and vertically, or the filling with concrete of the cavities in cavity walls as a means to resist movement, to control cracking and to strengthen masonry.

In reinforced hollow blockwork, the cores of the blocks are filled with infill concrete (sand, stone, cement and water) or grout (sand, cement and water). (See Figures 5.15 and 5.16.)

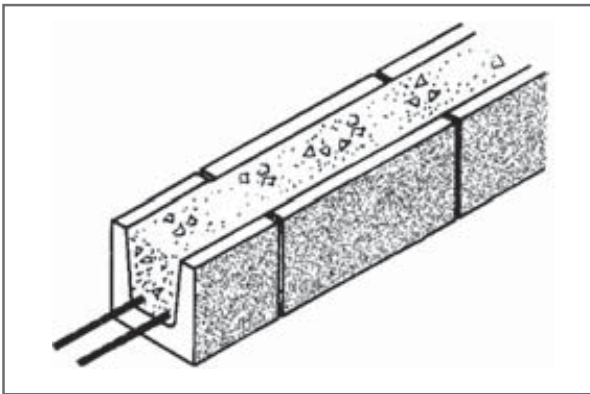


Figure 5.16 **Typical concrete masonry bond beam or lintel**

Grouted cavity construction consists essentially of two parallel leaves of units built as a cavity at least 50 mm wide, the two leaves tied together with wall ties, with reinforcement placed in the cavity which is filled with high slump infill concrete or grout (see Figure 5.17).

If special shaped blocks are not available standard hollow blocks may be cut to suit requirements for the placement of the reinforcement (See Figure 5.18).

Horizontal courses that support roofs or floors and/or as detailed on the drawings, shall be reinforced. For bed-joint reinforcement strips of expanded metal lath or two longitudinal wires of at least 4mm diameter, with cross wires at regular intervals, may be used as reinforcement. The width of the strips shall be such that there is a finished cover of at least 20mm of mortar over the steel.

Care should be taken to use sufficient mortar in the horizontal joints in which reinforcement is bedded to ensure that the whole surface of the steel is in contact with mortar so that there will be adequate bond and protection against corrosion. When horizontal reinforcement is placed in the joint, the mortar should first be spread, the reinforcement placed on the mortar and then tapped into position with a trowel, until it is fully covered.

Vertical and horizontal bar reinforcement in concrete masonry cores, columns, beams and walls shall be properly positioned and secured against displacement. The cavities or cores containing such reinforcement shall be completely and solidly filled with concrete of mix proportions.....

Splices shall be made only at such points and in such a manner that the structural strength is not impaired. Minimum clear distance between vertical bars and masonry units shall be 12mm. Where the pour height exceeds 1000mm, clean-out openings shall be provided

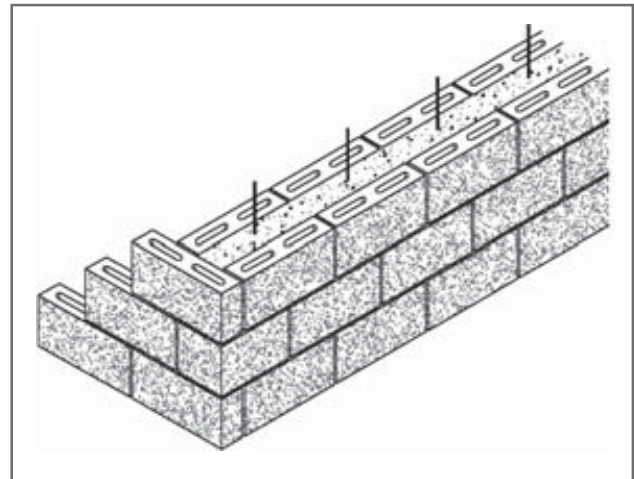


Figure 5.17 **Grouted cavity construction**

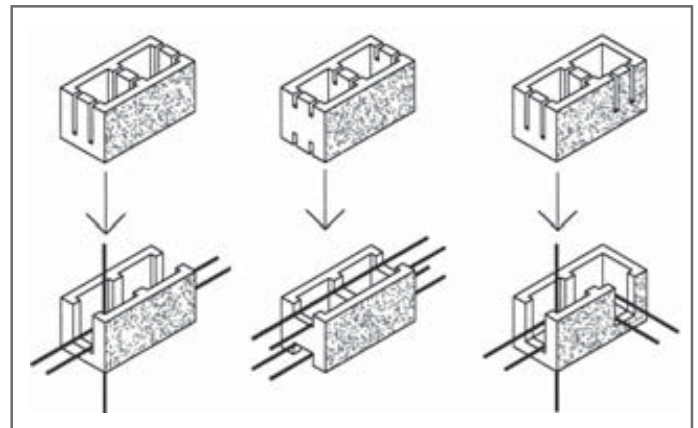


Figure 5.18 **Cut blocks to suit reinforcing**

at the base of the vertical cores to be filled, and mortar droppings on the base shall be removed through these openings prior to fixing the reinforcement.

To reduce cracking in walls of hollow blocks, vertical reinforcement may be placed in the core of the block which adjoins a door or window or other opening. The reinforcement is usually a single steel bar of 6mm diameter or larger and should be embedded in mortar or concrete in the block core. Either a mortar or concrete mix may be used (see clause 8 page 63 for details).

j) Reinforced hollow blockwork

- i) Low lift construction. In low lift reinforced hollow blockwork construction, the concrete infill in cores shall be placed as part of the process of laying the blocks, at maximum vertical intervals of 1000mm. Each layer of infill concrete shall be placed using receptacles with spouts to avoid splashing and staining of face work. The concrete infill shall be compacted immediately after pouring. Wall integrity shall not be disrupted during pouring.
- ii) High lift construction. In high lift reinforced hollow blockwork construction, the walls shall be built to

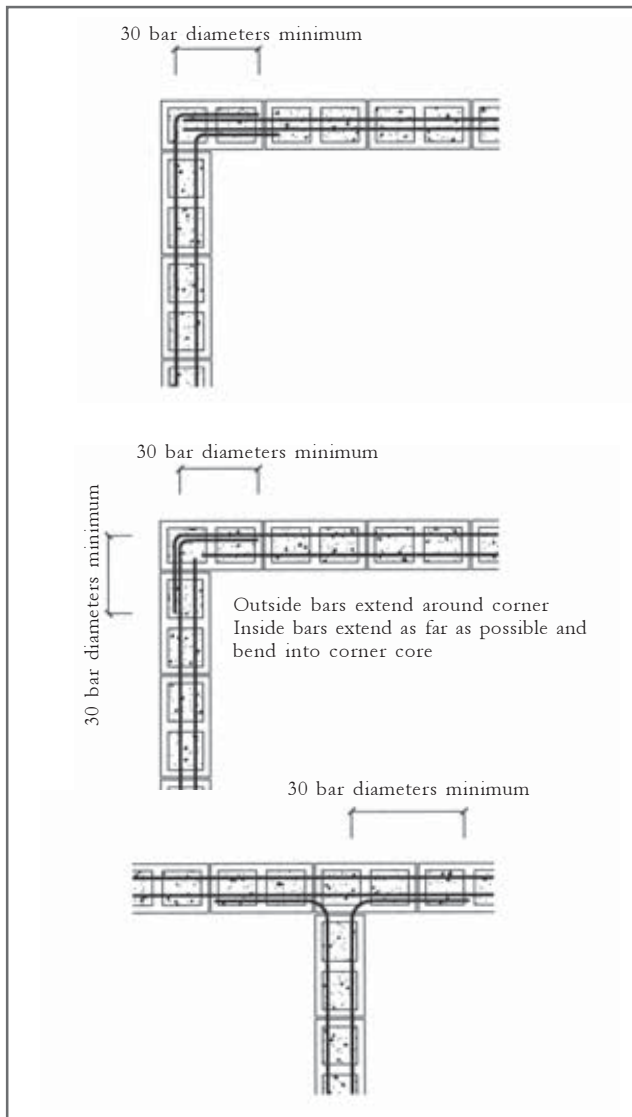


Figure 5.19 **Typical detail of reinforcing steel for bond beams at corners of intersection walls**

a maximum height of 3m. Clean-out holes having a minimum size of 100 x 100mm shall be provided at the bottom of every core to be filled. Cores shall be free of debris before concreting. Cores shall be fully filled and compacted in lifts not exceeding 500mm in height. After initial settlement but before initial set in each layer occurs concrete shall be recompact. In the filling of cores care should be taken to ensure that the pressure exerted by the infilling concrete does not disrupt the wall.

k) Grouted cavity construction

i) Low lift construction

In low lift construction, the concrete infill shall be placed as part of the process of laying the units at maximum vertical intervals of 500mm. Each layer of concrete or mortar shall be placed to within

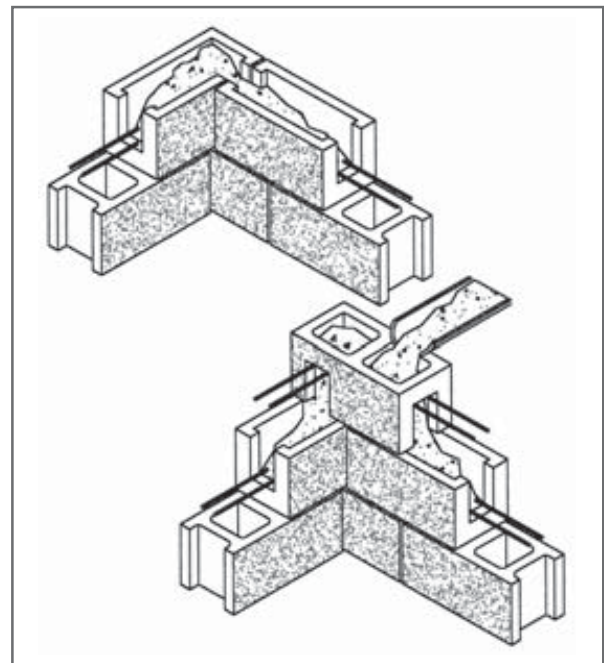


Figure 5.20 **Typical details of intersection of bond beams**

50mm of the top level of the last course laid and shall be placed using receptacles with guards to avoid splashing and staining face work. The concrete infill shall be compacted immediately after pouring. Care shall be taken to avoid disruption resulting from raising the walls too rapidly. Any wall disrupted in this way shall be taken down and rebuilt.

ii) High lift construction

In high lift construction, the walls shall be built to a maximum height of 3m. Clean-out holes 150 x 200 mm in size spaced at approximately 500mm between centres, shall be provided at the base of the wall. After cleaning of the cavity these holes shall be blocked off and the concrete infill placed not earlier than three days after building of the wall. The infill concrete shall be placed and compacted in... (one, two, etc.) lifts. After initial settlement of the infill concrete and before initial set occurs, the concrete in each layer shall be re-compact.

The number of lifts required will be dependent upon the overall height of the wall; in the case of walls up to 3m high, two lifts will generally be sufficient.

iii) Before grouting, the cavities to be filled shall be checked for cleanliness and projecting mortar shelves which shall be removed.

Some reinforcing details shown in figures 5.19 and 5.20.



l) Cleaning down

Acid may be used to clean down concrete masonry walls provided the treatment is tried on a small panel and found to be satisfactory.

In the laying of units, any mortar which exudes from the joint should be cut away and on no account should mortar be scraped on to the exposed face of the unit. Any smears on the face of the masonry from mortar droppings should be allowed to dry a little and then be lightly brushed off and washed.

To minimise cleaning of new masonry consider:

- protect the base of the wall from rain-splashed mud or mortar droppings;
- turn scaffold boards on edge at the end of each workday to prevent possible rain from splashing mortar or dirt onto the wall;
- cover the tops of unfinished walls to keep water from entering and causing efflorescence.

For cleaning concrete masonry let large mortar droppings harden slightly, then remove with trowel or putty knife or chisel.

Concrete surfaces may be rubbed with another piece of concrete masonry, then with a stiff fibre-bristle brush.

The National Concrete Masonry Association, USA, does not recommend any other cleaning methods. Because the mortar and masonry unit usually are close in colour, this dry, abrasive rubbing usually is sufficient to remove stains.

m) Removal of mortar droppings

Mortar droppings which fall on wall ties in a cavity wall shall be removed and temporary openings shall be provided to permit their removal from the bottom of the cavity.

4. Weepholes

Where it is required to drain away moisture in cavity walls or where detailed on the drawings, weepholes shall be located in the first course above any damp-proof

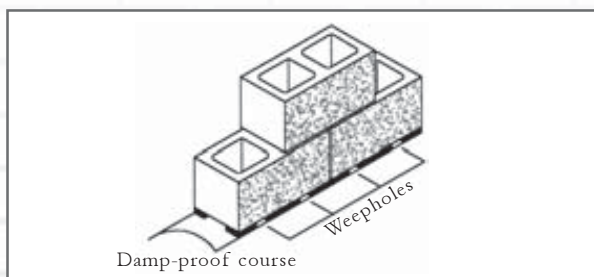


Figure 5.21 **Position of weepholes above dpc for hollow blockwork**

course membrane in positions specified. In cavity construction weep-holes shall be approximately 50mm high and formed in perp end joints. In hollow masonry walls the weepholes shall be of the same thickness as the bedding course thickness, approximately 30mm wide and located in the bedding course beneath the hollow masonry unit cores.

In Chapter 4 the position of weepholes as recommended in HBM is shown. For hollow block-work the weepholes should be located in the mortar bedding (see Figure 5.21).

5. Damp-proof courses

Damp-proof courses shall be provided at positions shown on the drawings.

The course on which a damp-proof course is to be laid shall be flushed up with mortar to form an even bed free from projections liable to puncture or damage the damp-proof course.

Damp-proof courses shall be positioned to fully cover the leaf thickness. All horizontal damp-proof courses shall protrude 10 mm from the exterior face of the wall and be turned downwards if possible.

Where a damp-proof membrane is over the full thickness of a hollow block wall not less than 140mm thick, the membrane may be pierced at regular intervals over the centre of each cavity in the blocks forming the wall. The membrane shall be depressed towards the centre. In cavity walls the vertical damp-proof courses shall be of adequate width and be fixed to slope down from the inner to the outer leaf of the wall.

SANS 10021 should be referred to for more detailed information on damp-proof courses.

The choice of a damp-proof course should reflect the functional needs of a given situation. To ensure water tightness, all junctions, steps and stop-ends should be carefully detailed, preferably by isometric sketches. Complicated junctions should be prefabricated.

Under window sills exposed to the weather, the damp-proof course in two-leaf walls shall be tucked under the window frame and stepped down one course to project 10mm beyond the outer masonry leaf.

Changes in direction of dpc's whether horizontal or vertical and the junction between horizontal and vertical dpc's may, if not properly designed or considered, direct water into the building.

6. Anchoring of roofs

The roof truss, rafter or beam shall be anchored to the wall with a galvanised steel strap or wire to extend into

the wall to a depth of at least 300mm in the case of a heavy roof (concrete or clay tiles or slate), or at least 600mm in the case of a sheeted roof, except that where the depth of the masonry is less than 300mm or 600mm, respectively, such strap or wire shall extend as far as possible into the wall.

The type of anchors to be used for light or heavy roofs, various roof slopes and roof truss/beam spacing are given in Chapter 4.

7. Flashing

Flashing material shall be used over openings or to cover an intersection or joint where water would otherwise penetrate to the interior of the building. Flashing or capping shall be provided to the tops of all parapets.

The material to be used should be sufficiently malleable to permit dressing into shape, but sufficiently stiff to maintain its shape and to resist lifting by the wind. Flashing should preferably be built in as work proceeds to avoid any damage to dpc's. It should adequately cover the joint it is intended to protect.

8. Masonry over and around openings

All masonry built over openings shall be adequately supported for not less than 7 days.

Where hollow blocks are used, the cores adjacent to the openings shall be filled with concrete (50 kg common cement to 150ℓ sand to 140ℓ stone) or mortar (class II).

Lintels over openings shall bear on the full thickness of the wall with a bearing length, at each end, of at least 190mm. Lintels may be of precast reinforced or prestressed concrete, or may be formed in situ with special lintel blocks filled with concrete and reinforced near the base with high tensile or mild steel rods.

Masonry in cavity walls and collar jointed walls around openings shall be reinforced with wall ties positioned not more than 150 mm from the opening and at a spacing not exceeding 300mm.

Figure 5.22 shows position of wall ties around openings.

Except over single doorways in non-loadbearing partition walls, a suitably designed lintel must be provided over all door, window and other openings. For the design of reinforced masonry lintels reference should be made to HBM Part 3 and CMA publications Lintels design guide and Lintels technical note.

The core in a hollow block adjacent to an opening shall be filled with concrete grade 10 or mortar and

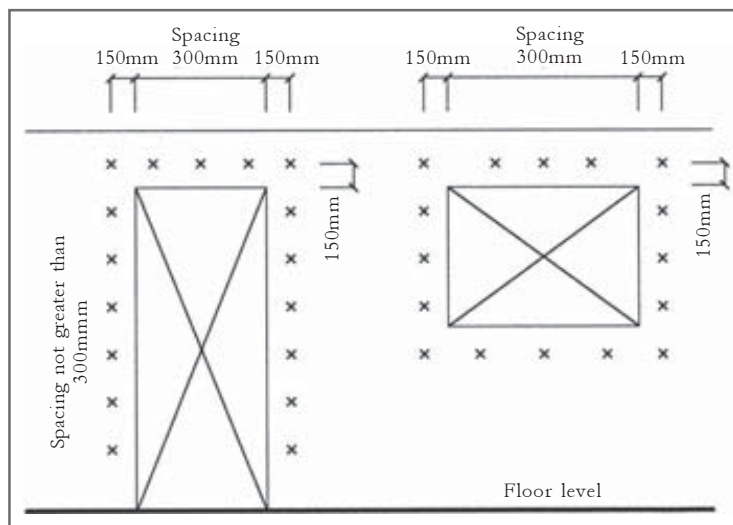


Figure 5.22 Positioning of wall ties around openings in cavity and collar jointed walls

reinforced with a single 6 mm bar extending 400 mm past the opening.

9. Bearing plates on blocks

Bearing plates on blocks shall be bedded in mortar similar to that used for the masonry and shall be set level.

Where a concentrated load occurs in a walls, eg. at a lintel or beam bearing, local bearing stresses should be checked out, and where necessary suitable bearing plates, spreader beams or pad-stones should be provided.

10. Control joints

Control joints shall be provided at positions indicated on the drawing and shall be constructed as shown. Care should be taken to ensure that the gap is free from debris. Filler materials shall be... (if specified)

If joints are to be sealed refer to clause 12: Joint infilling and sealing. The primary object of control joints is to divide the wall into separate panels in such a way that stresses along its length produced by differential movement and changes in volume of building units are relieved.

The design and positioning of control joints should accommodate movements but should not impair the stability of the wall or any of its functions, i.e. impermeability, sound insulation and fire resistance.

Where necessary, dowels, angles or channels strong enough to provide lateral stability should be incorporated. The dowels, which are usually metal rod or flat strips, should be anchored in the masonry in such a way that longitudinal movement is not restrained. Angles or channels fixed to one side of the

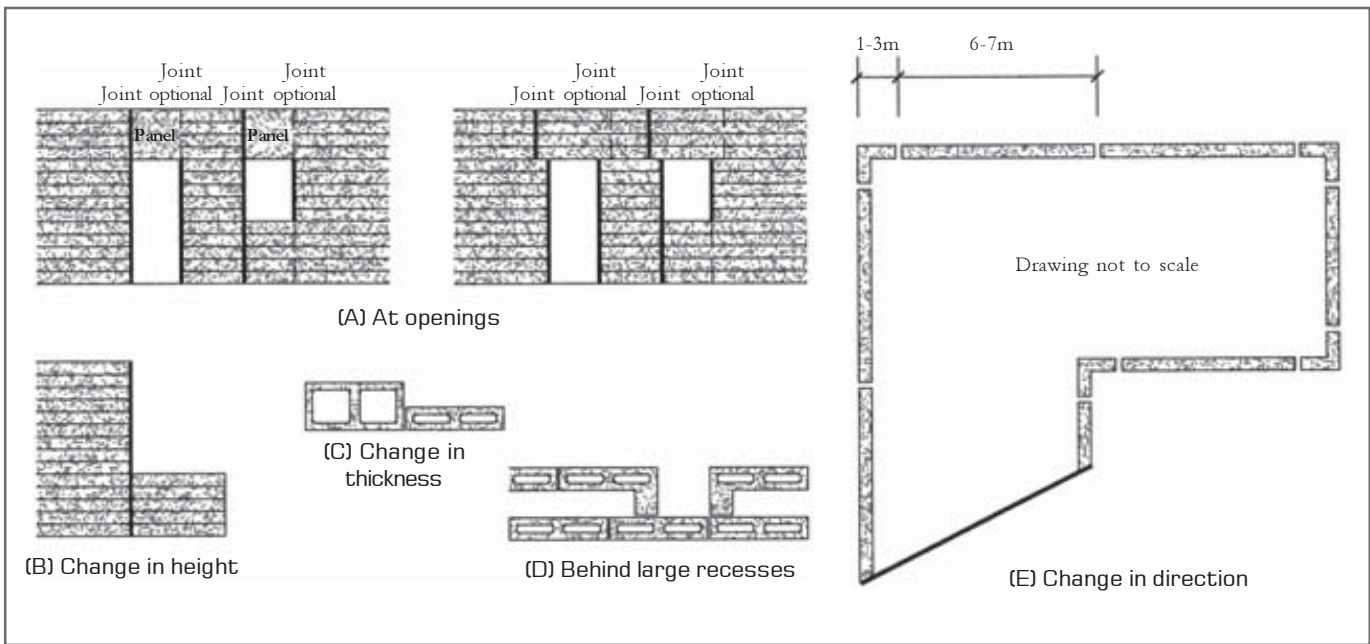


Figure 5.23 **Control joint positions**

control joint should project into grooves or recesses so as not to restrict longitudinal movement.

As a general rule, vertical joints to accommodate horizontal movement should be provided at intervals of 6m to 7m (see Figure 5.23) but since there are wide differences in the physical properties of concrete units and wall dimensions, and the loading to which the wall will be subjected, other joint spacings may be acceptable. SANS 10145 permits joint spacing up to 9m for unreinforced masonry ("subject to the length of wall between control joints not exceeding twice the height of the wall") and up to 18,5 m where vertical spacing of horizontal reinforcement is 200mm or less.

Control joints will not normally be required in interior walls of dwellings, and for other buildings control joint spacing of 7,5m to 10m is generally acceptable. As a general rule no particular account need be taken of thermal movement in interior masonry.

Vertical control joints in non-reinforced masonry should generally be positioned where concentration of or changes in stress may occur, such as at: openings; major changes in wall height; changes in wall thickness; control joints in foundations etc; one or both sides of wall openings, near wall intersections and near return angles in L, T and U-shaped structures (see Figure 5.23). Control joints can also be located between openings.

Control joints should be considered in foundations, floors, roofs, at wall openings and wherever changes in thickness and major changes in wall height occur.

Joints are not generally provided within the corners of

exterior wall returns but are spaced 1 to 3m from them owing to the adverse effect of corner joints on stability of the structure (see Figure 5.23).

Control joints should be built into the wall during construction and should run the full height of the masonry. Sawn joints are generally more expensive, require great care in cutting and are not normally as effective as built-in joints.

It is not usual to continue the joints below the ground floor damp-proof course where changes in temperature and moisture content are minimal.

Where concrete masonry is used as a backing for other materials, control joints should extend through the facing if the bond is rigid (such as a masonry bond) but need not extend throughout the facing if the bond is flexible (eg. made of metal ties). Control joints should also extend through any plaster applied directly to concrete masonry.

A horizontal slip plate (of a suitable corrosion-resistant material) should be provided under at least one end of a lintel and, where the roof is supported on loadbearing masonry, at a control joint. If an effective horizontal slip plate cannot be built under the end of the lintel, then the position of the control joint should be placed not more than 3m away from the edge of the opening.

The position of the control joints, bond beams and joint reinforcement should be clearly shown on the plans.

With infilling panels in framed buildings, control joints allowing for vertical movement are required. The top of the panel has to be anchored to the structure to

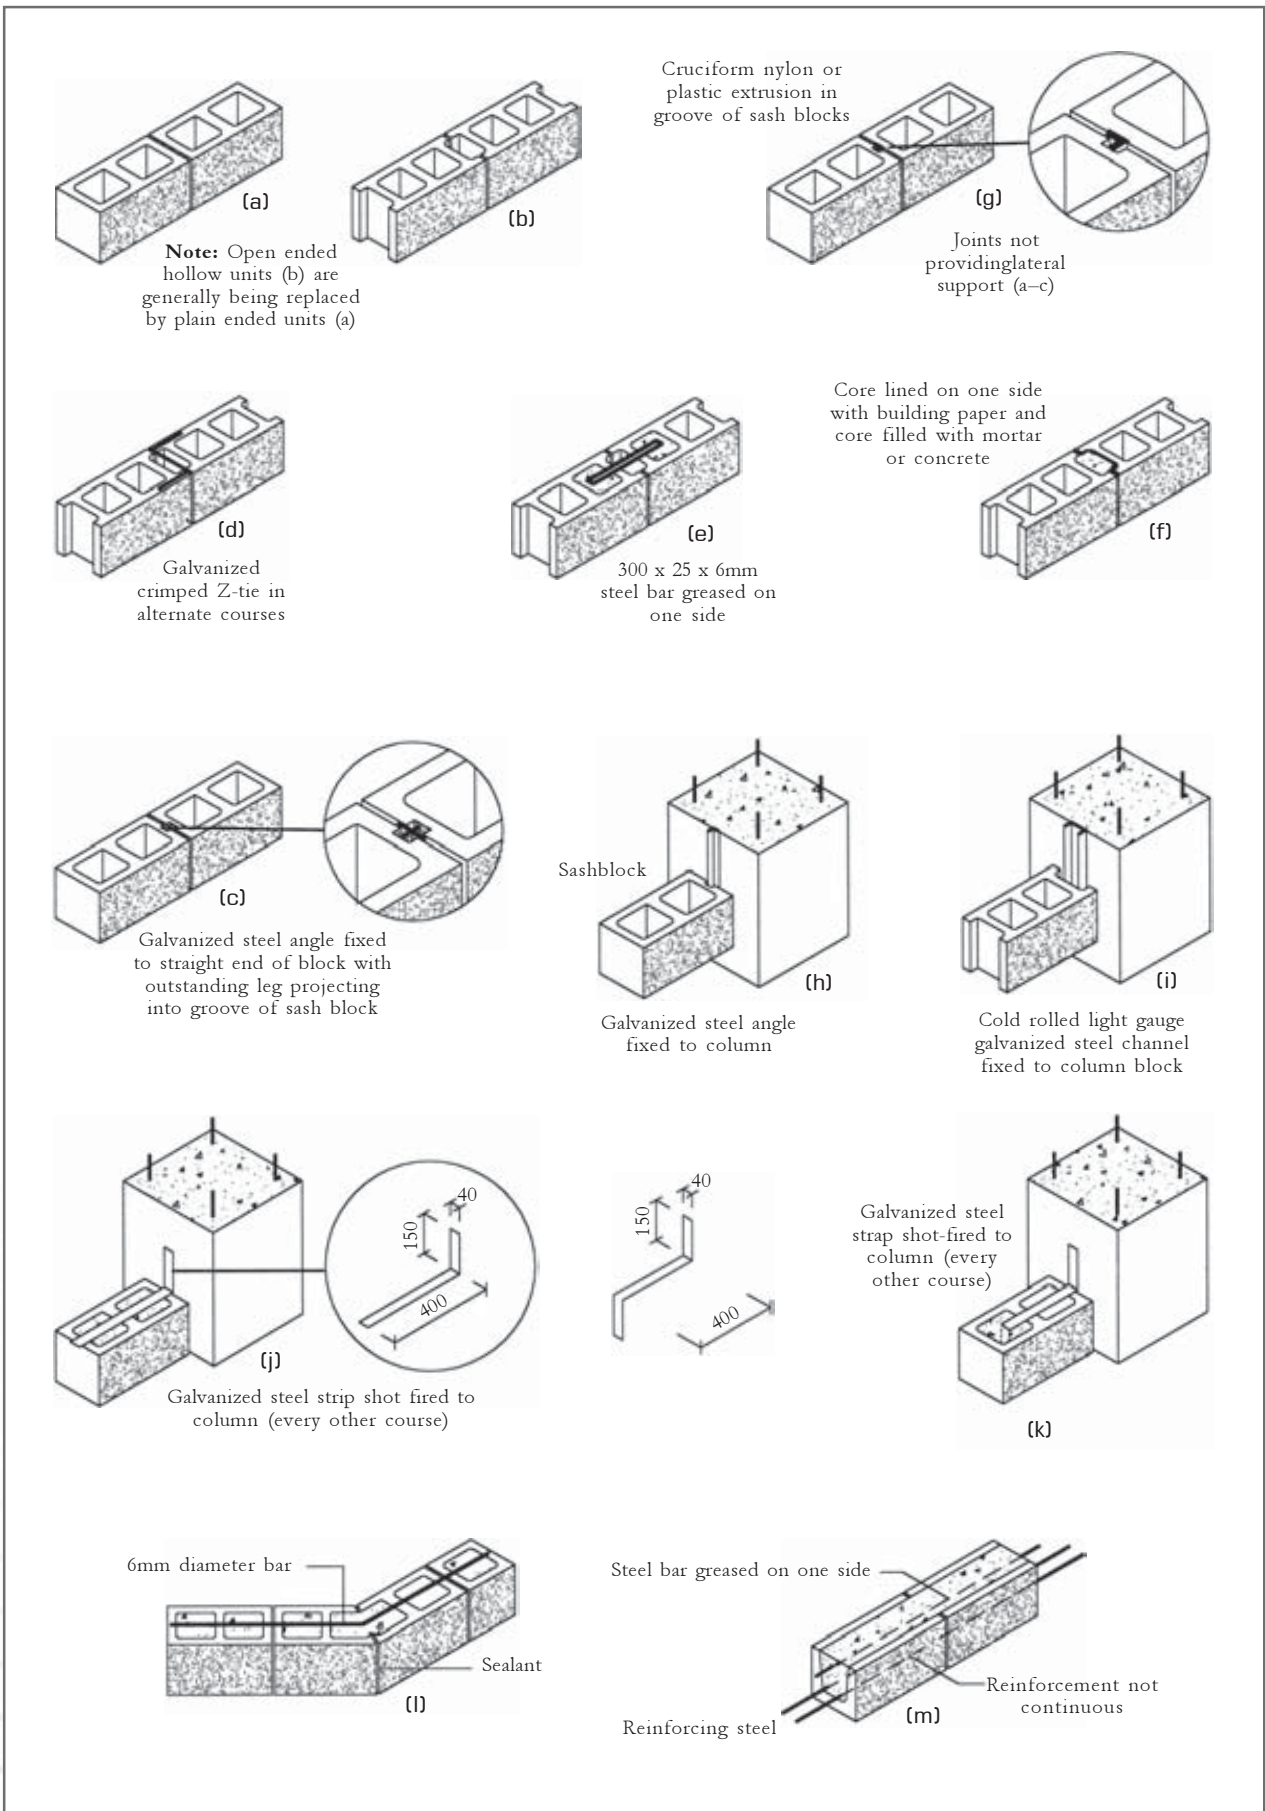


Figure 5.24 Details of some control joint configurations (Note: joint fillers and sealants not shown)



permit relative vertical movement while restraining the wall against lateral movement. Movement control gaps are required under any element that supports masonry cladding.

When calculating the thickness of the gap above infill masonry panels in reinforced concrete frame structures allow for 1,2 to 1,6mm/m shortening of columns due to stress, shrinkage and creep of concrete.

Where the cladding is separate to the reinforced concrete frame of the building, a horizontal control joint every third storey should be provided in the cladding to allow for frame shortening.

The American Concrete Institute, in its Commentary on building code requirements for concrete masonry structures, recommends a control joint for expansion at spacings of 45m to 60m.

The joint configuration depends on the purpose of the joint, primarily on the ability of the joint to transfer load across the gap.

In Figure 5.24, details are given of some control joint configurations. Joints (a), (b) and (c) are suitable for interior walls. Joints (d) to (m) are capable of providing mutual lateral support. Flat galvanised mild-steel strips 40mm wide x 1,6mm minimum thickness are also used for tying walls to concrete columns. The horizontal long leg of the strip, approximately 400 mm long, lies in the bedding course of the masonry while the vertical leg, approximately 150mm, is shot-bolted to the column in such a way as to give immediate lateral support to the wall, i.e. the vertical leg of the strip does not initially pull away appreciably from the column before providing support.

The horizontal leg of the tie should be parallel to the wall surfaces, otherwise cracks may be induced in the wall at the end of the tie. It is normal practice to fill the core of hollow units adjacent to the column with concrete or mortar. Calculations of lateral forces will determine the size, spacing and type of the control joint to be used.

11. Chasing for services

The positions and size of horizontal or vertical chasings to accommodate services or conduits for electrical and other services shall be as indicated on the drawings and shall be carried out neatly.

Well-considered earlier decisions on the location of services and wall finishes will be rewarded when electrical and plumbing services are to be installed. Horizontal chasing should be avoided where possible.

Ensure that chases, holes and recesses are so made as not to impair the strength or stability of the wall or reduce the fire resistance properties of the walling below the minimum permitted.

Small circular holes that can be made by drilling or coring may be formed after the construction of the masonry wall, but larger holes should preferably be square, of dimensions to suit the masonry unit size and coursing, and formed at the time of the construction of the wall. Holes and chases formed after the construction should not be made by impact methods as these can encourage local cracking that may propagate under loads and movements.

Vertical chases in solid units should not exceed one third of the wall/leaf thickness and horizontal chases should not exceed one sixth of the wall/leaf thickness.

Walls constructed of hollow units should not be chased at all and services should be located in the unit cores. Where chasing in these blocks is unavoidable, it should be no deeper than 15mm.

Chases in hollow concrete block wall shall be filled with Class I or II mortar once the conduits or pipes have been placed in their final position in the chase.

12. Joint infilling and sealing

Joints around door and window frames, control joints, abutting joints at external columns and other points where sealing is indicated or required shall be brush painted with... (type or name) primer and filled with (type or name) sealant of a colour specified by the specifier, the whole of which shall be carried out in accordance with the manufacturer's recommendations.

Many sealant materials effectively seal joints but frequently fail because of insufficient capacity to absorb total movement. Joints around door and window frames, unless properly designed, are not control joints and are not expected to accommodate movement.

Joints may be filled with various types of materials. Sealants are used to exclude water and solid material from the joints; joint fillers, which are of compressible material, are used to fill a joint to prevent the infiltration of debris and to provide support for sealants, if used.

Suitable sealants for masonry joints are field-moulded, chemically-curing materials such as polysulphides, polyurethanes and silicones.

These may be one- or two-component systems. Two-component systems require a catalyst while one-component systems, with the exception of silicones,

cure by taking up moisture from the air.

In less critical applications acrylics, bitumen and polyisobutylene materials may be used. Allowable extension and compression of these materials is generally $\pm 20\%$, i.e. on a 10mm wide joint the sealant will be effective between joint widths from 8mm to 12mm. The closer the installation temperature is to the mean annual temperature, the less will be the strain in the joint-filling material.

The joint depth-to-width ratio is an important consideration with seals. To ensure adequate bond to the masonry, the depth of seal should be at least 5mm. Certain single-part moisture-cured sealants are best used in joints of small cross-section due to excessive curing time required in thick sections.

Optimum performance in butt joints is obtained when the width-to-depth ratio of the sealant bed lies within the range 2:1 to 1:1.

Check with sealant supplier as to the best joint shape factor for the particular sealant.

The sealant should be applied against a firm backing so that it is forced against the sides of the joint under sufficient pressure to ensure good adhesion. The filler or back-up material should not adhere to or react with the sealant.

Preformed materials used as fillers and back-up are generally bitumen-impregnated fibreboard (softboard), closed-cell expanded polyethylene, polyurethane and polystyrene rigid foams, natural-rubber sponges and neoprene or butyl sponge tubes or rods. When there is a likelihood of the filler material reacting with the masonry, the use of a bond breaker should be considered. In some instances, particularly on interior walls, a dry butt joint filled with mortar can be used provided hairline cracking is acceptable. Metal cover strips to joints can also be used.

13. Protection against damage

Finished masonry shall be protected where necessary to avoid damage during building operations.

Care should be taken to anticipate and prevent any possible damage or disfigurement to finished work due to subsequent building and other operations.

The arrises around openings should be protected from damage by barrows, etc.

Masonry walls subject to uniform floor or roof loads shall not be subjected to loading for at least 12 hours after completion. Concentrated loads shall not be applied for 3 days after completion.

14. Protection of new work

To ensure that hardening and strength development of the masonry will not be adversely affected all new work shall be suitably protected against both rain and rapid drying.

During construction, partially completed walls which are not enclosed or sheltered shall be kept dry by covering at the end of each day, and when work is not in progress, with strong, weather-resistant material extending to a minimum of 600mm down each side, and held securely in place.

When any working platform is not in use the inner board should be turned up on edge away from the wall to prevent splashing of the wall face.

15. Bracing during construction

Back-filling shall not be placed against foundation walls until they have been braced or have adequate strength to withstand the horizontal pressure.

16. Cleaning of finished work

Finished masonry shall, if necessary, be cleaned with water and a fibre brush. Chemical cleaning agents shall only be permitted with the written approval of the specifier.

Where chemical cleaning agents are used the instructions of the manufacturer shall be followed.

THE USE OF CONCRETE AND CLAY MASONRY UNITS IN THE SAME WALL

Introduction

Concrete and burnt clay masonry units respond differently to temperature, moisture and stress. Consequently when used in the same wall distress may occur:

Masonry units: Clay

After manufacture, some clay bricks expand slowly in contact with water or humid air; this expansion is not reversible by drying at atmospheric temperatures; the movement is termed moisture expansion and continues for a number of years.

In an unrestrained wall, a temperature change of 20 °C results in movements of approximately 0,1 mm perm horizontally and 0,2mm per m vertically.

Creep – deformation in time under stress – is generally less for clay than for concrete units but, except in highly stressed loadbearing structures, this is not a significant factor in design.



Masonry units: Concrete

For a short period after manufacture, concrete masonry units shrink due to loss of moisture and carbonation.

Initial drying shrinkage should be substantially complete before units are built into the wall.

Concrete masonry units expand with a gain in moisture and contract with loss of moisture.

In an unrestrained wall, a temperature change of 20 °C results in horizontal and vertical movements of approximately 0,2mm per m.

Overall Considerations

a) General considerations

In a building the temperature range to which exterior and interior wall surfaces are exposed varies significantly. For example, the orientation of walls to the sun is a factor – south walls have little sun while west walls become hottest. Over-hanging roofs shade part of the wall.

Moisture changes in masonry units depend on whether they form an interior or an exterior wall, whether protected by plaster and/or paint or by an overhanging roof, and by the orientation of the walls towards the direction of the prevailing rain.

The stresses to which walls as a whole and various parts of the same wall are subjected, due to changing climatic conditions, vary throughout the day and night, and from point to point in a wall.

b) Design considerations

The designer of a wall should therefore consider the

Summary		
Factors affecting movement	Masonry Units	
	Clay	Concrete
After manufacture of unit	Expands	Shrinks
Creep	Low	Slightly higher
Temperature-induced movement		
Horizontal	Low	Higher
Vertical	Higher	Higher
Moisture-induced movement	Negligible	Reversible

many factors affecting its performance in service to ensure a maintenance-free wall.

He should identify and assess the numerous stress factors referred to above to which various parts of the wall will be subjected and take into account the quality of masonry units and mortar to be used, the quality of workmanship and supervision, the provision of control and/or movement joints, wall type (single leaf, double leaf, solid, cavity), wall ties, the use of bedding reinforcement, the position of service conduits, etc.

Recommendations

The notes that follow are based on conditions of exposure, quality of units, materials, workmanship and supervision on a well-organised and controlled building site.

a) Masonry units

Strength requirements for masonry units and mortar use in various positions in the construction of walling should be as specified.

b) Mortar sands and mix proportions

Sands used for mortar should not contain excessive amounts of fine or clayey material which frequently leads to excessive shrinkage and cracking of the bedding and perpend joints. Sands for mortar should comply with SANS 1090. Sand which does not comply with SANS 1090 should only be used with the written consent of the specifier. For mortar mix proportions refer to SANS 10145.

c) Wall ties

Wall ties in cavity walls should be able to accommodate the movement between inner and outer leaves. Butterfly and double triangular wire ties are more flexible and thus are preferred to flat or vertical twisted ties.

d) Type of wall

- i) Separate leaves of concrete and clay masonry units in solid or cavity walls (see sketch No. 1 Figure 5.25).

This type of construction is satisfactory provided that: leaves are kept separate, i.e. no mortar between concrete and clay masonry units; separate leaves are joined together by wall ties; attention is paid to detailing at corners and openings.

- ii) Concrete and clay masonry units in the same wall leaf. This may occur in four ways:

1. Adjacent areas of full wall height in concrete and clay masonry units (see sketch No. 2, Figure 5.25).








	Situation	Comment
Sketch 1	separate leaves of concrete & clay masonry units <div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">concrete</div>  <div style="margin-left: 10px;">clay</div> </div> <p style="text-align: center;">section</p>	satisfactory if leaves kept separate but detailing problems at openings
Sketch 2	<div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">concrete</div>  <div style="margin-left: 10px;">clay</div> </div> <p style="text-align: center;">elevation</p>	unsatisfactory
Sketch 3	control joint <div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">concrete</div>  <div style="margin-left: 10px;">clay</div> </div> <p style="text-align: center;">elevation</p>	satisfactory
Sketch 4	<div style="display: flex; align-items: center; justify-content: center;">  <div style="margin-left: 10px;"> clay concrete clay concrete </div> </div> <p style="text-align: center;">elevation</p>	unsatisfactory
Sketch 5	<div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">concrete</div>  <div style="margin-left: 10px;">clay</div> </div> <p style="text-align: center;">elevation</p>	unsatisfactory
Sketch 6	<div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">clay</div> <div style="margin-right: 10px;">concrete</div>  </div> <p style="text-align: center;">elevation</p>	unsatisfactory
Sketch 7	<div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 10px;">clay (or concrete)</div> <div style="margin-right: 10px;">concrete (or clay)</div>  </div> <p style="text-align: center;">foundation elevation</p>	satisfactory if joint, e.g. dpc, at junction of different masonry units

Figure 5.25 Concrete and clay masonry units in the same wall



Areas of concrete and clay masonry units should be separated by a straight vertical control joint (see sketch No. 3, Figure 5.25).

Where lateral pressures are expected consider pillars behind control joints or the use of lubricated dowel bars in the bedding course.

2. Alternate horizontal courses of concrete and clay masonry units (see sketch No. 4, Figure 5.25).

This type of construction of units is unsatisfactory and should not be used.

3. Random distribution of units made from different materials yields unsatisfactory results as each type of unit will exhibit differing characteristic movement patterns. At point of contact between these areas cracking is likely to occur (see sketches No. 5 and 6, Figure 5.25).
4. Lower courses of a wall, eg. foundation walls, may consist of units of one material while those of a different material may be used for the superstructure. This type of construction is satisfactory, particularly if a horizontal slip joint, i.e. a dpc, is placed in the bedding course at the junction of the different masonry units (see sketch No. 7, Figure 5.25).

RAIN PENETRATION THROUGH MASONRY WALLS

Introduction

Masonry walls that leak when subjected to rain are of concern to designers, builders and occupiers.

Water generally enters the wall through fine capillary passages at the masonry unit/mortar interface, and through cracks caused by building movement.

The prevention of rain leakage through walls begins with the design of the building, follows through with the selection of materials and supervision of workmanship, and continues with maintenance of the structure after its completion.

Good practice involves the following:

1. Design

Best results are obtained with:

- Cavity walls – cavities must be properly drained and ventilated.
- Provision of dpc's and weepholes located where necessary.
- Non-continuous mortar bed across wall composed of hollow units, i.e. shell bedding.

- Correct profiles of joints; best – concave and vee joints poorest – flush, struck and raked joints
- Correct detailing and reinforcing around windows and other openings to avoid cracks.
- Covering of top of walls – flashings, coping and roof overhang.
- Discharging of rain water from roof run-off away from wall. Large roof overhangs best.
- Surface finish – rendering, plastering, painting of non-face units and mortar.
- Provision of control joints, vertical and/or horizontal, of correct profile, spacing and sealing.

2. Materials

a) Masonry units

Research and experience regarding the ability of concrete masonry units to resist rain penetration have shown that:

- Strength, density and capacity for water absorption are not significant properties.
- Open textured, porous units soak up rain and generally dry out in wall under favourable climatic conditions. Water-permeable units should be designed for through correct detailing.
- Dense face units give rise to a considerable run-off down the face of the wall with possible moisture penetration through cracks at the unit/mortar interface.
- There is no significant difference between hollow and solid units.

b) Mortar

Cement – Common and masonry cements are best

Sand – Avoid sands with high shrinkage characteristics, i.e. high clay content or requiring high water content for workability – preferably use sands complying with SANS 1090

Admixtures – Performance depends on properties of sand and mix proportions; mortar plasticizers are generally suitable

Lime – Use in common cement mortar mixes with coarse sand improves water retention and plasticity.

c) Wall ties

Use with moisture drip in cavity.

d) Bed reinforcement

Check longitudinal wire spacing and cover to suit particular dimensions.

e) General note

Protect all materials from contamination.

3. Workmanship

Specify quality requirements.

Use qualified and trained layers.

Supervise construction.

Lay concrete units dry.

a) Mortar and joints:

- Use correct mortar proportions – allow for sand bulking – check accuracy of batching.
- Batch cement by bag or mass.
- Fill, compact and retool joints after 30 minutes to 2 hours. Use correct tools for tooling joints.
- Avoid excessive joint thicknesses – 13mm maximum.
- Use correct joint profile.
- Provide adequate cover to bed reinforcement.
- Bed wall ties properly – slope to outside leaf.
- Prevent mortar dropping into cavity.
- Provide weepholes above dpc's, beams and lintels – except where dpc's pierced or cavity drained.
- Slope concrete infilling at top of bond beams and lintels to outer surface.
- Prevent excessive retempering of mortar – use within 1 hour of mixing (hot weather) 2 hours (cold weather).
- Protect work from rain and rapid drying.

b) Dampproofing:

- Sandwich damp-proof membrane between wet mortar.
- Position dpc to fully cover leaf thickness.
- Extend dpc 10mm beyond bedding mortar and turn end downwards.
- Place membrane over hollow units, pierce over the centre of each core and depress membrane towards centre.
- Lap dpc at least 150mm and seal where dpc not continuous.
- Provide dpc at openings.
- Provide dpc at reveals of openings in cavity walls, and over lintels that are not protected by eaves overhang.

c) Control joints:

- Ensure complete break in walls – no reinforcement over gap – consider greased dowel bars or other slip-joints where lateral loading is a factor.
- Seal joints.
- Protect work from rain and rapid drying.

4. Maintenance

Inspect walling at regular intervals and identify possible problem areas.

Maintain walling:

- repair cracks;
- consider tuck pointing of defective mortar joints;
- replace or top up control joint sealants in joints;
- consider painting.

5. Tests for moisture penetration

Weather resistance of masonry structures depends on the interaction of design, materials, workmanship and maintenance. Thus, any meaningful test for moisture penetration must encompass a test of the whole wall. A standard water spray test is detailed in SANS 10400 Subsection KK5.

6. Conclusion

Solid walls are more vulnerable to moisture penetration than cavity walls. Cavity wall construction should be used in coastal areas. Where exposure conditions are severe, all non-cavity exterior walls should be plastered or given some other effective waterproofing coating.

The quality of the mortar and the workmanship require particular attention if the structure is to be weatherproof.

The assessment of condensation risk is an important consideration in the design of external walls.

Prediction of condensation risk is a complex subject involving a number of variables. The most important of these (the way a heating system is used, and the production of water vapour and its control by ventilation) are usually beyond the control of the building designer.

EFFLORESCENCE ON CONCRETE MASONRY

Introduction

Efflorescence on concrete masonry units normally takes one of three forms: lime bloom, lime weeping, crystallisation of soluble salts.



Lime bloom

The most common form of efflorescence is lime bloom and it is particularly noticeable on coloured units.

It is a white deposit which is apparent either as white patches or as an overall lightening in colour. The latter effect is sometimes mistakenly interpreted as the colour fading or being washed out.

The cause of lime bloom lies in the chemical composition of cement. When water is added to cement, a series of chemical reactions take place which result in setting and hardening. One product of these reactions is "lime" in the form of calcium hydroxide. Calcium hydroxide is slightly soluble in water and, under certain conditions, can migrate through damp concrete or mortar to the surface and there react with carbon dioxide from the atmosphere to produce a surface deposit of calcium carbonate crystals. This surface deposit is similar to a very thin coat of white-wash and gives rise to the white patches or lightening of colour mentioned previously. The surface deposit is normally extremely thin and this thinness is demonstrated by the fact that, when the concrete or mortar is wetted, the film of water on the surface usually makes the deposit transparent and the efflorescence seemingly disappears.

The occurrence of lime bloom tends to be spasmodic and unpredictable. Nonetheless, an important factor is the weather. Lime bloom forms most readily when concrete or mortar becomes wet and remains damp for several days, and this is reflected in the fact that it occurs most frequently during the winter months. Extended periods of rain and cold weather in particular are conditions most likely to precipitate a severe manifestation.

Although drying winds are often suggested as a likely cause, they are probably not a major factor.

Lime bloom is not visible on damp surfaces and so only becomes apparent with the onset of dry weather. Thus dry weather does not necessarily produce lime bloom; it may only make visible a deposit which had already formed but could not be seen because the concrete or mortar was damp.

Concrete masonry units are normally only prone to lime bloom in the early stages of their service life. In general, concrete which has been in service for a year without being affected can be considered immune.

Lime bloom is a temporary effect and, given time, usually disappears of its own accord. It is purely superficial and does not affect the durability or strength of the concrete masonry units.

Lime weeping

Lime weeping is a rare phenomenon in concrete masonry. It is an encrustation or build-up of white material on the surface of concrete masonry.

It usually occurs at joints or cracks, or at dpc level where water emerges from the interior of a wall onto the surface.

Lime weeping is closely related to lime bloom. Water moving across or through concrete, deposits this lime as calcium carbonate. However, unlike lime bloom, the calcium carbonate is not deposited as a thin surface layer, but builds up to form thick encrustation in localised areas. Lime weeping is a process very similar to that which produces stalactites and stalagmites in caves in limestone rocks.

The presence of lime weeping does not normally give rise to concern about the durability of a structure.

It is, however, an indication that water is flowing through the concrete masonry and this may be undesirable.

Crystallisation of soluble salts

This type of efflorescence, which corresponds to that normally observed on burnt clay brickwork, is relatively rare on concrete masonry. It usually takes the form of a fluffy deposit.

Unlike lime bloom and lime weeping, the deposit is not calcium carbonate, but consists of soluble salts not normally present in concrete. These salts can originate from contaminants present in the original concrete mix, eg. sodium chloride, introduced by using sea-water as mixing water. Alternatively they may have migrated into the concrete from external sources, eg. groundwater in contact with walls or foundations. They are drawn to the surface and deposited where water evaporates from the concrete.

Removal of lime bloom

Lime bloom is usually a transient phenomenon and can be expected to disappear with time. The major factor influencing its duration is the environment to which the concrete is exposed. Where the concrete is fully exposed to the weather, rain-water (which is slightly acidic) dissolves the deposit and the lime bloom typically disappears in about a year. In more sheltered locations, removal by natural means may take considerably longer.

If immediate removal is required, this can be achieved by washing with dilute acid. This is a relatively simple operation, but care should be taken on two counts. Firstly, acids can be hazardous and appropriate safety

precautions must be taken. Secondly, acid attacks concrete and over-application to a concrete surface can result in acid-etching, which will alter the texture and appearance.

Generally a 5% solution of hydrochloric acid or a proprietary acid-based concrete cleaner is used. The acid concentration can be adjusted to suit individual circumstances; a less concentrated solution will require more applications to remove lime bloom, but will be less likely to result in an acid-etched appearance.

Before the acid is applied, the surface should be dampened with water to kill the initial suction. This prevents the acid from being sucked into the concrete before it has a chance to react with the surface deposit. The acid is applied by brush or spray and a typical application rate is 1 litre of acid to 5 - 10 square metres. Following application of acid, the surface of the concrete is allowed to dry out and is then inspected. Often one wash with acid is sufficient, but in more stubborn cases the treatment is repeated as necessary until the lime bloom disappears. Finally, it is normal practice to give the concrete a final wash with water.

When carrying out acid washing, always test the effect on an inconspicuous area. Operatives should wear protective clothing, at the very least rubber gloves and goggles. Precautions should be taken to prevent acid from coming into contact with metals and other materials which may be adversely affected.

Acid is neutralised within seconds of coming into contact with concrete; consequently, when acid washing is used on concrete products, there is no risk of acid burns to users of such products. The attack on concrete by acid, even in the case of severe over-application, is limited to a thin surface layer and there need be no cause for concern that acid washing will affect properties of the concrete other than surface appearance. Whilst there can be no guarantee, experience suggests that lime bloom is unlikely to recur following its removal with acid.

Control and removal of lime weeping

Lime weeping is a white deposit produced at points where water merges from the surface of concrete. Its prevention involves design and workmanship which eliminate the leakage of water.

Where lime weeping is present on existing structure, it can be removed by mechanical hacking, using a hammer and chisel. Provided this is done carefully, the

brittle encrustation can usually be knocked off without damaging the underlying concrete. Unless measures are taken to prevent further migration of water through the concrete, lime weeping will usually recur.

Control and removal of deposits of soluble salts

Salts crystallising on the surface of concrete may originate either from impurities present in the concrete mix or from ground-water in contact with the concrete.

Efflorescence resulting from contaminants present in the concrete mix is often a result of using sea-water as mixing water. The use of sea-water or of unwashed marine aggregates should be avoided in situations where efflorescence would be objectionable.

Ground-water does not migrate very easily through good quality concrete and soluble salts from ground-water do not often crystallise on concrete surfaces. In situations where precautions are considered necessary, a bitumen (or similar) damp-proof membrane should be used to separate the concrete from the ground-water.

These deposits are often soft and fluffy and in many cases can be removed by using a dry bristle brush. Should this fail, a combination of brushing and washing with water may be tried. Should this also fail to remove the deposit, the surface should be washed with acid as described previously. In all cases, trials on an inconspicuous area should be carried out to determine the most effective treatment.

Test for efflorescence

There are no requirements in SANS 1215 pertaining to the amount of efflorescence permissible, but a test for efflorescence is described which states: "Place each of six masonry units on end in separate trays that are situated in a well-ventilated room and each of which contains 300ml of distilled water and has dimensions such that the depth of immersion of the unit is between 25 and 40 mm.

"Allow the water in the trays to evaporate. When the units appear to be dry and feel dry, place a further 300ml of distilled water in each tray. When the water has evaporated and the units have dried out, determine by visual examination the degree of efflorescence of each unit."

The permissible degree of efflorescence should be agreed upon by the supplier and the purchaser. Reference: HIGGINS, D.D. Efflorescence on concrete. Cement and Concrete Association 1982.



GOOD LAYING PRACTICE ILLUSTRATED




Setting out to block modules



Block module spacing



Positioning first corner block

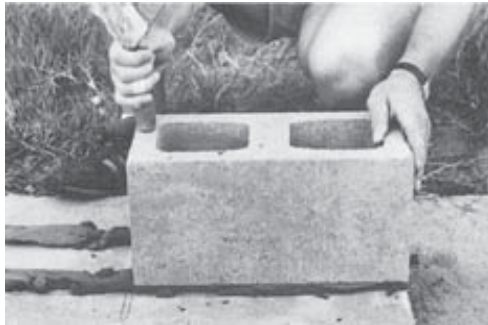


Tapping the block into position



Remove excess mortar



Buttering end of block

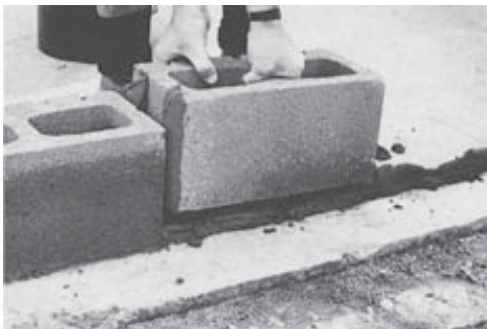

Place block against previous unit



Tap into position



Check corner for plumb



Check alignment with straightedge




Check level




Mortar for closing block



Lay closing block

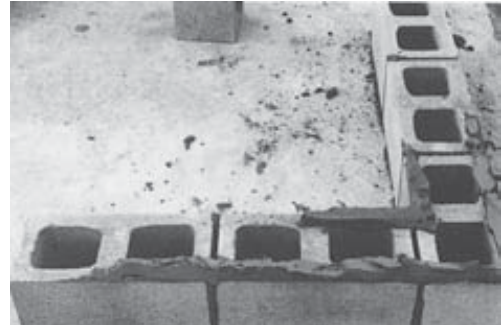

Face shell mortar bedding

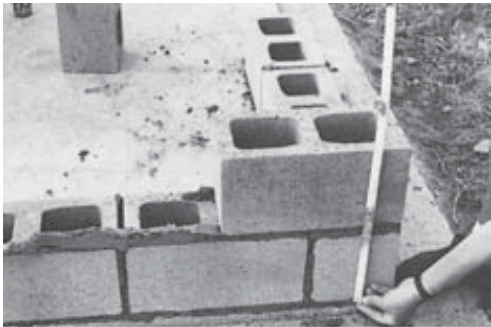

Check course height



Check level



Lay blocks to mason's line




Check corner alignment



Re-fill mortar joints



Tool horizontal joints

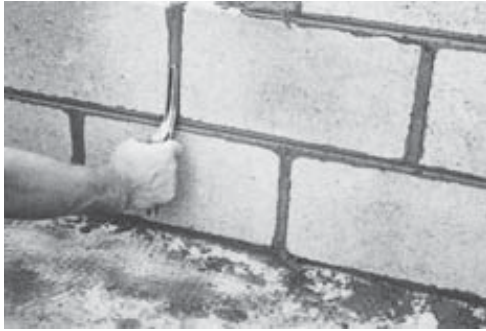


Tool vertical joints



Remove excess mortar burrs

GOOD DETAILING PRACTICE ILLUSTRATED

Drawing published with permission of Chief Architect:
Chief Directorate Works, Provincial Administration of
the Cape of Good Hope, Cape Town

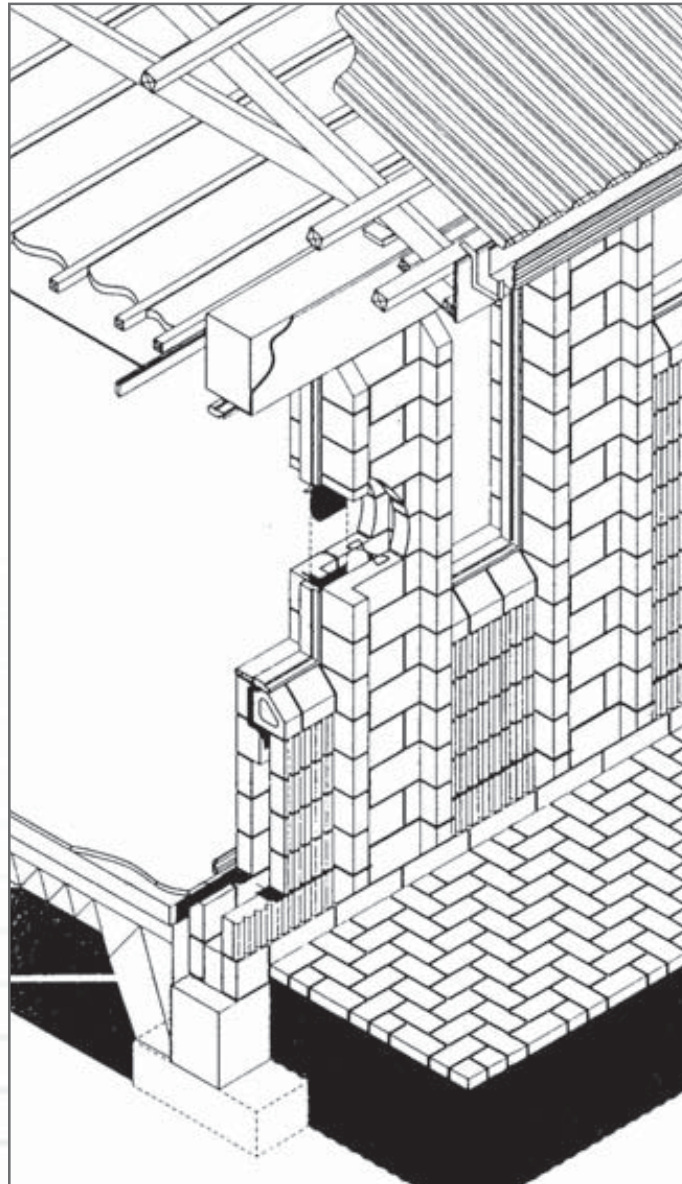

6 SCHEDULE OF SITE CHECKS

SCHEDULE OF SITE CHECKS FOR CONCRETE MASONRY CONSTRUCTION

The check list is comprehensive in that it covers all aspects of concrete masonry construction. The extent of site checking will depend on the importance and consequences of failure of any aspect of construction.

1. MATERIAL

Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes
a) Concrete masonry unit	Compressive strength (nominal compressive strength)	According to SANS 1215 Section 5.5 Compressive strength test	At pre-tender stage – (according to SANS consignment testing or sworn statement stating units comply with SANS 1215). During construction 10 units per 500m ² walling	Where specification requires SANS quality units contractor to provide proof at tender stage of quality of units to be used
	Drying shrinkage	According to SANS 1215 Section 5.6 Drying shrinkage test	At pre-tender stage – (according to SANS consignment testing or sworn statement stating units comply with SANS 1215) During construction 3 units per 1000m ² walling or when aggregates used are changed	SANS values: Normal 0,06% max. High shrinkage units 0,08% max. NHBRC HBM 0,06% max.
	Dimensions (tolerances)	According to SANS 1215 Section 5.3 Test for dimensions	At pre-tender stage – (according to SANS consignment testing or sworn statement stating units comply with SANS 1215) Weekly or when excessive deviation of dimensions suspected	SANS 1215 values of tolerances: Length +2-4mm Width +3-3mm Height +3-3mm
	Face, appearance and colour	Visual. Refer subsections 3.1.1; 3.1.2; 3.1.3 of SANS 1215	When significant changes noted	Important for face units. Retain three units of agreed colour and texture to serve as an example of the possible range of unit colour and texture

*Concrete masonry units which do not bear the SANS mark certifying compliance with SANS 1215 should be checked at frequency shown.

Most Concrete Manufacturers Association members manufacturing masonry units hold the SABS mark according to SANS 1215 Concrete masonry units.



Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes
b) Common cement	General quality	See notes	See notes	Common cement sold in SA must bear SABS mark according to SANS 50197-1. Independent testing not necessary
	Contamination by moisture	Visual examination for lumps in cement	When contamination suspected	Cement contamination by water – during transport or storage on site. Refer cement manufacturer on possible testing
	Age of common cement at time of use	Check site records	Weekly	Cement to be used within 3 months of manufacture/delivery
c) Masonry cement	General quality	See notes	See notes	Masonry cements sold in SA must bear SABS mark for masonry cement SANS 50413-1
	Contamination by moisture	Visual examination for lumps in cement	When contamination suspected	Cement contamination by water – during transport or storage on site. Refer cement manufacturer on possible testing
	Age at time of use	Check site records	Weekly	Cement to be used within 3 months of manufacture/delivery
d) Lime	General quality	Tests as specified in SANS 523		Lime should comply with SANS 523 preferably class A2P
e) Mortar sand	Grading	Sieve analysis	At commencement of contract and when changes are noted or once every 100m ³	As per SANS 1090
	Contamination	Visual check on type and cleanliness	Daily	
f) Water	Purity as it affects setting and strength gain of cement	Test method SANS 10100-2	At beginning of contract and when contamination suspected	Municipal water need not be tested. Check borehole, farm dam and similar water
g) Admixtures (mortar plasticizers etc.)	General quality (check storage and shelf life of product not exceeded)	Obtain test certificate or quality statement on admixture by manufacturer	At beginning of contract	As per BS 4887 Check dosage rates as recommended by manufacturer
h) Reinforcement and wall ties (metal)	General quality	Obtain manufacturer's test certificate	At commencement of contract	Refer SANS 190, 920 and 1024; and 28
	Contamination (free from loose millscale and other coatings that will adversely affect bond, kinks and bends)	Visual check	Daily or at frequent intervals when being used	
i) Wall ties (non-metallic)	General quality	Obtain manufacturer's test certificate	At commencement of contract	Test for non-metallic ties specified in NHBRC HBM, Part 3 Section 3, Clause 3.3.11.2

2. CONSTRUCTION

Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes
a) Setting out	Accuracy of setting out	Re-measurement	Before masonry laying commences	Refer SANS 10155. Preferable lay units to modular co-ordinating dimensions
b) Accuracy of building	Accuracy of building (plumb, line, level)	Measurement	At regular intervals or when inaccuracies in plumb, line and level noted	Refer SANS 10155. Two grades of accuracy are given: Grade I is suitable for special work and Grade II is suitable for most other work.
c) Mortar	Materials used and mix proportions	Visual check on all ingredients. If sand quality uncertain a grading analysis is required. Check batching quantities.	Daily	Refer SANS 1090 for grading limits for mortar sands
	Mixing time and conditions of mixing equipment	Visual examination to check uniform distribution of ingredients in mix	Daily	Time of mixing depends on how ingredients mixed
	Consistency	Visual check	Daily	Consistency appropriate for suction of masonry units, rate of laying and vertical progress
	Retempering	Measurement of time interval between addition of water and use of mortar with masonry units (loss of workability)	When excessive retempering suspected	Mortar mixes to be used within 2 hours of mixing – in hot weather reduce to 1 hour. Retempering may change colour of pigmented mortars
	Compressive strength (only for structural masonry)	Cube tests (SANS test method 749)	3 cubes/150 m ² (structural masonry requirement)	Required for highly stressed masonry. Refer SANS 10164-1, Sections 6.1 and 6.2
	Colour	Visual examination	Daily	Important when colour of joints and uniformity of colour significant
d) Concrete masonry units	Moisture conditions at time of laying	Visual examination or test according to SANS 10145	Daily	Refer SANS 10145. Moisture content of units at time of laying (except in consistently high humidity area) should be dry, i.e. not wetted
	Quality/type of unit	Visual and refer to consignment delivery sheets	Daily	Check units are of right nominal compressive strengths, size, profile, colour and texture
e) Laying	Mortar bedding: full or shell	Visual check	Daily	Hollow units should be laid with thicker shell uppermost, with shell bedding perpendicular joints filled to same depth as horizontal joints



Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes						
e) Laying (cont)	Mortar stiffening	Thumb test to ensure mortar has not set before unit laid or when unit disturbed and relaid	When stiffening suspected	Bond between mortar and unit essential for strength and resistance to moisture penetration						
	Joint profile	Visual check	Daily	Concave and weather struck best. Flush, raked and extruded, poorest in external walls. Retooling concave joints when mortar thumb-hard improves weather resistance						
	Bond pattern (stretcher, stack or as specified)	Visual check	Daily							
	Bonding with a cross wall	Visual	Daily	Cross walls may be bonded with mesh or metal ties						
	Permissible deviations in joint width	Measurement	Daily	Face work: bedding joints 10 mm ± 3mm; perpend joints 10mm ± 2mm for units complying with dimensional accuracy as per SANS 1215						
	Mortar falling into cores and cavities	Visual	Daily	Mortar to be removed						
	Visual appearance of face work. Smearing of face units with mortar	Visual	Daily	Mortar squeezed out joints should be lifted away from wall and not smeared into face of units						
f) Reinforcement	Type, size and position, not contaminated in storage	Measurement	When used	Check against drawings and/or specification. Check cover to reinforcement						
	Position in bedding joint	Measurement	When used	To be placed in middle of joint thickness, reinforcement surrounded by mortar with adequate cover						
	Position – vertical and/or horizontal in grouted or concrete filled cores	Measurement	When used	Refer drawings. Check vertical starter bars in foundation. Horizontal bars at least 25mm above or below mortar joint and fully embedded in grout/concrete and positively held in position						
g) Cavity walls	Wall tie placing – horizontal and vertical	Measurement	Daily	Refer specification. Requirements wall ties/m ² cavity (mm) <table style="margin-left: 20px; border: none;"> <tr> <td style="padding-right: 20px;">2,5</td> <td>< 75</td> </tr> <tr> <td>3</td> <td>75 – 100</td> </tr> <tr> <td>5</td> <td>100 – 150</td> </tr> </table>	2,5	< 75	3	75 – 100	5	100 – 150
2,5	< 75									
3	75 – 100									
5	100 – 150									

Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes
g) Cavity walls (cont)	Wall tie in bedding joint	Measurement	Daily	Ensure wall tie bedded in mortar, slopes to exterior leaf and "drip" points downwards. Wall ties placed at right angles to the plane of the masonry
	Mortar droppings	Visual	Daily	Remove mortar droppings on wall ties and from cavity
h) Single leaf exterior walls of hollow units (when cores house reinforcement)	Lining up of cavities	Measurement	Daily	Cavities to line up for reinforcement
	Mortar droppings (note: shell bedding of mortar)	Visual (use mirror to assist)	Daily	Remove mortar from cavities preferably through special cleanout blocks
i) Damp-proof courses	Position and shape in wall, sills and copings	Visual	When used	Refer drawing and/or specification
	Position in bedding joint	Visual	When used	dpc in middle of bedding mortar. To project 10mm from external face of wall and turned down
	Jointing of dpc's	Measurement	When used	Check lap required
	Hollow unit masonry	Visual	When used	dpcs over cavities to be pierced and dpc depressed downwards
Weepholes	Position and size in bedding and perpend joint	Visual	When used	Refer drawing and/or specification
j) Lintels – masonry	Length of lintel (opening plus bearing lengths)	Measurement	When used	Refer drawings and/or specification. Lintel to be propped during construction
	Reinforcement, type size, position in lintel	Measurement	When used	Refer drawings and/or specifications
	Infill concrete	Mix proportions or concrete cube tests	When used	Refer drawings and/or specification
k) Lintels – precast prestressed concrete	Length of lintel (opening and bearing lengths)	Measurement	When used	Refer drawings and/or specification
	Orientation	Visual	When used	Reinforcement at bottom of lintel when placed
l) Control joints	Position and spacing	Measurement	When used	Refer drawings and/or specification
	Type	Visual and measurement	When used	Refer drawings and/or specification
	Width	Measurement	When used	Refer drawings and/or specification
	Joint sealing	Check sealant and application on a backing	When used	Refer drawings and/or specification or manufacturer's instructions. Check if a primer must be used



Item	Property to be checked	Test	Frequency* (applicable to non-SANS)	Notes
m) Chasing for services	Position and size of chasing	Visual and measurement – check depth and width not excessive	When used	As indicated on drawings. Chasing tool to be used unless otherwise permitted
	Chases in hollow units	Visual check on infill concrete – check width and depth not excessive	When used	Refer specification
n) Cleaning	Visual defects	Visual	When wall completed	Mortar smears on finished work removed by brushing. Temporary holes in mortar joints filled
o) Protection against damage – completed work	Damage to wall after construction	Visual	Daily	Damage or disfigurement due to subsequent building operations
p) Protection against damage – new work	Damage to wall during construction	Visual	Daily	Tops of constructed walls protected from rain and in addition fair-faced work protected against staining from construction activities. Walls to be braced against wind and earth back-fill forces where necessary
q) Painting/plastering	Condition of surface to be painted/plastered	Visual	Before painting/plastering commences	Surfaces of walls dry and cleaned down to remove all, dust and dirt and mortar dabs. Efflorescence removed with stiff brush or cloth
r) Anchoring of roofs	Heavy or light roof	Check length of anchorage	When used	Heavy roofs 300mm, light roofs 600mm

Accuracy in building: Permissible deviations in masonry work, mm

Description	SANS 10155		SANS 10164-1
	Grade II	Grade I	
Position on plan			
PD of fair-faced specified side of wall from the designed position	±15	±10	
Length:			
Up to and including 5 m	±15	±10	±10
Over 5 m, up to and including 10 m	±20	±15	±15
Over 10 m	±25	±20	±20
Height:			
Up to and including 3 m: brickwork	±10	±5	±5
Up to and including 3 m: blockwork	±15	±10	±5
Over 3 m, up to and including 6 m	±20	±20	±20
Over 6 m	±25	±20	±20
Thickness: 1½ bricks			
2 bricks			
2½ bricks	±15	±10	
More than one block			
Level of bed joints			
Length up to but not exceeding 5 m	±10	±5	
Over 5 m but not exceeding 10 m	±15	±10	
Over 10 m but not exceeding 20 m	±20	±15	
Add for every 5 m in excess of 20 m	±5	±5	
Straightness, max			
In any 5 m (not cumulative): brickwork	15	10	10
In any 5 m (not cumulative): blockwork	10	5	10
Verticality			
In any 8 courses: brickwork (1m)	±10	±5	±5*
In any 3 m	±15	±10	±10
Finished surfaces			
PD of any point from a 2 m straight-edge placed in any direction on the wall, max.	6	3	

Note: *In any 1m (not cumulative)



7 QUANTITIES

The tables that follow are designed to assist in calculating the quantities of materials required to construct concrete masonry walls.

QUANTITIES OF MASONRY UNITS AND MORTAR

The dimensions of units given in Table 7.1 are those of the commonly manufactured sizes.

Table 7.1 Quantities of masonry units and mortar

Masonry unit size, mm			Masonry units per m ²	Mortar, m ³ per	
Length, l	Width, w	Height, h		1000 units	100m ² walling
190	90	90	50	0,27	1,35
190	190	90	50	0,57	2,85
222	90	73	52	0,29	1,48
222	106	73	52	0,34	1,74
290	90	90	33,4	0,36	1,20
290	90	140	22,3	0,41	0,90
290	140	90	33,4	0,56	1,87
290	140	140	22,3	0,63	1,40
390	90	90	25	0,45	1,13
390	90	190	12,5	0,54	0,68
390	140	90	25	0,70	1,75
390	140	140	16,7	0,77	1,29
390	140	190	12,5	0,84	1,05
390	190	90	25	0,95	2,38
390	190	190	12,5	1,14	1,43
440	90	190	11,2	0,59	0,65
440	140	190	11,2	0,91	1,02
440	190	190	11,2	1,24	1,38
440	110	220	9,7	0,75	0,73
440	220	220	9,7	1,50	1,45

Note:

- The table is based on exact sizes of solid masonry units, with 10 mm thick bedding and vertical joints, and no wastage.
- No allowance is made for:
 - undersized units
 - hollow units
 - units with perforations or holes
 - units with one or two frogs
 - bedding and vertical joints thicker than 10 mm
 - wastage
 - site-mixed against ready-mixed mortar.
- Adjustment of mortar quantities given in Table 7.1 to allow for the above factors:
 - For **all** mixes multiply mortar quantities by 2 for excellent control on site

by 3 for average control on site

(Above factors based on many observations of quantities used).

- For hollow units where units laid in shell bedding, reduce mortar quantities by:

width of units, mm	% reduction
90 - 110	20
140	30
190 - 220	40

- For units with perforations or holes increase mortar quantities by 15%
- For units with frogs; frog laid face up (as required for structural walls), increase mortar quantities by 15%
- Once the above adjustments have been made: for mortar ready-mixed and delivered into

watertight containers on site, reduce quantities by 20% as against site-mixed mortar.

4. Adjustment of masonry unit quantities for size variation
 - For under- or oversized units: Measure dimensions of 10 units and use the average for calculating the number of units per m².
5. Quantities to be reduced by areas of wall occupied by openings such as doors, windows, airconditioning units etc. Refer to Form A for calculation of masonry units required.

Basis for Table 7.1 Quantities of masonry units and mortar

$$\text{No. of units/m}^2 = \frac{1}{(l + 0,01)(h + 0,01)} = x \text{ (No.)}$$

$$\text{Mortar/1000 units} = 1000(l+0,01+h+0,01) \text{ w.t} = y \text{ (m}^3\text{)}$$

$$\text{Mortar/100m}^2 = \frac{xy(\text{m}^3)}{10}$$

where l, w, h are the work sizes of length, width and height of the masonry units and t the thickness of the mortar joints all measured in metres.

MORTAR MIX QUANTITIES OF MATERIALS

Table 7.2 Quantities of materials for mortar (not including wastage)

Mortar Class	Per 50 kg bag				Per cubic metre			
	Sand (damp & loose)		Cement	Lime	Sand (damp & loose)		Cement	Lime
	kg ⁺	ℓ*	kg	ℓ	kg ⁺	m ³ **	kg	ℓ
Class I								
common cement only	160	130	50	0	1330	1,08	420	0
with lime added	160	130	50	10	1260	1,02	390	80
masonry cement	120	100	50	0	1150	0,96	480	0
Class II								
common cement only	250	200	50	0	1440	1,15	290	0
with lime added	250	200	50	40	1290	1,03	260	210
masonry cement	210	170	50	0	1310	1,06	310	0
Class III								
common cement only	370	300	50	0	1520	1,23	210	0
with lime added	370	300	50	80	1300	1,05	190	290
masonry cement	250	200	50	0	1350	1,08	270	0

* Sand measured loose and damp

+ Mass increased by 5% to allow for moisture in the sand

Table 7.2 provided by the Cement & Concrete Institute is based on the following data:

Relative densities:

Common cement	3,14
Lime	2,35
Masonry cement (MC 12,5)	3,08
Sand	2,60

Loose bulk densities, kg/m³:

Lime	700
Sand (dry)	1400
Sand (damp) 5% moisture (20% bulking)	1230

Water content, kg/m³ (total, sand dry):

Common cement + sand	350
Common cement + lime + sand	360
Masonry cement (MC12,5 only) + sand	330

Air content, %:

Common cement + sand	4
Common cement + lime + sand	4
Masonry cement (MC12,5) + sand	10



EXAMPLES OF CALCULATIONS FOR MASONRY UNITS AND MORTAR IN A WALL

Example 1

A 190 mm boundary wall, 80m long x 2m high using 390 x 190 x 190 2-core hollow blocks, with class II mortar, common cement and lime is to be built by an experienced builder.

Calculation of quantities

Area of wall $80 \times 2 = 160\text{m}^2$
 Number of blocks/m² = 12,5
 Total number of blocks = $12,5 \times 160 = 2000$
 No allowance for breakage in transporting and handling – normally between 2,5 and 5%
 Allow 5% breakages
 Order blocks = $2000 \times 1,05 = 2100$
 From Table 7.1 1,43m³ mortar required for 100m² walling without any adjustment for on-site factor, i.e

$$\frac{160}{100} \times 1,43 = 2,29 \text{ m}^3$$

Material	Mortar required for 160m ² walling			Order
	Nett quantities from Table 7.2	Quantities experienced builder x 2	Quantities adjusted for hollow units 40% reduction	
Common cement, kg	$2,29 \times 250 = 572,50$	1145	687	14 bags of 50kg
Lime, ℓ	$2,29 \times 200 = 458,00$	916	549,6	22 bags of 25kg
Sand, m ³	$2,29 \times 1,01 = 2,32$	4,64	2,79	3m ³

Note: Lime packaged in 25 kg bags has a volume of approximately 40ℓ when measured loose.

Example 2

A 230 wall collar jointed using 222 x 106 x 73 solid bricks with frog one side only using class II ready-mixed mortar with common cement (no lime - ready mix supplier will use a retarder and maybe some mortar plasticizers which may affect quantities) using an experienced builder. Calculation of quantities per 100m² walling required for estimating only. Ready-mixed mortar to be pumped into containers on scaffolding ready for use by layers

Calculation of quantities

Bricks/m² (x2) = $52 \times 2 = 104$ (No)
 Mortar 100m² (x2) = $1,74 \times 2 = 3,54\text{m}^3$
 Mortar for 10mm collar joint, 100m² = $100 \times 0,01 = 1,00\text{m}^3$
 Total mortar required, 100m² = 4,54m³

From Table 7.2 material quantities are given.

Material	Mortar required for 100m ² walling				Estimating quantities
	Nett quantities	Adjustment experienced builder x 2	Adjustment for frog x 1.15	Adjustment for ready mixed mortar -20%	
Common cement, kg	$4,54 \times 290 = 1317$	2 634	3 029	2 423	49 bags of 50 kg*
Sand, kg	$4,54 \times 1440 = 6538$	13 076	15 037	12 030	12,1t

* Bulk cement prices may be used for estimating costs, then use 2423 kg

Example 3

190 double leaf collar jointed wall using 190 x 90 x 90 solid bricks (no frog) using a class III mortar with masonry cement with an inexperienced builder. Quantities for 20 000 bricks required.

Bricks = 20 000
 Mortar/1000 bricks = 0,27m³
 Mortar for 10mm collar joint
 Area covered by 1000 bricks -one leaf only = $\frac{1000}{50} = 20\text{m}^2$
 Mortar for collar joint wall/ 1000 bricks = 20 x .01 = 0,2m³
 Mortar for 20 000 bricks i.e 10 000 bricks in each leaf
 = (0,27 x 2 + 0,2) $\frac{10\ 000}{1\ 000} = (0,54 + 0,2) 10 = 7,4\text{m}^3$

From Table 7.2 material quantities are given.

Material	Mortar required for 20 000 bricks		
	Nett quantities	Adjustment for inexperienced builder x 3	Order
Masonry cement, kg	7,4 x 270 = 1998	6000	150 bags of 40 kg
Sand, m ³	7,4 x 1,08 = 8.0	24	24 m ³

A measurement of 10 bricks showed average size to be 187 x 87 x 87 (lower limit of acceptable sizes)

Allow 5% for breakages on site (units not delivered on pallets)

Brick order = 20 000 x $\frac{190 \times 90}{187 \times 87} \times 1,05 = 22\ 072$ say 22 000 bricks.

Table 7.3 **Calculated mass per m² face area: hollow (2 core) and solid concrete masonry walls including mortar** (masonry density 2 200 kg/m³)

Manufacturing dimensions		Manufactured width of wall units, mm		
Length, mm	Height, mm	190	140	90
		Mass of wall per m ² face area, kg/m ²		
390	190 solid	390	285	185
390	190 hollow	200	160	130

As core volume and the properties of materials may vary, figures should be checked against the masonry units, mortar and core filling grout (if any) actually used.

Note:

Density of materials:

concrete masonry: 2200kg/m³

mortar: 2100kg/m³

Table 7.4 **Percentage of solid material in hollow units:**

Manufacturing thickness (mm)	Percentage solid	
190	51	The values shown are based on the minimum practical shell and web thicknesses used in manufacture
140	50	
90	66	



FORM A

Calculation of number of units required

Gross area of wall	-----	m ²
Openings (deduct)	-----	m ²
Net area of wall	-----	m ²
Corners (deduct)	$\frac{(\text{No})^* \times (\text{ht})^* \times (\text{t})^*}{1000}$	m ²
Net area of masonry	-----	m ²
Face dimensions of unit	-----	mm
No. of units per 100m ² (Table 7.1)	-----	

Total No. of Units

* No = Number of corners. *ht = Wall height in m. *t = Wall thickness in mm.

Deductions (special units)

Unit	Number of Units	
	Full	Half
Corner		
Lintel		
Sash/Jamb		
Control joint		
Other		
Total		

Total deduction in stretcher units -----

Net number of stretcher units -----

Calculation of quantity of mortar required

Net area of masonry	-----	m ²
Manufacturing dimensions of unit (l x w x h).	-----	mm
Quantity of mortar per 100 m ² (from Table 7.1)	-----	m ³
Total quantity of mortar	-----	m³

APPENDIX

STANDARDS, CODES OF PRACTICE AND REFERENCES ON THE MANUFACTURE AND USE OF CONCRETE MASONRY

MANUFACTURE OF CONCRETE MASONRY UNITS

SANS 1215 - 1984 (2004)	Concrete masonry units
Lane J. W.	The manufacture of concrete masonry units

MATERIALS OF MANUFACTURE

Cement

SANS 50197-1: 2000	Part 1. Cement. Part 1. Composition, specification and conformity criteria for common cements
SANS 50413-1: 2004	Masonry cements. Part 1. Specification

Aggregates

SANS 794 - 2002	Aggregates of low density
SANS 1083 - 2002	Aggregates from natural sources - Aggregates for concrete
Cement and Concrete Institute	Commentary on SANS 1083 - 1994. Aggregates from natural sources. Aggregates for concrete
SANS 1090 - 1996	Aggregates from natural sources - Fine aggregates for plaster and mortar

USE OF MASONRY UNITS

Planning design and specification

SANS 993 - 1972 (2002)	Modular co-ordination in building
SANS 10021 - 2002	Waterproofing of buildings
SANS 10155 - 2000	Accuracy in buildings
SANS 10249 - 2000	Masonry walling
NBRI R/Bou 602	Fire resistance ratings - walls constructed of concrete blocks

Building regulations

National Building Regulations and Building Standards Act 1987 revised 1990	
SANS 10400 - 1990	Application of the National Building Regulations
SANS 10401 - 1989	The construction of dwelling house in accordance with the National Building Regulations
National Home Builders Registration Council's Home Building Manual, 1999	
The Joint Structural Division of The South African Institution of Civil Engineering and The Institution of Structural Engineers. Code of practice.	Foundations and superstructures for single storey residential buildings of masonry construction. 1995

STRUCTURAL DESIGN

SANS 10100: Part 1 - 2002	The structural use of concrete Part 1 : Design
SANS 10100 - 1992	The structural use of concrete Part 2: Materials and execution of work
SANS 10160 - 1989	The general procedures and loadings to be adopted for the design of buildings
SANS 10161 - 1980	The design of foundations for buildings
SANS 10164: Part 1 - 2000	The structural use of masonry Part 1 - unreinforced masonry walling
SANS 10164: Part 2 - 2003	Part 2 - reinforced and prestressed masonry
SANS 1504 - 1990	Prestressed concrete lintels
The Joint Structural Division of The South African Institution of Civil Engineers and The Institution of Structural Engineers	Checklist for structural design.
Crofts F.S; Lane J.W.	Structural concrete masonry. A design guide, 2000

CONCRETE MASONRY CONSTRUCTION

SANS 10145 - 2000	Concrete masonry construction
SANS 10249 - 1993	Masonry walling
SANS 2001 - EM1:2004	Construction works. Cement Plaster

MATERIALS OF CONSTRUCTION

Cement	As above
Lime	
SANS 523 - 2002	Limes for use in building
Sand	
SANS 1090 - 2002	Aggregates from natural sources - Fine aggregate for plaster and mortar



Wall ties

SANS 28 - 1986

Metal ties for cavity walls

Damp-proof courses

SANS 248 - 1973 (2002)

Bituminous damp-proof course

SANS 298 - 1975 (1999)

Mastic asphalt for damp-proofing courses and tanking

SANS 952 - 1985 (2000)

Polyolefin film for damp-proofing and waterproofing in buildings

Lintels

SANS 1504 - 1990 (2002)

Prestressed concrete lintels

REINFORCEMENT

SANS 190 - Part 2: 1984 (2001)

Expanded metal. Part 2: Building products

SANS 920 - 1985 (2002)

Steel bars for concrete reinforcement

SANS 1024 - 1991

Welded steel fabric for reinforcement of concrete

SEALANTS

SANS 110 - 1973 (2001)

Sealing compounds for the building industry, two component, polysulphide base

SANS 1077 - 1984 (2001)

Sealing compound for the building and construction industry, two-component, polyurethane base

SANS 1305 - 1980 (2001)

Sealing compounds for the building industry, one component, silicone - rubber base

USEFUL BRITISH STANDARDS

BS EN 12878: 1999

Pigments for portland cement and portland cement products

BS 4551-1 - 1998

Methods of testing mortars, screeds and plasters

BS 4551-2: 1998

Methods of testing mortars screeds and plaster. Chemical analysis and aggregate grading

BS 4887 Mortar Admixtures

Part 1 : 1986: Specification for air-entraining (plasticising) admixtures

Part 2 : 1987: Specification for set-retarding admixtures

CONCRETE MANUFACTURERS ASSOCIATION PUBLICATIONS

DETAILING OF CONCRETE MASONRY:

Volume 1 Solid Units - 140

Volume 2 Hollow Units - 140/190

Volume 3 Cavity Wall - 240/290

FREE-STANDING WALLS

Design guide

Technical Note: Unreinforced/Reinforced

LINTELS

Design guide

Technical note

BUILDING YOUR HOUSE - STEP BY STEP - WITH BUILDING PLANS

INDEX

A

Accuracy in building	79; 83
Admixtures	48; 78
Aggregate	
coarse	48; 52; 55
fine	47
Anchoring of roofs	41; 62
Anchors, masonry	49; 52

B

Balustrades	47
Bearing plates	63
Block	
bond	8; 44; 60; 61; 80
co-ordinating sizes	4; 15
coping	8
decorative	9
definition	4
pilaster	8
structural shapes	8

Blockwork

Bonding

corners	61
patterns	57
walls	56

Bracing during construction

Brick.	4
--------	---

Building regulations

National Building Regulations	18
National Home Builders Registration Council	18; 21

C

Cavity walls	20; 80
--------------	--------

Cement

common	48; 78
contamination	78
masonry	48; 78
storage	52; 78

Chasing

for services	66
site check	82

Clay masonry unit in same wall as concrete masonry

units	67
-------	----

Cleaning	62; 82
----------	--------

Concrete infill	55; 60
-----------------	--------

Concrete masonry units

appearance	7; 77
block	4
brick	4
colour	7
compressive strength	4; 5; 22; 46; 47; 77; 79
decorative	9
definition	4
density	5; 85
dimensions	4; 6; 77; 84
drying shrinkage	5; 77
durability	10
expansion on rewetting	5
face	7; 77

hollow, definition	5
in same walls as clay masonry units	67
initial rate of absorption	5
moisture condition at time of laying	79
permeability	5
porosity	5
profiles	7
properties	4
rain penetration	70
SABS mark	4
shape	4
shrinkage	5; 77
solid, definition	5; 87
specification	4
storage	52
strength, compressive	4; 5; 22; 46; 47; 77
structural, reinforced masonry	8; 60
textures	7
tolerances, dimensions	5; 77
water absorption	5

Construction

accuracy of building	79; 83
Home Building Manual	21
setting out	55

Control joints

infilling and sealing	66
location and type	30; 39; 63
site checks	81

Coping blocks

	8; 9
--	------

Corners

construction	58; 59; 61
modular planning	15

D

Damp-proof courses	19; 62; 81
--------------------	------------

Design

empirical	18; 21
modular co-ordination	6; 15

Detailing, good practice illustrated	76
--------------------------------------	----

E

Efflorescence.	71
----------------	----

Expanded metal building products	52
----------------------------------	----

F

Fire resistance, walling	12; 19
--------------------------	--------

Flashing	63
----------	----

Foundation walls	34
------------------	----

H

Home Building Manual	21
----------------------	----

J

bedding	
---------	--

profile	58
---------	----

thickness	4; 15
-----------	-------

L

Lateral support	26
-----------------	----

Laying

alignment and perpends	58
------------------------	----

bedding	56
---------	----

bonding	56
---------	----



bonding with a cross wall	57; 58	masonry units	84
cleaning down	62; 82	mortar	84
corners	58	R	
frogs	56	Rain penetration/resistance	18; 19; 70
good practice illustrated	74	Reinforced masonry	
grouted cavity	61	cavity walls	57; 60
jointing	4; 15; 59	hollow units	8; 59
raking back	58	Reinforcement	
reinforced hollow blockwork	60	brickforce	49; 59; 60
reinforcement	59	control on site	78; 80
reveals	58	quality	49; 52; 59
setting out	55; 79	rod	49; 59
site control	56; 79	storage	52
wetting of masonry units	56; 79	Roof anchorage and fixing	40; 62
Lime	48; 78	S	
Lintels		Sand	
garage	45	field test	47
lintel units	8	mortar	47
masonry over opening	41; 81	specification	47; 48; 78
precast prestressed concrete	43	storage	52; 78
u-beams	8; 60	Sills	8; 9
M		Specification	
Masonry over and around openings	63	concrete masonry units	4
Metal lath strips	52	standard specification	4
Modular		construction	77
co-ordinating sizes	15	W	
planning	15	Walling	
Mortar		accommodation of movement	10
batching and mixing	54	acoustic properties	11
colour	54	durability	10
compressive strength	54	fire resistance	12; 18
mix proportions	53	structural strength and stability	10
plasticizers	48	thermal properties	12
properties	52	weatherproofness	11; 18; 19; 70
quantities	84	Walls	
retempering	79	balustrades	47
requirements HBM	54	bonding	56; 57; 60; 61; 80
site control	79	cavity	21; 80
specification	53	collar jointed	28; 29; 31; 32; 33-35; 42
N		design	18
National Home Builders Registration Council	18; 21	double storey	22; 23
National Building Regulations		foundation	22; 23
Part K Walls	18	free-standing	36; 47
SANS 10400 Part K	18	gables	24; 33
O		lateral support	26
Opening	23; 27; 28; 29; 31-33; 63	mass per m ²	87
P		openings	23; 27; 28; 29; 31-33; 63
Painting	82	panel sizes	23-26; 28; 29; 31; 32
Panels, infill	66	piers, in	4
Panel sizes	23-26; 28; 29; 31; 32	retaining	35; 47
Piers	35	single leaf	28-35; 42; 43
Pigments	48	single storey	22
Pilaster block	8	thickness	4; 15; 28; 29; 31-36; 38
Plastering	82	Wall ties	48-51; 68; 78
Protection		Water	48; 78
damage, completed work	67; 82	Weepholes	20; 62; 81
damage, new work	67; 82		
Q			
Quantities			