


Analysis Report

Order # 389973

Customer	SLGi Certified Test Kits (4400)	Location	Basement
Address		Number	
		Pin	MZ4D8AX
		Received	10/13/2020
Attn		Analyzed	10/14/2020
		Reported	10/15/2020
Analysis	Asbestos Identification by PLM	Method	EPA 600/R-93/116 & 40 CFR App. E Sub. E Pt. 763

Sample ID	389973-001	Collected	10/08/2020 05:00 AM
Number	1	Description	Congoleum Durastone HPF 9X9 tile circa 1963 ish. W
Layer # 1	Tile	Description	Tan, Organically Bound
<i>Asbestos Fibers</i>		<i>Other Materials</i>	
2% CHRYSOTILE		98% NON FIBROUS MATERIAL	
Layer # 2	Mastic	Description	Black, Bituminous
<i>Asbestos Fibers</i>		<i>Other Materials</i>	
None Detected		100% NON FIBROUS MATERIAL	

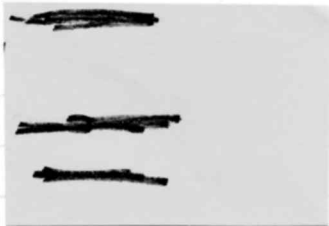


Analyst	Smith, Mary Katherine	Reviewer	Faszewski, Irma
Layers Analyzed	2		
Generated	10/15/2020 12:31:30 PM		

Per the EPA, any material with greater than 1% asbestos is hazardous and must be treated as asbestos containing material. Any removal plans should involve a professional asbestos abatement company. The EPA states that any loose fill vermiculite should be treated as asbestos containing material. The results reported relate only to the samples submitted. This report can only be reproduced in full with laboratory approval. Reporting Limit: 1%