



## RESIDENTIAL TECHNICAL REVIEW HANDOUT

**(Handout for informational purposes only.)**

2012 International Residential Code - <http://publicecodes.cyberregs.com/icod/irc/2012/>

Local Amendments - <http://www.austintexas.gov/department/building-technical-codes>

Updated 02/09/2015

### ✓ EGRESS REQUIREMENTS

#### Emergency escape and rescue required

Basements, habitable attics, and every sleeping room shall have at least one operable emergency escape and rescue opening with a clear opening height of not more than 44 inches above finished floor (AFF). *Reference R310.1*

#### Minimum opening area

All emergency escape and rescue openings shall have a minimum net clear opening of 5.7 sq. ft. *Reference R310.1.1* **Exception:** Grade floor ( $\leq 44''$ ) openings shall have a minimum net clear opening of 5 sq. ft.

#### Minimum opening height

The minimum net clear opening height shall be 24 inches. *Reference R310.1.2*

#### Minimum opening width

The minimum net clear opening width shall be 20 inches. *Reference R310.1.3*

#### Door type and size

The required exit door shall be a single-hinged door not less than 32" clear in width and 78" inches clear in Height (Typically must be a 3'0" wide x 6'8" high door to meet requirements). *Reference R311.2*

#### Retrofit Windows


Requirements for Retrofit Windows, *reference local amendment R324 Retrofit Windows.*

#### Floors and landings at exterior doors

There shall be a landing or floor on each side of each exterior door with a minimum width of the door served. These landings at the required egress door will not be more than 1 1/2" inches lower than the top of the threshold. Exterior landings may not be more than 7 3/4" below the top of the threshold provided the door does not swing over the landing. *Reference R311.3.1*

#### **Bedroom Window Egress**

The second exit required in a bedroom is usually a window. The dimensions of the openings are to ensure the residents an escape route, but equally important, they are designed to allow a firefighter with a backpack to enter. The opening must be at least 24" high and at least 20" wide, with a net area at least 5.7sq.ft., per T15. The window sill must not be higher than 44" from the floor.

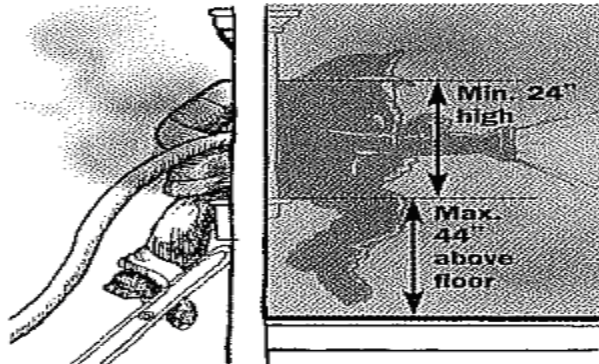

Updated 8/6/2015

Page 1 of 9

## ✓ MINIMUM ROOM AREAS/CEILING HEIGHT

### Minimum area

Every dwelling unit shall have at least one habitable room that shall have not less than 120 sq. ft. of gross floor area. *Reference* R304.1

### Other rooms

Other habitable rooms shall have a floor area of not less than 70 sq. ft. *Reference* R304.2

**Exception:** Kitchens

### Minimum dimensions

Habitable rooms shall not be less than 7 feet in any horizontal dimension. *Reference* R304.3

**Exception:** Kitchens

### Height effect on room area

Portions of a room with a sloping ceiling measuring <5' or furred ceiling measuring <7' above finished floor (AFF) shall not be considered as contributing to the minimum required habitable area for that room. *Reference* R304.4

### Minimum height

Habitable space, hallways, corridors, bathrooms, toilet rooms, laundry rooms and portions of basements containing these spaces shall have a height of not less than 7 feet AFF to the lowest projection from the ceiling. *Reference* R305.1

**Exception:** Items 1-2 listed on pages 54 of 2012 IRC & R305.1.1 Basements.

## ✓ SMOKE DETECTOR REQUIREMENTS

### Location

Smoke alarms shall be installed in the following locations: **Each sleeping room, outside each sleeping area** in the immediate vicinity of the bedrooms, **on each additional story** of the dwelling, including basements but not including crawl spaces and uninhabitable attics.

**Note:** When more than one smoke alarm is required to be installed, the devices shall be hard-wired and interconnected, with battery back-up. *Reference* R314 local amendment

### Alterations, repairs and additions

When alterations, repairs or additions requiring a permit occur, or when one or more sleeping rooms are added or created in existing dwellings, the individual dwelling unit shall be equipped with smoke alarms located as required for new dwellings; the smoke alarms shall be interconnected and hard wired.

*Reference* R314 local amendment

**Exceptions:** Interconnection and hard wiring of existing areas is not required unless there is existing access or access as a result of work being done. Exterior work is exempt from this requirement.

# CARBON MONOXIDE ALARMS

## Location

For new construction, an approved carbon monoxide alarm shall be installed outside of each separate sleeping area in the immediate vicinity of the bedrooms in dwelling units within which fuel-fired appliances are installed and in dwelling units that have attached garages. *Reference R315.1 local amendment*

## Existing dwelling requirements


Where work requiring a permit occurs in existing dwellings that have attached garages or in existing dwellings within which fuel-fired appliances exist, carbon monoxide alarms shall be installed as stated above. *Reference R315.3 local amendment*

## ✓ SAFETY GLAZING

### Hazardous locations requiring safety glazing

The following locations/uses (but not limited to) require tempered safety glass: All doors except jalousies, panels adjacent and within 24 inches of a door and sill less than 60", any wall enclosing whirlpools, saunas, pools, tubs and showers within 60" vertically and horizontally, adjacent to stairs and landings within 60 inches horizontally, skylights and sloped glazing, panels with 9 sq. ft. and bottom within 18 inches of floor and top 36 inches above the floor and within 36 inches of a walking surface. *Reference R308.4*

**Note:** The above is a condensed list of the most common safety glazing situations. There are many variables and exceptions not listed above which can be found on pages 55-58 of 2012 IRC.

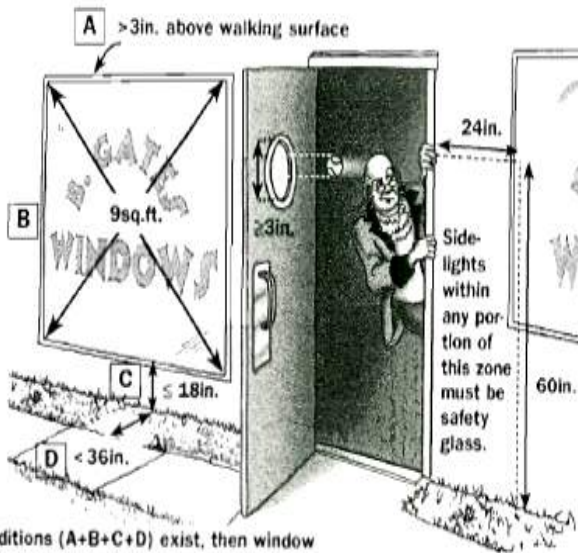

If all conditions (A+B+C+D) exist, then window must be safety glass. Safety glazing would also be req'd if within 2ft. of the door frame.




**Safety glazing is required when a walk-through hazard exists, defined as meeting ALL of the following:**

- Exposed area of glazing >9sq. ft. +
- Bottom edge <18in above floor or ground +
- Top edge >36in above floor or ground +
- Within 36in horizontal of walking surface
- **Exception;** Min 1/2in high protective guard installed 34-38in above floor

**✓ TOILET, BATH AND SHOWER SPACES**

Space required  
 Fixtures shall be spaced as per figure below. Reference R307 Figure 307.1.

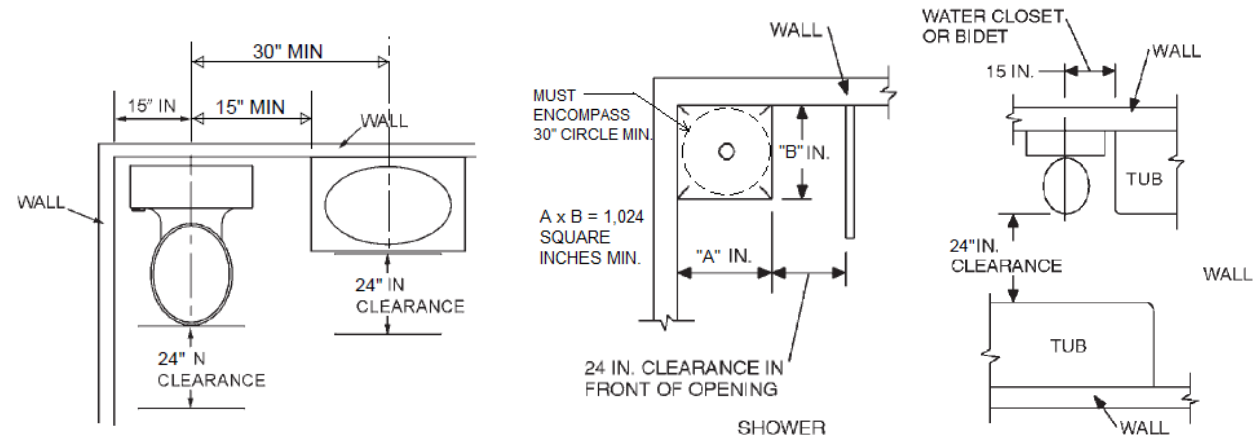



**✓ HANDRAILS/GUARDRAILS**

Handrails  
 Provided on at least one side of each continuous run of treads or flight with four or more risers. Reference 311.7.8

Height  
 Measured vertically from the sloped plane of stairs or ramp shall not be less than 34 inches and not more than 38 inches. Reference 311.7.8.1

Continuity  
 Shall be continuous for the full length of the flight, from directly above the top riser to directly above the lowest riser and shall be returned. Reference R311.7.8.2

**Handrail Height**

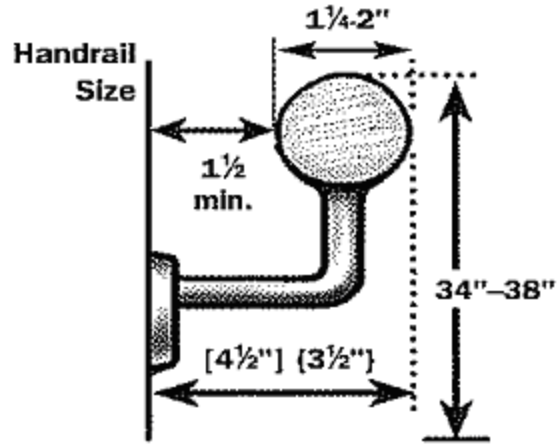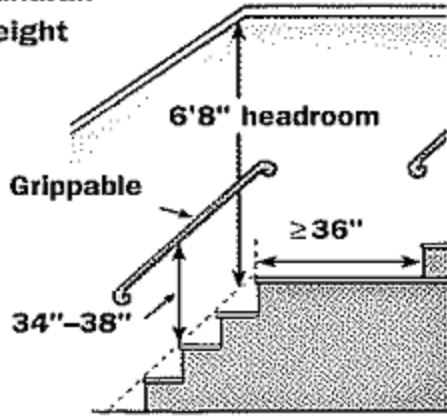


Guardrails

Porches, balconies, ramps or raised floor surfaces located more than 30 inches above floor or grade below at any point within 36" horizontally to the edge shall have guards not less than 36 inches in height with a maximum 4 inch opening. *Reference 312.1*

**Guardrails**

**Guardrail req'd when deck surface to ground >30"**

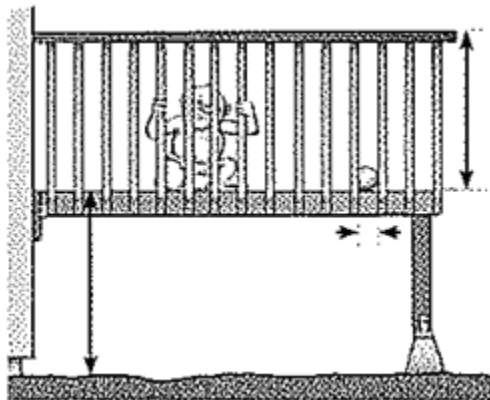

**Min. height: 36" single family dwelling**

**Max. opening such that a 4" sphere cannot pass through**

## ✓ STAIRWAYS

### Width

Shall be not less than 36 inches in clear width above handrail height and below headroom height. Handrails shall not project more than 4.5 inches on either side and minimum clear width shall not be less than 31.5 inches where handrail is provided on one side and 27 inches where handrails are provided on both sides. *Reference R311.7.1*

### Headroom

Minimum headroom in all parts of the stairway shall not be less than 6 feet 8 inches. *Reference R311.7.2*

### Riser height

Maximum riser height shall be  $7\frac{3}{4}$  inches. The greatest riser height within any flight of stairs shall not exceed the smallest by more than  $\frac{3}{8}$  inch. *Reference 311.5. 1*

### Tread depth


Minimum tread depth shall be 10 inches. The greatest tread depth within any flight of stairs shall not exceed the smallest by more than  $\frac{3}{8}$  inch. *Reference 311.5. 2*

### Landings


There shall be a floor or landing at the top and bottom of each stairway. A flight of stairs shall not have a vertical rise larger than 12 feet between floor levels or landings. The width of each landing shall not be less than the width of the stairway served and shall have a minimum dimension of 36 inches in the direction of travel. *Reference 311.7.6*

**Exception:** A floor or landing is not required at the top of an interior flight of stairs, including the stairs in an enclosed garage, provided that a door does not swing over the stair

**Winding Stairs**

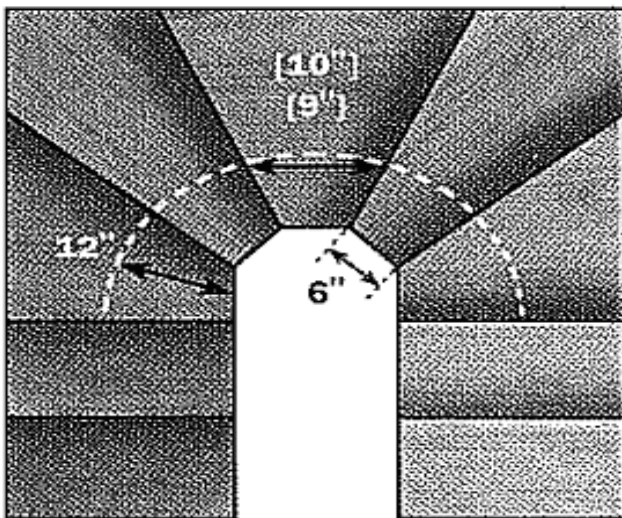

**Stair Profile**

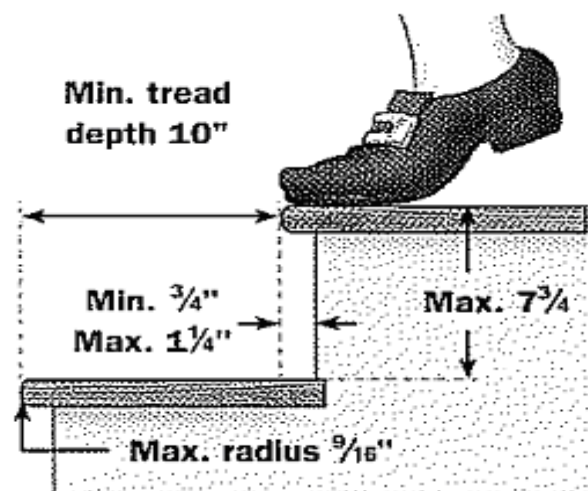



## ✓ EXTERIOR WALLS

### Exterior wall location *Reference Table R302.1*

Construction, projections, openings and penetrations of exterior walls of dwellings and accessory buildings shall comply with table below. These provisions shall not apply to walls, projections, openings or penetrations in walls that are perpendicular to the line used to determine fire separation distance. Projections beyond the exterior wall shall not extend more than 12 inches into areas where openings are prohibited.

**Exceptions:** 1. Detached tool sheds and storage sheds, playhouses and similar structures exempted from permits are not required to provide wall protection based on location on the lot. Projections beyond the exterior wall shall not extend over the lot line. 2. Detached garages accessory to a dwelling located within 2 feet (610 mm) of a lot line are permitted to have roof eave projections not exceeding 4 inches (102 mm). 3. Foundation vents installed in compliance with this code are permitted.

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Walls	(Fire-resistance rated)	1 hour-tested in accordance with ASTM E 119 or UL 263 with exposure <i>from</i> both sides	< 5 feet
	(Not fire-resistance rated)	0 hours	≥ 5 feet
Projections	(Fire-resistance rated)	1 hour on the underside	≥ 2 feet to 5 feet
	(Not fire-resistance rated)	0 hours	5 feet
Openings in walls	Not allowed	N/A	< 3 feet
	25% maximum of wall area	0 hours	3 feet
	Unlimited	0 hours	5 feet
Penetrations	All	Comply with Section <i>R302.4</i>	< 5 feet
		None required	5 feet

## ✓ VISITABILITY

### Visitability (new construction only) *Reference R320*

Visitability applies to any new structure that constitutes a dwelling unit per the International Residential Code (IRC). Detailed plans must be prepared by a Texas-Registered Architect or Certified Building Designer holding a National Council of Building Designers Certification seal. Drawings and notes must be provided specific to project.

- Exterior route originating from garage, driveway, public street or public sidewalk to visitable entrance.
- No-step visitable entrance 32" clear (36" door) with beveled threshold 1/2" or less and landing.
- 32" clear accessible route from entrance through living/dining/kitchen to visitable bathroom.
- Water closet/bathroom located on the first floor shall have a net clear opening of at least 30 inches (32" door) and 2x6 blocking @ 34" height from finished floor for grab bars. Door swings shall not impede the 30" x 30" clear floor space within the visitable bathroom.
- Light switches & environmental controls no higher than 48" and outlets no lower than 15" above the floor.

Waiver of Exterior Visitable Route A waiver for exterior route can be requested with permit application for:

1. Lots with 10% or greater slope prior to development; or
2. Properties for which compliance cannot be achieved without the use of switchbacks.

\*S.M.A.R.T. Housing waivers must be approved by Neighborhood Housing and Community Development.

[http://www.austintexas.gov/sites/default/files/files/Housing/Application\\_Center/SMART\\_Housing/smart\\_guide\\_0708.pdf](http://www.austintexas.gov/sites/default/files/files/Housing/Application_Center/SMART_Housing/smart_guide_0708.pdf)

*Reference R320 local amendment* <http://www.austintexas.gov/edims/document.cfm?id=205386>.

**Note:** Refer to **Building Criteria Manual section 4.4.7 Visitability** for additional information:

[https://www.municode.com/library/tx/austin/codes/building\\_criteria\\_manual?nodeId=S4RECO\\_4.4.0RESURE\\_4.4.7VI](https://www.municode.com/library/tx/austin/codes/building_criteria_manual?nodeId=S4RECO_4.4.0RESURE_4.4.7VI)

## Criteria for Structural Plans

### **Suspended Foundations:**

- Pier/Footing locations/dimensions
- Pier/footing sizes and depth below grade
- Footing details (materials, reinforcing, etc.)
- Joist/beam layout (size and spacing)
- Details for anchorage of structure to foundation
- Foundation requirements at braced wall panels
- Connection to existing foundation where applicable

### **Slab-on-grade Foundations:**

- Slab layout (beam locations, changes in slab elevation, slab openings)
- Beam sizes (width and depth)
- Concrete compressive strength
- Reinforcing details
- Details for anchorage of structure to foundation
- Foundation requirements at braced wall panels
- Connection to existing foundation where applicable

### **Footings (for decks, pergolas, carports, etc.):**

- Footing locations/dimensions
- Footing sizes and depth below grade
- Footing details (materials, reinforcing, etc.)
- Connection details for superstructure to foundation

### **Wood Framed Walls:**

- Stud spacing/ wood grade
- Headers – size/span/material type
- Foundation/floor/ceiling connection details
- Anchor requirements to foundation

### **Wood Framed Floors:**

- Live loads supported
- Joist sizes
- Joist layout/spacing
- Intermediate girder size and location
- Floor sheathing information (type, thickness)

### **Wood Framed Roofs:**

- Live load supported
- Ceiling joist size/layout/spacing
- Rafter size/layout/spacing
- Ridge boards
- Roof sheathing information (type, thickness)
- Collar ties
- Rafter ties

### **Trusses/I-joists:**

- Truss layout and spacing
- Support structure framing (headers, beams, walls, columns)
- Truss package due at field inspections

### **Wind Bracing Plans:**

- Braced wall lines layout
- Braced wall methods used
- Braced wall panel locations
- Fasteners/nail pattern
- Details for methods used

Structural design must meet the prescriptive requirements of the 2012 International Residential Code; otherwise a Texas-licensed engineer or architect must provide and seal the structural drawings. A Texas-licensed engineer is required for foundations on expansive soil.



## Structural Verifications

A Structural Verification Report, completed by a Texas Registered Architect or Engineer, can be submitted in lieu of structural drawing requirements for the following conditions:

- 1) Conversion of a carport with an existing foundation, open on no more than 2 sides, to a single-story habitable space.
- 2) Projects eligible for a Remodel/Repair permit where no additions to the proposed building are proposed
- 3) Change of use with remodel work only where no additions to the building are proposed
- 4) Verification of existing foundations less than 10 years in age
- 5) Verification of existing framing and wall bracing for structures between 5 to 10 years of age
- 6) As required by the reviewer to complete a review for technical code compliance

This verification should include at the minimum:

- 1) Date of the site visit
- 2) Areas of the property observed
- 3) Detailed foundation and framing information of existing structure
- 4) Current condition of existing structure
- 5) Engineer's/Architect's opinion of the adequacy of the existing structure to support the anticipated loads
- 6) Engineer's/Architect's repair plan, if required, to bring the structure up to the adequacy required to support the anticipated loads.

The Structural Verification Report Form can be found at:

[http://www.austintexas.gov/sites/default/files/files/Planning/Applications\\_Forms/Structural\\_Verification\\_Report\\_citylogo.pdf](http://www.austintexas.gov/sites/default/files/files/Planning/Applications_Forms/Structural_Verification_Report_citylogo.pdf)

Reference: Rule of Adoption R161-15.19 Building Criteria Manual, Section 4: Residential Construction

<http://www.austintexas.gov/edims/document.cfm?id=245752>